



June 9, 2014

BY ELECTRONIC FILING

The Honorable Kimberly D. Bose, Secretary
Federal Energy Regulatory Commission
888 First Street, NE
Washington, DC 20426

RE: **ISO New England Inc. and New England Power Pool, Docket No. ER14- -
000, Section 12 Demand Curve Changes**

Dear Secretary Bose:

Pursuant to Section 205 of the Federal Power Act (“Section 205”),¹ ISO New England Inc. (the “ISO”), joined by the New England Power Pool (“NEPOOL”) Participants Committee² (together, the “Filing Parties”),³ hereby electronically submit this transmittal letter and revisions to the ISO Tariff to make changes to Section III.12 of Market Rule 1 to reflect the use of a System-Wide Capacity Demand Curve in the capacity market starting with the ninth Forward Capacity Auction (“FCA 9”) to be held in early 2015. The tariff changes add provisions concerning the calculation of certain parameters that define the shape of the sloped demand curve, as well as making several additional clarifying and clean-up changes to Section III.12 (collectively, the tariff changes are referred to as the “Section 12 Demand Curve Changes”). In support of the changes, the ISO is submitting the testimony of Peter K. Wong, Manager of Resource Adequacy (the “PKW Testimony”), which is sponsored solely by the ISO.

¹ 16 U.S.C. § 824d (2006 and Supp. II 2009).

² Capitalized terms used but not defined in this filing are intended to have the meaning given to such terms in the ISO New England Inc. Transmission, Markets and Services Tariff (the “Tariff”), the Second Restated New England Power Pool Agreement, and the Participants Agreement. Market Rule 1 is Section III of the Tariff.

³ Under New England’s Regional Transmission Organization (“RTO”) arrangements, the rights to make this filing of changes to Market Rule 1 under Section 205 of the Federal Power Act are the ISO’s. NEPOOL, which pursuant to the Participants Agreement provides the sole Participant Processes for advisory voting on ISO matters, supported the changes reflected in this filing and, accordingly, joins in this Section 205 filing.

The Honorable Kimberly D. Bose
June 9, 2014
Page 2 of 7

I. REQUESTED EFFECTIVE DATE

The Filing Parties request an effective date for the Section 12 Demand Curve Changes of September 1, 2014.

II. DESCRIPTION OF THE FILING PARTIES; COMMUNICATIONS

The ISO is the private, non-profit entity that serves as the regional transmission organization (“RTO”) for New England. The ISO operates the New England bulk power system and administers New England’s organized wholesale electricity market pursuant to the Tariff and the Transmission Operating Agreement with the New England Participating Transmission Owners. In its capacity as an RTO, the ISO has the responsibility to protect the short-term reliability of the New England Control Area and to operate the system according to reliability standards established by the Northeast Power Coordinating Council (“NPCC”) and the North American Electric Reliability Corporation (“NERC”).

NEPOOL is a voluntary association organized in 1971 pursuant to the New England Power Pool Agreement, and it has grown to include more than 430 members. The Participants include all of the electric utilities rendering or receiving service under the Tariff, as well as independent power generators, marketers, load aggregators, brokers, consumer-owned utility systems, end users, demand resource providers, developers and a merchant transmission provider. Pursuant to revised governance provisions accepted by the Commission,⁴ the Participants act through the NEPOOL Participants Committee. The Participants Committee is authorized by Section 6.1 of the Second Restated NEPOOL Agreement and Section 8.1.3(c) of the Participants Agreement to represent NEPOOL in proceedings before the Commission. Pursuant to Section 2.2 of the Participants Agreement, “NEPOOL provide[s] the sole Participant Processes for advisory voting on ISO matters and the selection of ISO Board members, except for input from state regulatory authorities and as otherwise may be provided in the Tariff, TOA and the Market Participant Services Agreement included in the Tariff.”

All correspondence and communications in this proceeding should be addressed to the undersigned for the ISO as follows:

James H. Douglass, Esq.*
ISO New England Inc.
One Sullivan Road
Holyoke, MA 01040-2841
Tel: (413) 540-4559
Fax: (413) 535-4379
E-mail: jdouglass@iso-ne.com

⁴ *ISO New England Inc., et al.*, 109 FERC ¶ 61,147 (2004).

The Honorable Kimberly D. Bose
June 9, 2014
Page 3 of 7

And to NEPOOL as follows:

William Fowler*
Vice Chair, NEPOOL Reliability Committee
c/o Sigma Consultants, Inc.
20 Main Street
Acton, MA 01720
Tel: (978) 266-0220
Fax: (978) 263-5455
Email: wfowler@sigmaconsult.com

David T. Doot, Esq.*
Sebastian M. Lombardi, Esq.*
Day Pitney LLP
242 Trumbull Street
Hartford, CT 06103
Tel: (860) 275-0663
Fax: (860) 881-2493
Email: dt_doot@daypitney.com
slombardi@daypitney.com

*Persons designated for service⁵

III. STANDARD OF REVIEW

These changes are being submitted pursuant to Section 205, which “gives a utility the right to file rates and terms for services rendered with its assets.”⁶ Under Section 205, the Commission “plays ‘an essentially passive and reactive role’”⁷ whereby it “can reject [a filing] only if it finds that the changes proposed by the public utility are not ‘just and reasonable.’”⁸ The Commission limits this inquiry “into whether the rates proposed by a utility are reasonable - and [this inquiry does not] extend to determining whether a proposed rate schedule is more or less reasonable than alternative rate designs.”⁹ The changes proposed herein “need not be the only reasonable methodology, or even the most accurate.”¹⁰ As a result, even if an intervenor or the Commission develops an alternative proposal, the Commission must accept this Section 205 filing if it is just and reasonable.¹¹

⁵ Due to the joint nature of this filing, the Filing Parties respectfully request a waiver of Section 385.203(b)(3) of the Commission’s regulations to allow the inclusion of more than two persons on the service list in this proceeding.

⁶ *Atlantic City Elec. Co. v. FERC*, 295 F. 3d 1, 9 (D.C. Cir. 2002).

⁷ *Id.* at 10 (quoting *City of Winnfield v. FERC*, 744 F.2d 871, 876 (D.C. Cir. 1984)).

⁸ *Id.* at 9.

⁹ *City of Bethany v. FERC*, 727 F.2d 1131, 1136 (D.C. Cir. 1984).

¹⁰ *Oxy USA, Inc. v. FERC*, 64 F.3d 679, 692 (D.C. Cir. 1995).

¹¹ *Cf. Southern California Edison Co., et al*, 73 FERC ¶ 61,219 at 61,608 n.73 (1995) (“Having found the Plan to be just and reasonable, there is no need to consider in any detail the alternative plans proposed by the Joint Protesters.” (citing *Bethany*)).

The Honorable Kimberly D. Bose
June 9, 2014
Page 4 of 7

IV. THE SECTION 12 DEMAND CURVE CHANGES

On April 1, 2014, the Filing Parties submitted tariff changes in Docket No. ER14-1639 to provide for the use of a sloped demand curve in the Forward Capacity Market beginning with FCA 9. On May 30, 2014, the Commission accepted the sloped demand curve tariff changes.¹²

As discussed in the PKW Testimony, the shape of the System-Wide Capacity Demand Curve is defined by Loss of Load Expectation (“LOLE”) values reflecting the “reliability” associated with higher or lower levels of installed capacity.¹³ Specifically, the sloped demand curve requires the calculation of capacity requirement values associated with LOLE values of 1-in-5 and 1-in-87 days/year.¹⁴ Under the existing provisions of Section III.12, the ISO calculates the annual Installed Capacity Requirement based on an LOLE value of 1-in-10 days/year. Under the Section 12 Demand Curve Changes, the ISO will continue to calculate the Installed Capacity Requirement based on the 1-in-10 LOLE value, but will also calculate the capacity requirement values required for the demand curve based on LOLE values of 1-in-5 and 1-in-87 days/year. The capacity requirement values will be calculated using the same modeling methods, assumptions and calculations as are currently used to calculate the Installed Capacity Requirement.¹⁵ The calculation of the capacity requirement values will be reviewed with stakeholders and filed with the Commission using the same process as is currently used for determining and filing the annual Installed Capacity Requirement prior to each auction under the Forward Capacity Market.¹⁶

The Section 12 Demand Curve Changes also include several conforming and clean-up changes. For example, two new defined terms are added to Section I.2.2 - Local Resource Adequacy Requirement and Transmission Security Analysis Requirement - to reflect the use of these terms in Sections III.12.2.1.1 and III.12.2.1.2, respectively.¹⁷ Also, there are a handful of wording changes throughout Section III.12 that are intended to clarify existing provisions or correct typographical errors.¹⁸

¹² *ISO New England Inc. and New England Power Pool, Order Accepting Tariff Revisions*, 147 FERC ¶ 61,173 (2014).

¹³ PKW Testimony at p. 3.

¹⁴ *Id.*

¹⁵ *Id.* at p. 4.

¹⁶ *Id.*

¹⁷ *Id.* at p. 5.

¹⁸ *Id.*

The Honorable Kimberly D. Bose
 June 9, 2014
 Page 5 of 7

V. STAKEHOLDER PROCESS

At its May 20, 2014 meeting, the NEPOOL Reliability Committee voted unanimously to recommend that the NEPOOL Participants Committee support the Section 12 Demand Curve Changes. At its June 6, 2014 meeting, the Participants Committee voted unanimously to support the changes as part of its Consent Agenda.¹⁹

VI. ADDITIONAL SUPPORTING INFORMATION

Section 35.13 of the Commission's regulations generally requires public utilities to file certain cost and other information related to an examination of traditional cost-of-service rates. However, the Section 12 Demand Curve Changes do not modify a traditional "rate" and the ISO is not a traditional investor-owned utility. Therefore, to the extent necessary, the Filing Parties request waiver of Section 35.13 of the Commission's regulations.²⁰ Notwithstanding its request for waiver, the Filing Parties submit the following additional information in substantial compliance with relevant provisions of Section 35.13 of the Commission's regulations:

35.13(b)(1) – Materials included herewith are as follows:

- This transmittal letter;
- Blacklined ISO Tariff sections reflecting the revision submitted in this filing;
- Clean ISO Tariff sections reflecting the revision submitted in this filing;
- Testimony of Peter K. Wong, the ISO's Manager of Resource Adequacy, sponsored solely by the ISO;
- List of governors and utility regulatory agencies in Connecticut, Maine, Massachusetts, New Hampshire, Rhode Island and Vermont to which a copy of this filing has been sent.

35.13(b)(2) – As set forth in Section I above, the Filing Parties request that the changes become effective on September 1, 2014.

¹⁹ The Consent Agenda for a Participants Committee meeting, similar to the Consent Agenda for a Commission open meeting, is a group of actions (each recommended by a Technical Committee or subgroup established by the Participants Committee) to be taken by the Participants Committee through approval of a single motion at a meeting. All recommendations voted on as part of the Consent Agenda are deemed to have been voted on individually and independently. The Participants Committee's unanimous approval of the June 6, 2014 Consent Agenda included its support for the Section 12 Demand Curve Changes.

²⁰ 18 C.F.R. § 35.13 (2011).

The Honorable Kimberly D. Bose

June 9, 2014

Page 6 of 7

35.13(b)(3) – Pursuant to Section 17.11(e) of the Participants Agreement, Governance Participants are being served electronically rather than by paper copy. The names and addresses of the Governance Participants are posted on the ISO's website at http://www.iso-ne.com/committees/nepool_part/index.html. A copy of this transmittal letter and the accompanying materials have also been sent to the governors and electric utility regulatory agencies for the six New England states that comprise the New England Control Area, the New England Conference of Public Utility Commissioners, Inc., and to the New England States Committee on Electricity. Their names and addresses are shown in the attached listing. In accordance with Commission rules and practice, there is no need for the Governance Participants or the entities identified in the listing to be included on the Commission's official service list in the captioned proceeding unless such entities become intervenors in this proceeding.

35.13(b)(4) – A description of the materials submitted pursuant to this filing is contained in Section VI of this transmittal letter.

35.13(b)(5) – The reasons for this filing are discussed in Section IV of this transmittal letter.

35.13(b)(6) – The ISO's approval of the changes is evidenced by this filing. The changes reflect the results of the Participant Processes required by the Participants Agreement and reflect the support of the Participants Committee.

35.13(b)(7) – Neither the ISO nor NEPOOL has knowledge of any relevant expenses or costs of service that have been alleged or judged in any administrative or judicial proceeding to be illegal, duplicative, or unnecessary costs that are demonstrably the product of discriminatory employment practices.

35.13(b)(8) – A form of notice and electronic media are no longer required for filings in light of the Commission's Combined Notice of Filings notice methodology.

35.13(c)(1) – The changes submitted herein do not modify a traditional "rate," and the statement required under this Commission regulation is not applicable to the instant filing.

35.13(c)(2) – The ISO does not provide services under other rate schedules that are similar to the wholesale, resale and transmission services it provides under the Tariff.

35.13(c)(3) – No specifically assignable facilities have been or will be installed or modified in connection with the revision filed herein.

The Honorable Kimberly D. Bose

June 9, 2014

Page 7 of 7

VII. CONCLUSION

For the reasons discussed in this transmittal letter, the Filing Parties request that the Commission accept the Section 12 Demand Curve Changes to become effective on September 1, 2014.

Respectfully submitted,

ISO NEW ENGLAND INC.

**NEW ENGLAND POWER POOL
PARTICIPANTS COMMITTEE**

By: /s/ James H. Douglass

By: /s/ Sebastian M. Lombardi

James H. Douglass, Esq.
ISO New England Inc.
One Sullivan Road
Holyoke, MA 01040-2841
Tel: (413) 540-4559
Fax: (413) 535-4379
E-mail: jdouglass@iso-ne.com

Sebastian M. Lombardi, Esq.
Day Pitney LLP
242 Trumbull Street
Hartford, CT 06103
Tel: (860) 275-0663
Fax: (860) 881-2493
Email: slombardi@daypitney.com

I.2 Rules of Construction; Definitions

I.2.1 Rules of Construction:

In this Tariff, unless otherwise provided herein:

- (a) words denoting the singular include the plural and vice versa;
- (b) words denoting a gender include all genders;
- (c) references to a particular part, clause, section, paragraph, article, exhibit, schedule, appendix or other attachment shall be a reference to a part, clause, section, paragraph, or article of, or an exhibit, schedule, appendix or other attachment to, this Tariff;
- (d) the exhibits, schedules and appendices attached hereto are incorporated herein by reference and shall be construed with an as an integral part of this Tariff to the same extent as if they were set forth verbatim herein;
- (e) a reference to any statute, regulation, proclamation, ordinance or law includes all statutes, regulations, proclamations, amendments, ordinances or laws varying, consolidating or replacing the same from time to time, and a reference to a statute includes all regulations, policies, protocols, codes, proclamations and ordinances issued or otherwise applicable under that statute unless, in any such case, otherwise expressly provided in any such statute or in this Tariff;
- (f) a reference to a particular section, paragraph or other part of a particular statute shall be deemed to be a reference to any other section, paragraph or other part substituted therefor from time to time;
- (g) a definition of or reference to any document, instrument or agreement includes any amendment or supplement to, or restatement, replacement, modification or novation of, any such document, instrument or agreement unless otherwise specified in such definition or in the context in which such reference is used;
- (h) a reference to any person (as hereinafter defined) includes such person's successors and permitted assigns in that designated capacity;
- (i) any reference to "days" shall mean calendar days unless "Business Days" (as hereinafter defined) are expressly specified;
- (j) if the date as of which any right, option or election is exercisable, or the date upon which any amount is due and payable, is stated to be on a date or day that is not a Business Day, such right, option or election may be exercised, and such amount shall be deemed due and payable, on the next succeeding Business Day with the same effect as if the same was exercised or made on such date or day (without, in the case of any such payment, the payment or accrual of any interest or

other late payment or charge, provided such payment is made on such next succeeding Business Day);

- (k) words such as “hereunder,” “hereto,” “hereof” and “herein” and other words of similar import shall, unless the context requires otherwise, refer to this Tariff as a whole and not to any particular article, section, subsection, paragraph or clause hereof; and a reference to “include” or “including” means including without limiting the generality of any description preceding such term, and for purposes hereof the rule of *ejusdem generis* shall not be applicable to limit a general statement, followed by or referable to an enumeration of specific matters, to matters similar to those specifically mentioned.

I.2.2. Definitions:

In this Tariff, the terms listed in this section shall be defined as described below:

Actual Load is the consumption at the Retail Delivery Point for the hour.

Adjusted Audited Demand Reduction is the Audited Demand Reduction of a Demand Response Resource adjusted in accordance with Section III.13.7.1.5.10.1.1.

Additional Resource Blackstart O&M Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Additional Resource Specified-Term Blackstart Capital Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Additional Resource Standard Blackstart Capital Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Administrative Costs are those costs incurred in connection with the review of Applications for transmission service and the carrying out of System Impact Studies and Facilities Studies.

Administrative Export De-List Bid is a bid that may be submitted in a Forward Capacity Auction by certain Existing Generating Capacity Resources subject to a multi-year contract to sell capacity outside of the New England Control Area during the associated Capacity Commitment Period, as described in Section III.13.1.2.3.1.4 of Market Rule 1.

Administrative Sanctions are defined in Section III.B.4.1.2 of Appendix B of Market Rule 1.

ADR Neutrals are one or more firms or individuals identified by the ISO with the advice and consent of the Participants Committee that are prepared to act as neutrals in ADR proceedings under Appendix D to Market Rule 1.

Advance is defined in Section IV.A.3.2 of the Tariff.

Affected Party, for purposes of the ISO New England Billing Policy, is defined in Section 6.3.5 of the ISO New England Billing Policy.

Affiliate is any person or entity that controls, is controlled by, or is under common control by another person or entity. For purposes of this definition, "control" means the possession, directly or indirectly, of the authority to direct the management or policies of an entity. A voting interest of ten percent or more shall create a rebuttable presumption of control.

AGC is automatic generation control.

Allocated Assessment is a Covered Entity's right to seek and obtain payment and recovery of its share in any shortfall payments under Section 3.3 or Section 3.4 of the ISO New England Billing Policy.

Alternative Capacity Price Rule is a rule potentially affecting Capacity Clearing Prices in a Forward Capacity Auction, as described in Section III.13.2.7.8 of Market Rule 1.

Alternative Dispute Resolution (ADR) is the procedure set forth in Appendix D to Market Rule 1.

Alternative Technologies Regulation Pilot Program is the pilot described in Appendix J to Market Rule 1.

Ancillary Services are those services that are necessary to support the transmission of electric capacity and energy from resources to loads while maintaining reliable operation of the New England Transmission System in accordance with Good Utility Practice.

Announced Schedule 1 EA Amount, Announced Schedule 2 EA Amount, Announced Schedule 3 EA Amount are defined in Section IV.B.2.2 of the Tariff.

Annual Transmission Revenue Requirements are the annual revenue requirements of a PTO's PTF or of all PTOs' PTF for purposes of the OATT shall be the amount determined in accordance with Attachment F to the OATT.

Annualized FCA Payment is used to determine a resource's availability penalties and is calculated in accordance with Section III.13.7.2.7.1.2(b) of Market Rule 1.

Applicants, for the purposes of the ISO New England Financial Assurance Policy, are entities applying for Market Participant status or for transmission service from the ISO.

Application is a written request by an Eligible Customer for transmission service pursuant to the provisions of the OATT.

APR-1 means the first of three Alternative Capacity Price Rule mechanisms described in Section III.13.2.7.8.

APR-2 means the second of three Alternative Capacity Price Rule mechanisms described in Section III.13.2.7.8.

APR-3 means the third of three Alternative Capacity Price Rule mechanisms described in Section III.13.2.7.8.

Asset is a generating unit, interruptible load, a component of a demand response resource or load asset.

Asset Registration Process is the ISO business process for registering a physical load, generator, or tie-line for settlement purposes. The Asset Registration Process is posted on the ISO's website.

Asset Related Demand is a physical load that has been discretely modeled within the ISO's dispatch and settlement systems, settles at a Node and, except for pumped storage load, is made up of one or more individual end-use metered customers receiving service from the same point or points of electrical supply, with an aggregate average hourly load of 1 MW or greater during the 12 months preceding its registration.

Asset Related Demand Bid Block-Hours are Block-Hours assigned to the Lead Market Participant for each Asset Related Demand bid. The daily bid Blocks in the price-based Real-Time bid will be multiplied by the number of hours in the day to determine the daily quantity of Asset Related Demand Bid Block-Hours. In the case that a Resource has a Real-Time unit status of “unavailable” for an entire day, that day will not contribute to the quantity of Asset Related Demand Bid Block-Hours. However, if the Resource has at least one hour of the day with a unit status of “available,” the entire day will contribute to the quantity of Asset Related Demand Bid Block-Hours.

Asset-Specific Going Forward Costs are the net risk-adjusted going forward costs of an asset that is part of an Existing Generating Capacity Resource, calculated for the asset in the same manner as the net-risk adjusted going forward costs of Existing Generating Capacity Resources as described in Section III.13.1.2.3.2.1.2.

Assigned Meter Reader reports to the ISO the hourly and monthly MWh associated with the Asset. These MWh are used for settlement. The Assigned Meter Reader may designate an agent to help fulfill its Assigned Meter Reader responsibilities; however, the Assigned Meter Reader remains functionally responsible to the ISO.

Auction Revenue Right (ARR) is a right to receive FTR Auction Revenues in accordance with Appendix C of Market Rule 1.

Auction Revenue Right Allocation (ARR Allocation) is defined in Section 1 of Appendix C of Market Rule 1.

Auction Revenue Right Holder (ARR Holder) is an entity which is the record holder of an Auction Revenue Right (excluding an Incremental ARR) in the register maintained by the ISO.

Audited Demand Reduction is the seasonal claimed capability of a Demand Response Resource as established pursuant to Section III.13.6.1.5.4.

Audited Full Reduction Time is the Offered Full Reduction Time associated with the Demand Response Resource’s most recent audit.

Authorized Commission is defined in Section 3.3 of the ISO New England Information Policy.

Authorized Person is defined in Section 3.3 of the ISO New England Information Policy.

Automatic Response Rate is the response rate, in MW/Minute, at which a Market Participant is willing to have a generating unit change its output while providing Regulation between the Regulation High Limit and Regulation Low Limit.

Average Hourly Load Reduction is either: (i) the sum of the Demand Resource's electrical energy reduction during Demand Resource On-Peak Hours in the month divided by the number of Demand Resource On-Peak Hours in the month; (ii) the sum of the Demand Resource's electrical energy reduction during Demand Resource Seasonal Peak Hours in the month divided by the number of Demand Resource Seasonal Peak Hours in the month; or (iii) in each Real-Time Demand Response Event Hour, the sum of the baseline electrical energy consumption less the sum of the actual electrical energy consumption of all of the Real-Time Demand Response Assets associated with the Real-Time Demand Response Resource as registered with the ISO as of the first day of the month; or (iv) in each Real-Time Emergency Generation Event Hour, the sum of the baseline electrical energy consumption less the sum of the actual electrical energy consumption of all of the Real-Time Emergency Generation Assets associated with the Real-time Emergency Generation Resource as registered with the ISO as of the first day of the month. The Demand Resource's electrical energy reduction and Average Hourly Load Reduction shall be determined consistent with the Demand Resource's Measurement and Verification Plan, which shall be reviewed by the ISO to ensure consistency with the measurement and verification requirements, as described in Section III.13.1.4.3 of Market Rule 1 and the ISO New England Manuals.

Average Hourly Output is either: (i) the sum of the Demand Resource's electrical energy output during Demand Resource On-Peak Hours in the month divided by the number of Demand Resource On-Peak Hours in the month; (ii) the sum of the Demand Resource's electrical energy output during Demand Resource Seasonal Peak Hours in the month divided by the number of Demand Resource Seasonal Peak Hours in the month; or (iii) in each Real-Time Demand Response Event Hour or Real-Time Emergency Generation Event Hour, the sum of the electrical energy output of all of the Real-Time Demand Response Assets or Real-Time Emergency Generation Assets associated with the Real-Time Demand Response Resource or Real-Time Emergency Generation Resource as registered with the ISO as of the first day of the month. Electrical energy output and Average Hourly Output shall be determined consistent with the Demand Resource's Measurement and Verification Plan, which shall be reviewed by the ISO to ensure

consistency with the measurement and verification requirements, as described in Section III.13.1.4.3 of Market Rule 1 and the ISO New England Manuals.

Average Monthly PER is calculated in accordance with Section III.13.7.2.7.1.1.2(a) of Market Rule 1.

Bankruptcy Code is the United States Bankruptcy Code.

Bankruptcy Event occurs when a Covered Entity files a voluntary or involuntary petition in bankruptcy or commences a proceeding under the United States Bankruptcy Code or any other applicable law concerning insolvency, reorganization or bankruptcy by or against such Covered Entity as debtor.

Bilateral Contract (BC) is any of the following types of contracts: Internal Bilateral for Load, Internal Bilateral for Market for Energy, and External Transactions.

Bilateral Contract Block-Hours are Block-Hours assigned to the seller and purchaser of an Internal Bilateral for Load, Internal Bilateral for Market for Energy and External Transactions; provided, however, that only those contracts which apply to the Real-Time Energy Market will accrue Block-Hours.

Blackstart Capability Test is the test, required by ISO New England Operating Documents, of a resource's capability to provide Blackstart Service.

Blackstart Capital Payment is the annual compensation, as calculated pursuant to Section 5.1, or as referred to in Section 5.2, of Schedule 16 to the OATT, for a Designated Blackstart Resource's Blackstart Equipment capital costs associated with the provision of Blackstart Service (excluding the capital costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Blackstart CIP Capital Payment is the annual compensation level, as calculated pursuant to Section 5.1 utilizing data from Table 6 of Appendix A to this Schedule 16, or as referred to in Section 5.2, of Schedule 16 to the OATT, for a Blackstart Station's costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service.

Blackstart CIP O&M Payment is the annual compensation level, as calculated pursuant to Section 5.1 of Schedule 16 to the OATT, utilizing data from Table 6 of Appendix A to this Schedule 16, for a

Blackstart Station's operating and maintenance costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of the provision of Blackstart Service.

Blackstart Equipment is any equipment that is solely necessary to enable the Designated Blackstart Resource to provide Blackstart Service and is not required to provide other products or services under the Tariff.

Blackstart O&M Payment is the annual compensation, as calculated pursuant to Section 5.1 of Schedule 16 to the OATT, for a Designated Blackstart Resource's operating and maintenance costs associated with the provision of Blackstart Service (except for operating and maintenance costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Blackstart Owner is the Market Participant who is authorized on behalf of the Generator Owner(s) to offer or operate the resource as a Designated Blackstart Resource and is authorized to commit the resource to provide Blackstart Service.

Blackstart Service is the Ancillary Service described in Section II.47 of the Tariff and Schedule 16 of the OATT, which also encompasses "System Restoration and Planning Service" under the predecessor version of Schedule 16.

Blackstart Service Commitment is the commitment by a Blackstart Owner for its resource to provide Blackstart Service and the acceptance of that commitment by the ISO, in the manner detailed in ISO New England Operating Procedure No. 11 – Designated Blackstart Resource Administration (OP 11), and which includes a commitment to provide Blackstart Service under a "Signature Page for Schedule 16 of the NEPOOL OATT" that was executed and in effect prior to January 1, 2013 for Category A Designated Blackstart Resources or a commitment to provide Blackstart Service established under Operating Procedure 11 – Designated Blackstart Resource Administration (OP11) for Category B Designated Blackstart Resources.

Blackstart Service Minimum Criteria are the minimum criteria that a Blackstart Owner and its resource must meet in order to establish and maintain a resource as a Designated Blackstart Resource.

Blackstart Standard Rate Payment is the formulaic rate of monthly compensation, as calculated pursuant to Section 5 of Schedule 16 to the OATT, paid to a Blackstart Owner for the provision of Blackstart Service from a Designated Blackstart Resource.

Blackstart Station is comprised of (i) a single Designated Blackstart Resource or (ii) two or more Designated Blackstart Resources that share Blackstart Equipment.

Blackstart Station-specific Rate Payment is the Commission-approved compensation, as calculated pursuant to Section 5.2 of Schedule 16 to the OATT, paid to a Blackstart Owner on a monthly basis for the provision of Blackstart Service by Designated Blackstart Resources located at a specific Blackstart Station.

Blackstart Station-specific Rate Capital Payment is a component of the Blackstart Station-specific Rate Payment that reflects a Blackstart Station's capital Blackstart Equipment costs associated with the provision of Blackstart Service (excluding the capital costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Blackstart Station-specific Rate CIP Capital Payment is a component of the Blackstart Station-specific Rate Payment that reflects a Blackstart Station's capital costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service.

Block is defined as follows: (1) With respect to Bilateral Contracts, a Bilateral Contract administered by the ISO for an hour; (2) with respect to Supply Offers administered by the ISO, a quantity with a related price for Energy (Supply Offers for Energy may contain multiple sets of quantity and price pairs for the day); (3) with respect to Demand Bids administered by the ISO, a quantity with a related price for Energy (Demand Bids for Energy may contain multiple sets of quantity and price pairs for each hour); (4) with respect to Increment Offers administered by the ISO, a quantity with a related price for Energy (Increment Offers for Energy may contain multiple sets of quantity and price pairs for each hour); (5) with respect to Decrement Bids administered by the ISO, a quantity with a related price for Energy (Decrement Bids for Energy may contain multiple sets of quantity and price pairs for each hour); (6) with respect to Asset Related Demand bids administered by the ISO, a quantity with a related price for Energy (Asset Related Demand bids may contain multiple sets of quantity and price pairs for each hour); and (7) with respect to Demand Reduction Offers administered by the ISO, a quantity of reduced demand with a

related price (for Capacity Commitment Periods commencing on or after June 1, 2017, Demand Reduction Offers may contain multiple sets of quantity and price pairs for the day).

Block-Hours are the number of Blocks administered for a particular hour.

Budget and Finance Subcommittee is a subcommittee of the Participants Committee, the responsibilities of which are specified in Section 8.4 of the Participants Agreement.

Business Day is any day other than a Saturday or Sunday or ISO holidays as posted by the ISO on its website.

Cancellation Fee is defined in Section III.1.10.2(d).

Cancelled Start Credit is a credit calculated pursuant to Section III.F.2.5 of Appendix F to Market Rule 1 as the NCPC Credit due to each Market Participant for pool-scheduled generating Resources that were scheduled by the ISO to start after the close of the Day-Ahead Energy Market and that were cancelled by the ISO prior to their assigned commitment time.

Capability Demonstration Year is the one year period from September 1 through August 31.

Capability Year means a year's period beginning on June 1 and ending May 31.

Capacity Acquiring Resource is a resource that is seeking to acquire a Capacity Supply Obligation through a Capacity Supply Obligation Bilateral, as described in Section III.13.5.1 of Market Rule 1.

Capacity Balancing Ratio is a ratio used in calculating the Capacity Performance Payment in the Forward Capacity Market beginning on June 1, 2018 pursuant to rules filed with the Commission on January 17, 2014.

Capacity Capability Interconnection Standard has the meaning specified in Schedule 22 and Schedule 23 of the OATT.

Capacity Carried Forward Due to Rationing is described in Section III.13.2.7.8.2.1(c)(b)(ii) of Market Rule 1.

Capacity Clearing Price is the clearing price for a Capacity Zone for a Capacity Commitment Period resulting from the Forward Capacity Auction conducted for that Capacity Commitment Period, as determined in accordance with Section III.13.2.7 of Market Rule 1.

Capacity Clearing Price Floor is described in Section III.13.2.7.

Capacity Commitment Period is the one-year period from June 1 through May 31 for which obligations are assumed and payments are made in the Forward Capacity Market.

Capacity Cost (CC) is one of four forms of compensation that may be paid to resources providing VAR Service under Schedule 2 of the OATT.

Capacity Export Through Import Constrained Zone Transaction is defined in Section III.1.10.7(f)(i) of Market Rule 1.

Capacity Load Obligation is the quantity of capacity for which a Market Participant is financially responsible, equal to that Market Participant's Capacity Requirement (if any) adjusted to account for any relevant Capacity Load Obligation Bilaterals, as described in Section III.13.7.3.1 of Market Rule 1.

Capacity Load Obligation Acquiring Participant is a load serving entity or any other Market Participant seeking to acquire a Capacity Load Obligation through a Capacity Load Obligation Bilateral, as described in Section III.13.5.2 of Market Rule 1.

Capacity Load Obligation Bilateral is a bilateral contract through which a Market Participant may transfer all or a portion of its Capacity Load Obligation to another entity, as described in Section III.13.5 of Market Rule 1.

Capacity Load Obligation Transferring Participant is an entity that has a Capacity Load Obligation and is seeking to shed such obligation through a Capacity Load Obligation Bilateral, as described in Section III.13.5.2 of Market Rule 1.

Capacity Network Resource (CNR) is defined in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Capacity Network Resource Interconnection Service is defined in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Capacity Performance Payment is the performance-dependent portion of revenue received in the Forward Capacity Market beginning on June 1, 2018 pursuant to rules filed with the Commission on January 17, 2014.

Capacity Rationing Rule addresses whether offers and bids in a Forward Capacity Auction may be rationed, as described in Section III.13.2.6 of Market Rule 1.

Capacity Requirement is described in Section III.13.7.3.1 of Market Rule 1.

Capacity Supply Obligation is an obligation to provide capacity from a resource, or a portion thereof, to satisfy a portion of the Installed Capacity Requirement that is acquired through a Forward Capacity Auction in accordance with Section III.13.2, a reconfiguration auction in accordance with Section III.13.4, or a Capacity Supply Obligation Bilateral in accordance with Section III.13.5.1 of Market Rule 1.

Capacity Supply Obligation Bilateral is a bilateral contract through which a Market Participant may transfer all or a part of its Capacity Supply Obligation to another entity, as described in Section III.13.5.1 of Market Rule 1.

Capacity-to-Service Ratio is defined in Section III.3.2.2(h) of Market Rule 1.

Capacity Transfer Right (CTR) is a financial right that entitles the holder to the difference in the Net Regional Clearing Prices between Capacity Zones for which the transfer right is defined, in the MW amount of the holder's entitlement.

Capacity Transferring Resource is a resource that has a Capacity Supply Obligation and is seeking to shed such obligation, or a portion thereof, through a Capacity Supply Obligation Bilateral, as described in Section III.13.5.1 of Market Rule 1.

Capacity Value is the value (in kW-month) of a Demand Resource for a month determined pursuant to Section III.13.7.1.5 of Market Rule 1.

Capacity Zone is a geographic sub-region of the New England Control Area as determined in accordance with Section III.12.4 of Market Rule 1.

Capital Funding Charge (CFC) is defined in Section IV.B.2 of the Tariff.

CARL Data is Control Area reliability data submitted to the ISO to permit an assessment of the ability of an external Control Area to provide energy to the New England Control Area in support of capacity offered to the New England Control Area by that external Control Area.

Carried Forward Excess Capacity is calculated as described in Section III.13.2.7.8.2.1(c) of Market Rule 1.

Category A Designated Blackstart Resource is a Designated Blackstart Resource that has committed to provide Blackstart Service under a “Signature Page for Schedule 16 of the NEPOOL OATT” that was executed and in effect prior to January 1, 2013 and has not been converted to a Category B Designated Blackstart Resource.

Category B Designated Blackstart Resource is a Designated Blackstart Resource that is not a Category A Designated Blackstart Resource.

Charge is a sum of money due from a Covered Entity to the ISO, either in its individual capacity or as billing and collection agent for NEPOOL pursuant to the Participants Agreement.

CLAIM10 is the value, expressed in megawatts, calculated pursuant to Section III.9.5.3 of the Tariff.

CLAIM30 is the value, expressed in megawatts, calculated pursuant to Section III.9.5.3 of the Tariff.

Claimed Capability Audit is performed to determine the real power output capability of a Generator Asset.

CNR Capability is defined in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Coincident Peak Contribution is a Market Participant's share of the New England Control Area coincident peak demand for the prior calendar year as determined prior to the start of each power year, which reflects the sum of the prior year's annual coincident peak contributions of the customers served by the Market Participant at each Load Asset in all Load Zones. Daily Coincident Peak Contribution values shall be submitted by the Assigned Meter Reader or Host Participant by the meter reading deadline to the ISO.

Cold Weather Conditions means any calendar day when that day's Effective Temperatures are forecast to be equal to or less than zero degrees Fahrenheit for any single on-peak hour and that day's total Effective Heating Degree Days are forecast to be greater than or equal to 65.

Cold Weather Event means days when Cold Weather Conditions are forecast to exist and the Seven-Day Forecast indicates a capacity margin less than or equal to 0 MW for an Operating Day. Cold Weather Events are declared by 1100 two days prior to the Operating Day. A Cold Weather Warning will be used for all future days within the Seven-Day Forecast when a capacity margin of less than or equal to 0 MW exists, until such time that the ISO declares a Cold Weather Event.

Cold Weather Warning means days when Cold Weather Conditions are forecast to exist and the Seven-Day Forecast indicates a capacity margin less than 1,000 MW. In addition, a Cold Weather Warning will be used for all future days within the Seven-Day Forecast when a capacity margin of less than or equal to 0 MW exists for days not yet declared as a Cold Weather Event.

Cold Weather Watch means days when Cold Weather Conditions are forecast to exist and the Seven-Day Forecast indicates a capacity margin greater than or equal to 1,000 MW.

Commercial Capacity, for the purposes of the ISO New England Financial Assurance Policy, is defined in Section VII.A of that policy.

Commission is the Federal Energy Regulatory Commission.

Common Costs are those costs associated with a Station that are avoided only by (1) the clearing of the Static De-List Bids or the Permanent De-List Bids of all the Existing Generating Capacity Resources comprising the Station; or (2) the acceptance of a Non-Price Retirement Request of the Station.

Completed Application is an Application that satisfies all of the information and other requirements of the OATT, including any required deposit.

Compliance Effective Date is the date upon which the changes in the predecessor NEPOOL Open Access Transmission Tariff which have been reflected herein to comply with the Commission's Order of April 20, 1998 became effective.

Composite FCM Transaction is a transaction for separate resources seeking to participate as a single composite resource in a Forward Capacity Auction in which multiple Designated FCM Participants provide capacity, as described in Section III.13.1.5 of Market Rule 1.

Conditional Qualified New Generating Capacity Resource is defined in Section III.13.1.1.2.3(f) of Market Rule 1.

Confidential Information is defined in Section 2.1 of the ISO New England Information Policy, which is Attachment D to the Tariff.

Confidentiality Agreement is Attachment 1 to the ISO New England Billing Policy.

Congestion is a condition of the New England Transmission System in which transmission limitations prevent unconstrained regional economic dispatch of the power system. Congestion is the condition that results in the Congestion Component of the Locational Marginal Price at one Location being different from the Congestion Component of the Locational Marginal Price at another Location during any given hour of the dispatch day in the Day-Ahead Energy Market or Real-Time Energy Market.

Congestion Component is the component of the nodal price that reflects the marginal cost of congestion at a given Node or External Node relative to the reference point. When used in connection with Zonal Price and Hub Price, the term Congestion Component refers to the Congestion Components of the nodal prices that comprise the Zonal Price and Hub Price weighted and averaged in the same way that nodal prices are weighted to determine Zonal Price and averaged to determine the Hub Price.

Congestion Cost is the cost of congestion as measured by the difference between the Congestion Components of the Locational Marginal Prices at different Locations and/or Reliability Regions on the New England Transmission System.

Congestion Paying LSE is, for the purpose of the allocation of FTR Auction Revenues to ARR Holders as provided for in Appendix C of Market Rule 1, a Market Participant or Non-Market Participant Transmission Customer that is responsible for paying for Congestion Costs as a Transmission Customer paying for Regional Network Service under the Transmission, Markets and Services Tariff, unless such Transmission Customer has transferred its obligation to supply load in accordance with ISO New England System Rules, in which case the Congestion Paying LSE shall be the Market Participant supplying the transferred load obligation. The term Congestion Paying LSE shall be deemed to include, but not be limited to, the seller of internal bilateral transactions that transfer Real-Time Load Obligations under the ISO New England System Rules.

Congestion Revenue Fund is the amount available for payment of target allocations to FTR Holders from the collection of Congestion Cost.

Congestion Shortfall means congestion payments exceed congestion charges during the billing process in any billing period.

Control Agreement is the document posted on the ISO website that is required if a Market Participant's cash collateral is to be invested in BlackRock funds.

Control Area is an electric power system or combination of electric power systems to which a common automatic generation control scheme is applied in order to:

- (1) match, at all times, the power output of the generators within the electric power system(s) and capacity and energy purchased from entities outside the electric power system(s), with the load within the electric power system(s);
- (2) maintain scheduled interchange with other Control Areas, within the limits of Good Utility Practice;
- (3) maintain the frequency of the electric power system(s) within reasonable limits in accordance with Good Utility Practice and the criteria of the applicable regional reliability council or the North American Electric Reliability Corporation; and
- (4) provide sufficient generating capacity to maintain operating reserves in accordance with Good Utility Practice.

Correction Limit means the date that is one hundred and one (101) calendar days from the last Operating Day of the month to which the data applied. As described in Section III.3.6.1 of Market Rule 1, this will be the period during which meter data corrections must be submitted unless they qualify for submission as a Requested Billing Adjustment under Section III.3.7 of Market Rule 1.

Cost of Energy Consumed (CEC) is one of four forms of compensation that may be paid to resources providing VAR Service under Schedule 2 of the OATT.

Cost of Energy Produced (CEP) is one of four forms of compensation that may be paid to resources providing VAR Service under Schedule 2 of the OATT.

Cost of New Entry (CONE) is the estimated cost of new entry (\$/kW-month) for a capacity resource that is determined by the ISO for each Forward Capacity Auction pursuant to Section III.13.2.4.

Counterparty means the status in which the ISO acts as the contracting party, in its name and own right and not as an agent, to an agreement or transaction with a Customer (including assignments involving Customers) involving sale to the ISO, and/or purchase from the ISO, of Regional Transmission Service and market and other products and services, and other transactions and assignments involving Customers, all as described in the Tariff.

Covered Entity is defined in the ISO New England Billing Policy.

Credit Coverage is third-party credit protection obtained by the ISO, in the form of credit insurance coverage, a performance or surety bond, or a combination thereof.

Credit Qualifying means a Rated Market Participant that has an Investment Grade Rating and an Unrated Market Participant that satisfies the Credit Threshold.

Credit Threshold consists of the conditions for Unrated Market Participants outlined in Section II.B.2 of the ISO New England Financial Assurance Policy.

Critical Energy Infrastructure Information (CEII) is defined in Section 3.0(j) of the ISO New England Information Policy, which is Attachment D to the Tariff.

Current Ratio is, on any date, all of a Market Participant's or Non-Market Participant Transmission Customer's current assets divided by all of its current liabilities, in each case as shown on the most recent financial statements provided by such Market Participant or Non-Market Participant Transmission Customer to the ISO.

Curtailed is a reduction in the dispatch of a transaction that was scheduled, using transmission service, in response to a transfer capability shortage as a result of system reliability conditions.

Customer is a Market Participant, a Transmission Customer or another customer of the ISO.

Data Reconciliation Process means the process by which meter reconciliation and data corrections that are discovered by Governance Participants after the Invoice has been issued for a particular month or that are discovered prior to the issuance of the Invoice for the relevant month but not included in that Invoice or in the other Invoices for that month and are reconciled by the ISO on an hourly basis based on data submitted to the ISO by the Host Participant Assigned Meter Reader or Assigned Meter Reader.

Day-Ahead is the calendar day immediately preceding the Operating Day.

Day-Ahead Adjusted Load Obligation is defined in Section III.3.2.1(a)(iii) of Market Rule 1.

Day-Ahead Congestion Revenue is defined in Section III.3.2.1(f) of Market Rule 1.

Day-Ahead Demand Reduction Obligation is a cleared Demand Reduction Offer multiplied by one plus the percent average avoided peak distribution losses. For Capacity Commitment Periods commencing on or after June 1, 2017, Day-Ahead Demand Reduction Obligation is the hourly demand reduction amounts of a Demand Response Resource scheduled by the ISO as a result of the Day-Ahead Energy Market, multiplied by one plus the percent average avoided peak distribution losses.

Day-Ahead Energy Market means the schedule of commitments for the purchase or sale of energy, payment of Congestion Costs, payment for losses developed by the ISO as a result of the offers and specifications submitted in accordance with Section III.1.10 of Market Rule 1 and purchase of demand reductions pursuant to Appendix III.E2 of Market Rule 1 for Capacity Commitment Periods commencing on or after June 1, 2017.

Day-Ahead Energy Market Congestion Charge/Credit is defined in Section III.3.2.1(d) of Market Rule 1.

Day-Ahead Energy Market Energy Charge/Credit is defined in Section III.3.2.1(d) of Market Rule 1.

Day-Ahead Energy Market Loss Charge/Credit is defined in Section III.3.2.1(d) of Market Rule 1.

Day-Ahead Generation Obligation is defined in Section III.3.2.1(a)(ii) of Market Rule 1.

Day-Ahead Load Obligation is defined in Section III.3.2.1(a)(i) of Market Rule 1.

Day-Ahead Load Response Program provides a Day-Ahead aspect to the Load Response Program. The Day-Ahead Load Response Program allows Market Participants with registered Load Response Program Assets to make energy reduction offers into the Day-Ahead Load Response Program concurrent with the Day-Ahead Energy Market.

Day-Ahead Locational Adjusted Net Interchange is defined in Section III.3.2.1(a)(iv) of Market Rule 1.

Day-Ahead Loss Charges or Credits is defined in Section III.3.2.1(h) of Market Rule 1.

Day-Ahead Loss Revenue is defined in Section III.3.2.1(g) of Market Rule 1.

Day-Ahead Prices means the Locational Marginal Prices resulting from the Day-Ahead Energy Market.

Debt-to-Total Capitalization Ratio is, on any date, a Market Participant's or Non-Market Participant Transmission Customer's total debt (including all current borrowings) divided by its total shareholders' equity plus total debt, in each case as shown on the most recent financial statements provided by such Market Participant or Non-Market Participant Transmission Customer to the ISO.

Decrement Bid means a bid to purchase energy at a specified Location in the Day-Ahead Energy Market which is not associated with a physical load. An accepted Decrement Bid results in scheduled load at the specified Location in the Day-Ahead Energy Market.

Default Amount is all or any part of any amount due to be paid by any Covered Entity that the ISO, in its reasonable opinion, believes will not or has not been paid when due (other than in the case of a payment dispute for any amount due for transmission service under the OATT).

Default Period is defined in Section 3.3.h(i) of the ISO New England Billing Policy.

Delivering Party is the entity supplying capacity and/or energy to be transmitted at Point(s) of Receipt under the OATT.

Demand Bid means a request to purchase an amount of energy, at a specified Location, or an amount of energy at a specified price, that is associated with a physical load. A cleared Demand Bid in the Day-Ahead Energy Market results in scheduled load at the specified Location. Demand Bids submitted for use in the Real-Time Energy Market are specific to Dispatchable Asset Related Demands only.

Demand Bid Block-Hours are the Block-Hours assigned to the submitting Customer for each Demand Bid.

Demand Designated Entity is the entity designated by a Market Participant to receive Dispatch Instructions for Demand Response Resources, Real-Time Demand Response Resources and Real-Time Emergency Generation Resources in accordance with the provisions set forth in ISO New England Operating Procedure No. 14.

Demand Reduction Offer is an offer by a Market Participant with a Real-Time Demand Response Asset to reduce demand. For Capacity Commitment Periods commencing on or after June 1, 2017, Demand Reduction Offer is an offer by a Market Participant with a Demand Response Resource to reduce demand.

Demand Reduction Threshold Price is a minimum offer price calculated pursuant to Section III.E1.6 and Section III.E2.6.

Demand Reduction Value is the quantity of reduced demand calculated pursuant to Section III.13.7.1.5.3 of Market Rule 1.

Demand Resource is a resource defined as Demand Response Capacity Resources, On-Peak Demand Resources, Seasonal Peak Demand Resources, Real-Time Demand Response Resources, or Real-Time

Emergency Generation Resources. Demand Resources are installed measures (i.e., products, equipment, systems, services, practices and/or strategies) that result in additional and verifiable reductions in end-use demand on the electricity network in the New England Control Area pursuant to Appendix III.E1 and Appendix III.E2 of Market Rule 1, or during Demand Resource On-Peak Hours, Demand Resource Seasonal Peak Hours, Real-Time Demand Response Event Hours, or Real-Time Emergency Generation Event Hours, respectively. A Demand Resource may include a portfolio of measures aggregated together to meet or exceed the minimum Resource size requirements of the Forward Capacity Auction.

Demand Resource Commercial Operation Audit is an audit initiated pursuant to Section III.13.6.1.5.4.4.

Demand Resource Forecast Peak Hours are those hours, or portions thereof, in which, absent the dispatch of Real-Time Demand Response Resources, Dispatch Zone, Load Zone, or system-wide implementation of the action of ISO New England Operating Procedure No. 4 where the ISO would have begun to allow the depletion of Thirty-Minute Operating Reserve is forecasted in the ISO's most recent next-day forecast.

Demand Resource On-Peak Hours are hours ending 1400 through 1700, Monday through Friday on non-Demand Response Holidays during the months of June, July, and August and hours ending 1800 through 1900, Monday through Friday on non-Demand Response Holidays during the months of December and January.

Demand Resource Operable Capacity Analysis means an analysis performed by the ISO estimating the expected dispatch hours of active Demand Resources given different assumed levels of Demand Resources clearing in the primary Forward Capacity Auction.

Demand Resource Performance Incentives means the additional monthly capacity payment that a Demand Resource may earn for producing a positive Monthly Capacity Variance in a period where other Demand Resources yield a negative monthly capacity variance.

Demand Resource Performance Penalties means the reduction in the monthly capacity payment to a Demand Resource for producing a negative Monthly Capacity Variance.

Demand Resource Seasonal Peak Hours are those hours in which the actual, real-time hourly load, as measured using real-time telemetry (adjusted for transmission and distribution losses, and excluding load associated with Exports and the pumping load associated with pumped storage generators) for Monday through Friday on non-Demand Response Holidays, during the months of June, July, August, December, and January, as determined by the ISO, is equal to or greater than 90% of the most recent 50/50 system peak load forecast, as determined by the ISO, for the applicable summer or winter season.

Demand Response Asset is the electricity consumption of an individual end-use customer at a Retail Delivery Point or the aggregated electricity consumption of multiple end use customers from multiple delivery points that meets the registration requirements in Section III.E2.2.

Demand Response Available is the capability of the Demand Response Resource, in whole or in part, at any given time, to reduce demand in response to a Dispatch Instruction.

Demand Response Baseline is the expected baseline demand of an individual end-use metered customer or group of end-use metered customers or the expected output levels of the generation of an individual end-use metered customer whose asset is comprised of Distributed Generation as determined pursuant to Section III.8A or Section III.8B.

Demand Response Capacity Resource is one or more Demand Response Resources located within the same Dispatch Zone, that is registered with the ISO, assigned a unique resource identification number by the ISO, and participates in the Forward Capacity Market to fulfill a Market Participant's Capacity Supply Obligation pursuant to Section III.13 of Market Rule 1.

Demand Response Holiday is New Year's Day, Memorial Day, Independence Day, Labor Day, Veterans Day, Thanksgiving Day, and Christmas Day. If the holiday falls on a Saturday, the holiday will be observed on the preceding Friday; if the holiday falls on a Sunday, the holiday will be observed on the following Monday.

Demand Response Resource is an individual Demand Response Asset or aggregation of Demand Response Assets within a Dispatch Zone that meets the registration requirements and participates in the Energy Market pursuant to Appendix III.E2 of Market Rule 1 for Capacity Commitment Periods commencing on or after June 1, 2017.

Demand Response Resource Notification Time is the minimum time, from the receipt of a Dispatch Instruction, that it takes a Demand Response Resource that was not previously reducing demand to start reducing demand.

Demand Response Resource Ramp Rate is the average rate, expressed in MW per minute, at which the Demand Response Resource can reduce demand.

Demand Response Resource Start-Up Time is the time required from the time a Demand Response Resource that was not previously reducing demand starts reducing demand in response to a Dispatch Instruction and the time the resource achieves its Minimum Reduction.

Designated Agent is any entity that performs actions or functions required under the OATT on behalf of the ISO, a Transmission Owner, a Schedule 20A Service Provider, an Eligible Customer, or a Transmission Customer.

Designated Blackstart Resource is a resource that meets the eligibility requirements specified in Schedule 16 of the OATT, and may be a Category A Designated Blackstart Resource or a Category B Designated Blackstart Resource.

Designated Entity is the entity designated by a Market Participant to receive Dispatch Instructions for generation and/or Dispatchable Asset Related Demand in accordance with the provisions set forth in ISO New England Operating Procedure No. 14.

Designated FCM Participant is any Lead Market Participant, including any Provisional Member that is a Lead Market Participant, transacting in any Forward Capacity Auction, reconfiguration auctions or Capacity Supply Obligation Bilateral for capacity that is otherwise required to provide additional financial assurance under the ISO New England Financial Assurance Policy.

Designated FTR Participant is a Market Participant, including FTR-Only Customers, transacting in the FTR Auction that is otherwise required to provide additional financial assurance under the ISO New England Financial Assurance Policy.

Desired Dispatch Point (DDP) is the Dispatch Rate expressed in megawatts.

Direct Assignment Facilities are facilities or portions of facilities that are constructed for the sole use/benefit of a particular Transmission Customer requesting service under the OATT or a Generator Owner requesting an interconnection. Direct Assignment Facilities shall be specified in a separate agreement among the ISO, Interconnection Customer and Transmission Customer, as applicable, and the Transmission Owner whose transmission system is to be modified to include and/or interconnect with the Direct Assignment Facilities, shall be subject to applicable Commission requirements, and shall be paid for by the Customer in accordance with the applicable agreement and the Tariff.

Directly Metered Assets are specifically measured by OP-18 compliant metering as currently described in Section IV (Metering and Recording for Settlements) of OP-18. Directly Metered Assets include all Tie-Line Assets, all Generator Assets, as well as some Load Assets. Load Assets for which the Host Participant is not the Assigned Meter Reader are considered Directly Metered Assets. In addition, the Host Participant Assigned Meter Reader determines which additional Load Assets are considered Directly Metered Assets and which ones are considered Profiled Load Assets based upon the Host Participant Assigned Meter Reader reporting systems and process by which the Host Participant Assigned Meter Reader allocates non-PTF losses.

Disbursement Agreement is the Rate Design and Funds Disbursement Agreement among the PTOs, as amended and restated from time to time.

Dispatch Instruction means directions given by the ISO to Market Participants, which may include instructions to start up, shut down, raise or lower generation, curtail or restore loads from Demand Resources, change External Transactions, or change the status of a Dispatchable Asset Related Demand in accordance with the Resource's or contract's Supply Offer or Demand Bid parameters. Such instructions may also require a change to the operation of a Pool Transmission Facility. Such instructions are given through either electronic or verbal means.

Dispatch Rate means the control signal, expressed in dollars per MWh and/or megawatts, calculated and transmitted to direct the output level of each generating Resource and each Dispatchable Asset Related Demand and each Demand Response Resource dispatched by the ISO in accordance with the Offer Data.

Dispatch Zone means a subset of Nodes located within a Load Zone established by the ISO for each Capacity Commitment Period pursuant to Section III.13.1.4.6.1.

Dispatchable Asset Related Demand is any portion of an Asset Related Demand of a Market Participant that is capable of having its energy consumption modified in Real-Time in response to Dispatch Instructions has Electronic Dispatch Capability, and must be able to increase or decrease energy consumption between its Minimum Consumption Limit and Maximum Consumption Limit in accordance with Dispatch Instructions and must meet the technical requirements specified in the ISO New England Manuals. Pumped storage facilities may qualify as Dispatchable Asset Related Demand resources, however, such resources shall not qualify as a capacity resource for both the generating output and dispatchable pumping demand of the facility.

Dispute Representatives are defined in 6.5.c of the ISO New England Billing Policy.

Disputed Amount is a Covered Entity's disputed amount due on any fully paid monthly Invoice and/or any amount believed to be due or owed on a Remittance Advice, as defined in Section 6 of the ISO New England Billing Policy.

Disputing Party, for the purposes of the ISO New England Billing Policy, is any Covered Entity seeking to recover a Disputed Amount.

Distributed Generation means generation resources directly connected to end-use customer load and located behind the end-use customer's meter, which reduce the amount of energy that would otherwise have been produced by other capacity resources on the electricity network in the New England Control Area during Demand Resource On-Peak Hours, Demand Resource Seasonal Peak Hours, Real-Time Demand Response Event Hours, or Real-Time Emergency Generation Event Hours, provided that the aggregate nameplate capacity of the generation resource does not exceed 5 MW, or does not exceed the most recent annual non-coincident peak demand of the end-use metered customer at the location where the generation resource is directly connected, whichever is greater. Generation resources cannot participate in the Forward Capacity Market or the Energy Markets as Demand Resources or Demand Response Resources, unless they meet the definition of Distributed Generation.

Do Not Exceed Dispatch Point is a Dispatch Instruction indicating a maximum output level that a wind resource must not exceed.

DR Auditing Period is the summer DR Auditing Period or winter DR Auditing Period as defined in Section III.13.6.1.5.4.3.1.

Dynamic De-List Bid is a bid that may be submitted by Existing Generating Capacity Resources, Existing Import Capacity Resources, and Existing Demand Resources in the Forward Capacity Auction at or below the Dynamic De-List Bid Threshold, as described in Section III.13.2.3.2(d) of Market Rule 1.

Dynamic De-List Bid Threshold is the price specified in Section III.13.1.2.3.1.A of Market Rule 1 associated with the submission of Dynamic De-List Bids in the Forward Capacity Auction.

EA Amount is defined in Section IV.B.2.2 of the Tariff.

Early Amortization Charge (EAC) is defined in Section IV.B.2 of the Tariff.

Early Amortization Working Capital Charge (EAWCC) is defined in Section IV.B.2 of the Tariff.

Early Payment Shortfall Funding Amount (EPSF Amount) is defined in Section IV.B.2.4 of the Tariff.

Early Payment Shortfall Funding Charge (EPSFC) is defined in Section IV.B.2 of the Tariff.

EAWW Amount is defined in Section IV.B.2.3 of the Tariff.

EBITDA-to-Interest Expense Ratio is, on any date, a Market Participant's or Non-Market Participant Transmission Customer's earnings before interest, taxes, depreciation and amortization in the most recent fiscal quarter divided by that Market Participant's or Non-Market Participant Transmission Customer's expense for interest in that fiscal quarter, in each case as shown on the most recent financial statements provided by such Market Participant or Non-Market Participant Transmission Customer to the ISO.

Economic Maximum Limit or Economic Max is the maximum available output, in MW, of a resource that a Market Participant offers to supply in the Day-Ahead Energy Market or Real-Time Energy Market, as reflected in the resource's Supply Offer. This represents the highest MW output a Market Participant has offered for a resource for economic dispatch. A Market Participant must maintain an up-to-date Economic Maximum Limit for all hours in which a resource has been offered into the Day-Ahead Energy Market or Real-Time Energy Market.

Economic Minimum Limit or Economic Min is the maximum of the following values: (i) the Emergency Minimum Limit; (ii) a level supported by environmental and/or operating permit restrictions; or (iii) a level that addresses any significant economic penalties associated with operating at lower levels that can not be adequately represented by three part bidding (Start-Up Fee, No-Load Fee and incremental energy price). In no event shall the Economic Minimum Limit submitted as part of a generating unit's Offer Data be higher than the generation level at which a generating unit's incremental heat rate is minimized (i.e., transitioning from decreasing as output increases to increasing as output increases) except that a Self-Scheduled Resource may modify its Economic Minimum Limit on an hourly basis, as part of its Supply Offer, in order to indicate the desired level of Self-Scheduled MWs.

Economic Study is defined in Section 4.1(b) of Attachment K to the OATT.

EFT is electronic funds transfer.

Effective Heating Degree Days is equal to $68 - (\text{average of max and min Effective Temperature of the day})$.

Effective Temperature is equal to $\text{dry bulb temperature} - [\text{windspeed} \times (65 - \text{dry bulb temp}) / 100]$.

Elective Transmission Upgrade is a Transmission Upgrade that is participant-funded (i.e., voluntarily funded by an entity or entities that have agreed to pay for all of the costs of such Transmission Upgrade), and is not: (i) a Generator Interconnection Related Upgrade; (ii) a Reliability Transmission Upgrade (including a NEMA Upgrade, as appropriate); (iii) an Market Efficiency Transmission Upgrade (including a NEMA Upgrade, as appropriate); or (iv) initially proposed in an Elective Transmission Upgrade Application filed with the ISO in accordance with Section II.47.5 on a date after the addition or modification already has been otherwise identified in the current Regional System Plan (other than as an Elective Transmission Upgrade) in publication as of the date of that application.

Elective Transmission Upgrade Applicant is defined in Section II.47.5 of the OATT.

Electric Reliability Organization (ERO) is defined in 18 C.F.R. § 39.1.

Electronic Dispatch Capability is the ability to provide for the electronic transmission, receipt, and acknowledgment of data relative to the dispatch of generating units and Dispatchable Asset Related

Demands and the ability to carry out the real-time dispatch processes from ISO issuance of Dispatch Instructions to the actual increase or decrease in output of dispatchable Resources.

Eligible Customer is: (i) Any entity that is engaged, or proposes to engage, in the wholesale or retail electric power business is an Eligible Customer under the OATT. (ii) Any electric utility (including any power marketer), Federal power marketing agency, or any other entity generating electric energy for sale or for resale is an Eligible Customer under the OATT. Electric energy sold or produced by such entity may be electric energy produced in the United States, Canada or Mexico. However, with respect to transmission service that the Commission is prohibited from ordering by Section 212(h) of the Federal Power Act, such entity is eligible only if the service is provided pursuant to a state requirement that the Transmission Owner with which that entity is directly interconnected or the distribution company having the service territory in which that entity is located (if that entity is a retail customer) offer the unbundled transmission service or Local Delivery Service, or pursuant to a voluntary offer of such service by the Transmission Owner with which that entity is directly interconnected or the distribution company having the service territory in which that entity is located (if that entity is a retail customer). (iii) Any end user taking or eligible to take unbundled transmission service or Local Delivery Service pursuant to a state requirement that the Transmission Owner with which that end user is directly interconnected or the distribution company having the service territory in which that entity is located (if that entity is a retail customer) offer the transmission service or Local Delivery Service, or pursuant to a voluntary offer of such service by the Transmission Owner with which that end user is directly interconnected, or the distribution company having the service territory in which that entity is located (if that entity is a retail customer) is an Eligible Customer under the OATT.

Eligible FTR Bidder is an entity that has satisfied applicable financial assurance criteria, and shall not include the auctioneer, its Affiliates, and their officers, directors, employees, consultants and other representatives.

Emergency is an abnormal system condition on the bulk power systems of New England or neighboring Control Areas requiring manual or automatic action to maintain system frequency, or to prevent the involuntary loss of load, equipment damage, or tripping of system elements that could adversely affect the reliability of an electric system or the safety of persons or property; or a fuel shortage requiring departure from normal operating procedures in order to minimize the use of such scarce fuel; or a condition that requires implementation of Emergency procedures as defined in the ISO New England Manuals.

Emergency Condition means an Emergency has been declared by the ISO in accordance with the procedures set forth in the ISO New England Manuals and ISO New England Administrative Procedures.

Emergency Energy is energy transferred from one control area operator to another in an Emergency.

Emergency Minimum Limit or Emergency Min means the minimum generation amount, in MWs, that a generating unit can deliver for a limited period of time without exceeding specified limits of equipment stability and operating permits.

EMS is energy management system.

End-of-Round Price is the lowest price associated with a round of a Forward Capacity Auction, as described in Section III.13.2.3.1 of Market Rule 1.

End User Participant is defined in Section 1 of the Participants Agreement.

Energy is power produced in the form of electricity, measured in kilowatthours or megawatthours.

Energy Administration Service (EAS) is the service provided by the ISO, as described in Schedule 2 of Section IV.A of the Tariff, in order to facilitate: (1) bilateral Energy transactions; (2) self-scheduling of Energy; (3) Interchange Transactions in the Energy Market; and (4) Energy Imbalance Service under Section II of the Tariff.

Energy Component means the Locational Marginal Price at the reference point.

Energy Efficiency is installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that reduce the total amount of electrical energy needed, while delivering a comparable or improved level of end-use service. Such measures include, but are not limited to, the installation of more energy efficient lighting, motors, refrigeration, HVAC equipment and control systems, envelope measures, operations and maintenance procedures, and industrial process equipment.

Energy Imbalance Service is the form of Ancillary Service described in Schedule 4 of the OATT.

Energy Market is, collectively, the Day-Ahead Energy Market and the Real-Time Energy Market.

Energy Non-Zero Spot Market Settlement Hours are hours for which the Customer has a positive or negative Real-Time System Adjusted Net Interchange as determined by the ISO settlement process for the Energy Market.

Energy Transaction Units (Energy TUs) are the sum for the month for a Customer of Bilateral Contract Block-Hours, Demand Bid Block-Hours, Asset Related Demand Bid Block-Hours, Supply Offer Block-Hours and Energy Non-Zero Spot Market Settlement Hours.

Enrolling Participant is the Market Participant that registers Customers for the Load Response Program.

Equipment Damage Reimbursement is the compensation paid to the owner of a Designated Blackstart Resource as specified in Section 5.5 of Schedule 16 to the OATT.

Equivalent Demand Forced Outage Rate (EFORD) means the portion of time a unit is in demand, but is unavailable due to forced outages.

Estimated Capacity Load Obligation is, for the purposes of the ISO New England Financial Assurance Policy, the Capacity Requirement from the latest available month, adjusted as appropriate to account for any relevant Capacity Load Obligation Bilaterals, HQICCs, and Self-Supplied FCA Resource designations for the applicable month.

Establish Claimed Capability Audit is the audit performed pursuant to Section III.1.5.1.2.

Estimated Net Regional Clearing Price (ENRCP) is calculated in accordance with Section VII.C of the ISO New England Financial Assurance Policy.

Excepted Transaction is a transaction specified in Section II.40 of the Tariff for the applicable period specified in that Section.

Exempt Real-Time Generation Obligation means that portion of a Market Participant's Real-Time Generation Obligation that is not included in the calculation of Minimum Generation Emergency Credits pursuant to Appendix F of Market Rule 1.

Existing Capacity Qualification Deadline is a deadline, specified in Section III.13.1.10 of Market Rule 1, for submission of certain qualification materials for the Forward Capacity Auction, as discussed in Section III.13.1 of Market Rule 1.

Existing Capacity Qualification Package is information submitted by certain existing resources prior to participation in the Forward Capacity Auction, as described in Section III.13.1 of Market Rule 1.

Existing Capacity Resource is any resource that does not meet any of the eligibility criteria to participate in the Forward Capacity Auction as a New Capacity Resource, and, subject to ISO evaluation, for the Forward Capacity Auction to be conducted beginning February 1, 2008, any resource that is under construction and within 12 months of its expected commercial operations date.

Existing Demand Resource is a type of Demand Resource participating in the Forward Capacity Market, as defined in Section III.13.1.4.1.1 of Market Rule 1.

Existing Generating Capacity Resource is a type of resource participating in the Forward Capacity Market, as defined in Section III.13.1.2.1 of Market Rule 1.

Existing Import Capacity Resource is a type of resource participating in the Forward Capacity Market, as defined in Section III.13.1.3.1 of Market Rule 1.

Expedited Study Request is defined in Section II.34.7 of the OATT.

Export-Adjusted LSR is as defined in Section III.12.4(b)(ii).

Export Bid is a bid that may be submitted by certain resources in the Forward Capacity Auction to export capacity to an external Control Area, as described in Section III.13.1.2.3.1.3 of Market Rule 1.

Exports are Real-Time External Transactions, which are limited to sales from the New England Control Area, for exporting energy out of the New England Control Area.

External Market Monitor means the person or entity appointed by the ISO Board of Directors pursuant to Section III.A.1.2 of Appendix A of Market Rule 1 to carry out the market monitoring and mitigation functions specified in Appendix A and elsewhere in Market Rule 1.

External Node is a proxy bus or buses used for establishing a Locational Marginal Price for energy received by Market Participants from, or delivered by Market Participants to, a neighboring Control Area or for establishing Locational Marginal Prices associated with energy delivered through the New England Control Area by Non-Market Participants for use in calculating Non-Market Participant Congestion Costs and loss costs.

External Resource means a generation resource located outside the metered boundaries of the New England Control Area.

External Transaction is the import of external energy into the New England Control Area by a Market Participant or the export of internal energy out of the New England Control Area by a Market Participant in the Day-Ahead Energy Market and/or Real-Time Energy Market, or the wheeling of external energy through the New England Control Area by a Market Participant or a Non-Market Participant in the Real-Time Energy Market.

External Transmission Project is a transmission project comprising facilities located wholly outside the New England Control Area and regarding which an agreement has been reached whereby New England ratepayers will support all or a portion of the cost of the facilities.

Facilities Study is an engineering study conducted pursuant to the OATT by the ISO (or, in the case of Local Service or interconnections to Local Area Facilities as defined in the TOA, by one or more affected PTOs) or some other entity designated by the ISO in consultation with any affected Transmission Owner(s), to determine the required modifications to the PTF and Non-PTF, including the cost and scheduled completion date for such modifications, that will be required to provide a requested transmission service or interconnection on the PTF and Non-PTF.

Failure to Maintain Blackstart Capability is a failure of a Blackstart Owner or Designated Blackstart Resource to meet the Blackstart Service Minimum Criteria or Blackstart Service obligations, but does not include a Failure to Perform During a System Restoration event.

Failure to Perform During a System Restoration is a failure of a Blackstart Owner or Designated Blackstart Resource to follow ISO or Local Control Center dispatch instructions or perform in accordance with the dispatch instructions or the Blackstart Service Minimum Criteria and Blackstart Service

obligations, described within the ISO New England Operating Documents, during a restoration of the New England Transmission System.

Fast Start Generator means a generating unit that the ISO may dispatch within the hour through electronic dispatch and that meets the following criteria: (i) minimum run time does not exceed one hour; (ii) minimum down time does not exceed one hour; (iii) time to start does not exceed 30 minutes; (iv) available for dispatch and manned or has automatic remote dispatch capability; (v) capable of receiving and acknowledging a start-up or shut-down dispatch instruction electronically; and (vi) has satisfied its minimum down time.

FCA Cleared Export Transaction is defined in Section III.1.10.7(f)(ii) of Market Rule 1.

FCA Payment is the monthly capacity payment for a resource whose offer has cleared in a Forward Capacity Auction as described in Section III.13.7.2.1.1(a) of Market Rule 1.

FCA Qualified Capacity is the Qualified Capacity that is used in a Forward Capacity Auction.

FCM Capacity Charge Requirements are calculated in accordance with Section VII.C of the ISO New England Financial Assurance Policy.

FCM Deposit is calculated in accordance with Section VII.B.1 of the ISO New England Financial Assurance Policy.

FCM Financial Assurance Requirements are described in Section VII of the ISO New England Financial Assurance Policy.

Final Forward Reserve Obligation is calculated in accordance with Section III.9.8(a) of Market Rule 1.

Financial Assurance Default results from a Market Participant or Non-Market Participant Transmission Customer's failure to comply with the ISO New England Financial Assurance Policy.

Financial Assurance Obligations relative to the ISO New England Financial Assurance Policy are determined in accordance with Section III.A(v) of the ISO New England Financial Assurance Policy.

Financial Transmission Right (FTR) is a financial instrument that evidences the rights and obligations specified in Sections III.5.2.2 and III.7 of the Tariff.

Firm Point-To-Point Service is service which is arranged for and administered between specified Points of Receipt and Delivery in accordance with Part II.C of the OATT.

Firm Transmission Service is Regional Network Service, Through or Out Service, service for Excepted Transactions, firm MTF Service, firm OTF Service, and firm Local Service.

Force Majeure - An event of Force Majeure means any act of God, labor disturbance, act of the public enemy or terrorists, war, invasion, insurrection, riot, fire, storm or flood, ice, explosion, breakage or accident to machinery or equipment, any curtailment, order, regulation or restriction imposed by governmental military or lawfully established civilian authorities, or any other cause beyond the control of the ISO, a Transmission Owner, a Schedule 20A Service Provider, or a Customer, including without limitation, in the case of the ISO, any action or inaction by a Customer, a Schedule 20A Service Provider, or a Transmission Owner, in the case of a Transmission Owner, any action or inaction by the ISO, any Customer, a Schedule 20A Service Provider, or any other Transmission Owner, in the case of a Schedule 20A Service Provider, any action or inaction by the ISO, any Customer, a Transmission Owner, or any other Schedule 20A Service Provider, and, in the case of a Transmission Customer, any action or inaction by the ISO, a Schedule 20A Service Provider, or any Transmission Owner.

Forecast Hourly Demand Reduction means the estimated maximum quantity of energy reduction (MWh), measured at the end-use customer meter that can be produced by a Real-Time Demand Response Resource, or Real-Time Emergency Generation Resource, in each hour of an Operating Day. For a Real-Time Emergency Generation Asset that is metered at the generator and associated with a Real-Time Emergency Generation Resource, the Forecast Hourly Demand Reduction means the estimated maximum generator output (MWh) in each hour of an Operating Day.

Formal Warning is defined in Section III.B.4.1.1 of Appendix B of Market Rule 1.

Formula-Based Sanctions are defined in Section III.B.4.1.3 of Appendix B of Market Rule 1.

Forward Capacity Auction (FCA) is the annual descending clock auction in the Forward Capacity Market, as described in Section III.13.2 of Market Rule 1.

Forward Capacity Auction Starting Price is calculated in accordance with Section III.13.2.4 of Market Rule 1.

Forward Capacity Market (FCM) is the forward market for procuring capacity in the New England Control Area, as described in Section III.13 of Market Rule 1.

Forward Reserve means TMNSR and TMOR purchased by the ISO on a forward basis on behalf of Market Participants as provided for in Section III.9 of Market Rule 1.

Forward Reserve Assigned Megawatts is the amount of Forward Reserve, in megawatts, that a Market Participant assigns to eligible Forward Reserve Resources to meet its Forward Reserve Obligation as defined in Section III.9.4.1 of Market Rule 1.

Forward Reserve Auction is the periodic auction conducted by the ISO in accordance with Section III.9 of Market Rule 1 to procure Forward Reserve.

Forward Reserve Auction Offers are offers to provide Forward Reserve to meet system and Reserve Zone requirements as submitted by a Market Participant in accordance with Section III.9.3 of Market Rule 1.

Forward Reserve Charge is a Market Participant's share of applicable system and Reserve Zone Forward Reserve costs attributable to meeting the Forward Reserve requirement as calculated in accordance with Section III.9.9 of Market Rule 1.

Forward Reserve Clearing Price is the clearing price for TMNSR or TMOR, as applicable, for the system and each Reserve Zone resulting from the Forward Reserve Auction as defined in Section III.9.4 of Market Rule 1.

Forward Reserve Credit is the credit received by a Market Participant that is associated with that Market Participant's Final Forward Reserve Obligation as calculated in accordance with Section III.9.8 of Market Rule 1.

Forward Reserve Delivered Megawatts are calculated in accordance with Section III.9.6.5 of Market Rule 1.

Forward Reserve Delivery Period is defined in Section III.9.1 of Market Rule 1.

Forward Reserve Failure-to-Activate Megawatts are calculated in accordance with Section III.9.7.2(a) of Market Rule 1.

Forward Reserve Failure-to-Activate Penalty is the penalty associated with a Market Participant's failure to activate Forward Reserve when requested to do so by the ISO and is defined in Section III.9.7.2 of Market Rule 1.

Forward Reserve Failure-to-Activate Penalty Rate is specified in Section III.9.7.2 of Market Rule 1.

Forward Reserve Failure-to-Reserve, as specified in Section III.9.7.1 of Market Rule 1, occurs when a Market Participant's Forward Reserve Delivered Megawatts for a Reserve Zone in an hour is less than that Market Participant's Forward Reserve Obligation for that Reserve Zone in that hour. Under these circumstances the Market Participant pays a penalty based upon the Forward Reserve Failure-to-Reserve Penalty Rate and that Market Participant's Forward Reserve Failure-to-Reserve Megawatts.

Forward Reserve Failure-to-Reserve Megawatts are calculated in accordance with Section III.9.7.1(a) of Market Rule 1.

Forward Reserve Failure-to-Reserve Penalty is the penalty associated with a Market Participant's failure to reserve Forward Reserve and is defined in Section III.9.7.1 of Market Rule 1.

Forward Reserve Failure-to-Reserve Penalty Rate is specified in Section III.9.7.1(b)(ii) of Market Rule 1.

Forward Reserve Fuel Index is the index or set of indices used to calculate the Forward Reserve Threshold Price as defined in Section III.9.6.2 of Market Rule 1.

Forward Reserve Heat Rate is the heat rate as defined in Section III.9.6.2 of Market Rule 1 that is used to calculate the Forward Reserve Threshold Price.

Forward Reserve Market is a market for forward procurement of two reserve products, Ten-Minute Non-Spinning Reserve (TMNSR) and Thirty-Minute Operating Reserve (TMOR).

Forward Reserve MWs are those megawatts assigned to specific eligible Forward Reserve Resources which convert a Forward Reserve Obligation into a Resource-specific obligation.

Forward Reserve Obligation is a Market Participant's amount, in megawatts, of Forward Reserve that cleared in the Forward Reserve Auction and adjusted, as applicable, to account for bilateral transactions that transfer Forward Reserve Obligations.

Forward Reserve Obligation Charge is defined in Section III.10.4 of Market Rule 1.

Forward Reserve Offer Cap is \$14,000/megawatt-month.

Forward Reserve Payment Rate is defined in Section III.9.8 of Market Rule 1.

Forward Reserve Procurement Period is defined in Section III.9.1 of Market Rule 1.

Forward Reserve Qualifying Megawatts refer to all or a portion of a Forward Reserve Resource's capability offered into the Real-Time Energy Market at energy offer prices above the applicable Forward Reserve Threshold Price that are calculated in accordance with Section III.9.6.4 of Market Rule 1.

Forward Reserve Resource is a Resource that meets the eligibility requirements defined in Section III.9.5.2 of Market Rule 1 that has been assigned Forward Reserve Obligation by a Market Participant.

Forward Reserve Threshold Price is the minimum price at which assigned Forward Reserve Megawatts are required to be offered into the Real-Time Energy Market as calculated in Section III.9.6.2 of Market Rule 1.

FTR Auction is the periodic auction of FTRs conducted by the ISO in accordance with Section III.7 of Market Rule 1.

FTR Auction Revenue is the revenue collected from the sale of FTRs in FTR Auctions. FTR Auction Revenue is payable to FTR Holders who submit their FTRs for sale in the FTR Auction in accordance with Section III.7 of Market Rule 1 and to ARR Holders and Incremental ARR Holders in accordance with Appendix C of Market Rule 1.

FTR Award Financial Assurance is a required amount of financial assurance that must be maintained at all times from a Designated FTR Participant for each FTR awarded to the participant in any FTR Auctions. This amount is calculated pursuant to Section VI.C of the ISO New England Financial Assurance Policy.

FTR Bid Financial Assurance is an amount of financial assurance required from a Designated FTR Participant for each bid submission into an FTR auction. This amount is calculated pursuant to Section VI.B of the ISO New England Financial Assurance Policy.

FTR Credit Test Percentage is calculated in accordance with Section III.B.1(b) of the ISO New England Financial Assurance Policy.

FTR Financial Assurance Requirements are described in Section VI of the ISO New England Financial Assurance Policy.

FTR Holder is an entity that acquires an FTR through the FTR Auction to Section III.7 of Market Rule 1 and registers with the ISO as the holder of the FTR in accordance with Section III.7 of Market Rule 1 and applicable ISO New England Manuals.

FTR-Only Customer is a Market Participant that transacts in the FTR Auction and that does not participate in other markets or programs of the New England Markets. References in this Tariff to a “Non-Market Participant FTR Customers” and similar phrases shall be deemed references to an FTR-Only Customer.

FTR Settlement Risk Financial Assurance is an amount of financial assurance required by a Designated FTR Participant for each bid submission into an FTR Auction and for each bid awarded to the individual participant in an FTR Auction. This amount is calculated pursuant to Section VI.A of the ISO New England Financial Assurance Policy.

GADS Data means data submitted to the NERC for collection into the NERC's Generating Availability Data System (GADS).

Gap Request for Proposals (Gap RFP) is defined in Section III.11 of Market Rule 1.

Gas Day means a period of 24 consecutive hours beginning at 0900 hrs Central Time.

Generating Capacity Resource means a New Generating Capacity Resource or an Existing Generating Capacity Resource.

Generator Asset is a generator that has been registered in accordance with the Asset Registration Process.

Generator Imbalance Service is the form of Ancillary Service described in Schedule 10 of the OATT.

Generator Interconnection Related Upgrade is an addition to or modification of the New England Transmission System (pursuant to Section II.47.1, Schedule 22 or Schedule 23 of the OATT) to effect the interconnection of a new generating unit or an existing generating unit whose energy capability or capacity capability is being materially changed and increased whether or not the interconnection is being effected to meet the Capacity Capability Interconnection Standard or the Network Capability Interconnection Standard. As to Category A Projects (as defined in Schedule 11 of the OATT), a Generator Interconnection Related Upgrade also includes an upgrade beyond that required to satisfy the Network Capability Interconnection Standard (or its predecessor) for which the Generator Owner has committed to pay prior to October 29, 1998.

Generator Owner is the owner, in whole or part, of a generating unit whether located within or outside the New England Control Area.

Good Utility Practice means any of the practices, methods and acts engaged in or approved by a significant portion of the electric utility industry during the relevant time period, or any of the practices, methods and acts which, in the exercise of reasonable judgment in light of the facts known at the time the decision was made, could have been expected to accomplish the desired result at a reasonable cost consistent with good business practices, reliability, safety and expedition. Good Utility Practice is not intended to be limited to the optimum practice, method, or act to the exclusion of all others, but rather

includes all acceptable practices, methods, or acts generally accepted in the region, including those practices required by Federal Power Act Section 215(a)(4).

Governance Only Member is defined in Section 1 of the Participants Agreement.

Governance Participant is defined in the Participants Agreement.

Governing Documents, for the purposes of the ISO New England Billing Policy, are the Transmission, Markets and Services Tariff and ISO Participants Agreement.

Governing Rating is the lowest corporate rating from any Rating Agency for that Market Participant, or, if the Market Participant has no corporate rating, then the lowest rating from any Rating Agency for that Market Participant's senior unsecured debt.

Grandfathered Agreements (GAs) is a transaction specified in Section II.45 for the applicable period specified in that Section.

Grandfathered Intertie Agreement (GIA) is defined pursuant to the TOA.

Handy-Whitman Index of Public Utility Construction Costs is the Total Other Production Plant index shown in the Cost Trends of Electric Utility Construction for the North Atlantic Region as published in the Handy-Whitman Index of Public Utility Construction Costs.

Highgate Transmission Facilities (HTF) are existing U. S.-based transmission facilities covered under the Agreement for Joint Ownership, Construction and Operation of the Highgate Transmission Interconnection dated as of August 1, 1984 including (1) the whole of a 200 megawatt high-voltage, back-to-back, direct-current converter facility located in Highgate, Vermont and (2) a 345 kilovolt transmission line within Highgate and Franklin, Vermont (which connects the converter facility at the U.S.-Canadian border to a Hydro-Quebec 120 kilovolt line in Bedford, Quebec). The HTF include any upgrades associated with increasing the capacity or changing the physical characteristics of these facilities as defined in the above stated agreement dated August 1, 1984 until the Operations Date, as defined in the TOA. The current HTF rating is a nominal 225 MW. The HTF are not defined as PTF. Coincident with the Operations Date and except as stipulated in Schedules, 9, 12, and Attachment F to the OATT, HTF shall be treated in the same manner as PTF for purposes of the OATT and all references to PTF in the

OATT shall be deemed to apply to HTF as well. The treatment of the HTF is not intended to establish any binding precedent or presumption with regard to the treatment for other transmission facilities within the New England Transmission System (including HVDC, MTF, or Control Area Interties) for purposes of the OATT.

Host Participant or Host Utility is a Market Participant or a Governance Participant transmission or distribution provider that reconciles the loads within the metering domain with OP-18 compliant metering.

Hourly Adjusted Audited Demand Reduction is calculated in accordance with Section III.13.7.1.5.10.1.2.

Hourly Calculated Demand Resource Performance Value means the performance of a Demand Resource during Real-Time Demand Response Event Hours and Real-Time Emergency Generation Event Hours for purposes of calculating a Demand Reduction Value pursuant to Sections III.13.7.1.5.7.3 and III.13.7.1.5.8.3.

Hourly Charges are defined in Section 1.3 of the ISO New England Billing Policy.

Hourly PER is calculated in accordance with Section III.13.7.2.7.1.1.1(a) of Market Rule 1.

Hourly Real-Time Demand Response Resource Deviation means the difference between the Average Hourly Load Reduction or Average Hourly Output of the Real-Time Demand Response Resource and the amount of load reduction or output that the Market Participant was instructed to produce pursuant to a Dispatch Instruction calculated pursuant to Section III.13.7.1.5.7.3.1.

Hourly Real-Time Emergency Generation Resource Deviation is calculated pursuant to Section III.13.7.1.5.8.3.1.

Hourly Requirements are determined in accordance with Section III.A(i) of the ISO New England Financial Assurance Policy.

Hub is a specific set of pre-defined Nodes for which a Locational Marginal Price will be calculated for the Day-Ahead Energy Market and Real-Time Energy Market and which can be used to establish a

reference price for energy purchases and the transfer of Day-Ahead Adjusted Load Obligations and Real-Time Adjusted Load Obligations and for the designation of FTRs.

Hub Price is calculated in accordance with Section III.2.8 of Market Rule 1.

HQ Interconnection Capability Credit (HQICC) is a monthly value reflective of the annual installed capacity benefits of the Phase I/II HVDC-TF, as determined by the ISO, using a standard methodology on file with the Commission, in conjunction with the setting of the Installed Capacity Requirement. An appropriate share of the HQICC shall be assigned to an IRH if the Phase I/II HVDC-TF support costs are paid by that IRH and such costs are not included in the calculation of the Regional Network Service rate. The share of HQICC allocated to such an eligible IRH for a month is the sum in kilowatts of (1)(a) the IRH's percentage share, if any, of the Phase I Transfer Capability times (b) the Phase I Transfer Credit, plus (2)(a) the IRH's percentage share, if any, of the Phase II Transfer Capability, times (b) the Phase II Transfer Credit. The ISO shall establish appropriate HQICCs to apply for an IRH which has such a percentage share.

Import Capacity Resource means an Existing Import Capacity Resource or a New Import Capacity Resource offered to provide capacity in the New England Control Area from an external Control Area.

Inadequate Supply is defined in Section III.13.2.8.1 of Market Rule 1.

Inadvertent Energy Revenue is defined in Section III.3.2.1(k) of Market Rule 1.

Inadvertent Energy Revenue Charges or Credits is defined in Section III.3.2.1(l) of Market Rule 1.

Inadvertent Interchange means the difference between net actual energy flow and net scheduled energy flow into or out of the New England Control Area.

Increment Offer means an offer to sell energy at a specified Location in the Day-Ahead Energy Market which is not associated with a physical supply. An accepted Increment Offer results in scheduled generation at the specified Location in the Day-Ahead Energy Market.

Incremental ARR is an ARR provided in recognition of a participant-funded transmission system upgrade pursuant to Appendix C of this Market Rule.

Incremental ARR Holder is an entity which is the record holder of an Incremental Auction Revenue Right in the register maintained by the ISO.

Incremental Cost of Reliability Service is described in Section III.13.2.5.2.5.2 of Market Rule 1.

Independent Transmission Company (ITC) is a transmission entity that assumes certain responsibilities in accordance with Section 10.05 of the Transmission Operating Agreement and Attachment M to the OATT, subject to the acceptance or approval of the Commission and a finding of the Commission that the transmission entity satisfies applicable independence requirements.

Information Request is a request from a potential Disputing Party submitted in writing to the ISO for access to Confidential Information.

Initial Market Participant Financial Assurance Requirement is calculated for new Market Participants and Returning Market Participants, other than an FTR-Only Customer or a Governance Only Member, according to Section IV of the ISO New England Financial Assurance Policy.

Installed Capacity Requirement means the level of capacity required to meet the reliability requirements defined for the New England Control Area, as described in Section III.12 of Market Rule 1.

Insufficient Competition is defined in Section III.13.2.8.2 of Market Rule 1.

Interchange Transactions are transactions deemed to be effected under Market Rule 1.

Interconnecting Transmission Owner has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Interconnection Agreement is the “Large Generator Interconnection Agreement” or the “Small Generator Interconnection Agreement” pursuant to Schedules 22 and 23 of the ISO OATT or an interconnection agreement approved by the Commission prior to the adoption of the Interconnection Procedures.

Interconnection Customer has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Interconnection Feasibility Study Agreement has the meaning specified in Section I of Schedule 22 or Attachment 1 to Schedule 23 of the OATT.

Interconnection Procedure is the “Large Generator Interconnection Procedures” or the “Small Generator Interconnection Procedures” pursuant to Schedules 22 and 23 of the ISO OATT.

Interconnection Request has the meaning specified in Section I of Schedule 22 or Attachment 1 to Schedule 23 of the OATT.

Interconnection Rights Holder(s) (IRH) has the meaning given to it in Schedule 20A to Section II of this Tariff.

Interconnection System Impact Study Agreement has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Interest is interest calculated in the manner specified in Section II.8.3.

Intermittent Power Resource is defined in Section III.13.1.2.2.2 of Market Rule 1.

Intermittent Settlement Only Resource is a Settlement Only Resource that is also an Intermittent Power Resource.

Internal Bilateral for Load is an internal bilateral transaction under which the buyer receives a reduction in Real-Time Load Obligation and the seller receives a corresponding increase in Real-Time Load Obligation in the amount of the sale, in MWs. An Internal Bilateral for Load transaction is only applicable in the Real-Time Energy Market.

Internal Bilateral for Market for Energy is an internal bilateral transaction for Energy which applies in the Day-Ahead Energy Market and Real-Time Energy Market or just the Real-Time Energy Market under which the buyer receives a reduction in Day-Ahead Adjusted Load Obligation and Real-Time Adjusted

Load Obligation and the seller receives a corresponding increase in Day-Ahead Adjusted Load Obligation and Real-Time Adjusted Load Obligation in the amount of the sale, in MWs.

Internal Market Monitor means the department of the ISO responsible for carrying out the market monitoring and mitigation functions specified in Appendix A and elsewhere in Market Rule 1.

Interregional Planning Stakeholder Advisory Committee (IPSAC) is the committee described as such in the Northeast Planning Protocol.

Interregional Transmission Project is a transmission project located within the New England Control Area and one or more of the neighboring transmission planning regions.

Interruption Cost is the amount, in dollars, that must be paid to a Market Participant each time the Market Participant's Demand Response Resource is scheduled or dispatched in the New England Markets to reduce demand.

Investment Grade Rating, for a Market (other than an FTR-Only Customer) or Non-Market Participant Transmission Customer, is either (a) a corporate investment grade rating from one or more of the Rating Agencies, or (b) if the Market Participant or Non-Market Participant Transmission Customer does not have a corporate rating from one of the Rating Agencies, then an investment grade rating for the Market Participant's or Non-Market Participant Transmission Customer's senior unsecured debt from one or more of the Rating Agencies.

Invoice is a statement issued by the ISO for the net Charge owed by a Covered Entity pursuant to the ISO New England Billing Policy.

Invoice Date is the day on which the ISO issues an Invoice.

ISO means ISO New England Inc.

ISO Charges, for the purposes of the ISO New England Billing Policy, are both Non-Hourly Charges and Hourly Charges.

ISO Control Center is the primary control center established by the ISO for the exercise of its Operating Authority and the performance of functions as an RTO.

ISO-Initiated Claimed Capability Audit is the audit performed pursuant to Section III.1.5.1.4.

ISO New England Administrative Procedures means procedures adopted by the ISO to fulfill its responsibilities to apply and implement ISO New England System Rules.

ISO New England Billing Policy is Exhibit ID to Section I of the Transmission, Markets and Services Tariff.

ISO New England Filed Documents means the Transmission, Markets and Services Tariff, including but not limited to Market Rule 1, the Participants Agreement, the Transmission Operating Agreement or other documents that affect the rates, terms and conditions of service.

ISO New England Financial Assurance Policy is Exhibit IA to Section I of the Transmission, Markets and Services Tariff.

ISO New England Information Policy is the policy establishing guidelines regarding the information received, created and distributed by Market Participants and the ISO in connection with the settlement, operation and planning of the System, as the same may be amended from time to time in accordance with the provisions of this Tariff. The ISO New England Information Policy is Attachment D to the Transmission, Markets and Services Tariff.

ISO New England Manuals are the manuals implementing Market Rule 1, as amended from time to time in accordance with the Participants Agreement. Any elements of the ISO New England Manuals that substantially affect rates, terms, and/or conditions of service shall be filed with the Commission under Section 205 of the Federal Power Act.

ISO New England Operating Documents are the Tariff and the ISO New England Operating Procedures.

ISO New England Operating Procedures are the ISO New England Planning Procedures and the operating guides, manuals, procedures and protocols developed and utilized by the ISO for operating the ISO bulk power system and the New England Markets.

ISO New England Planning Procedures are the procedures developed and utilized by the ISO for planning the ISO bulk power system.

ISO New England System Rules are Market Rule 1, the ISO New England Information Policy, the ISO New England Administrative Procedures, the ISO New England Manuals and any other system rules, procedures or criteria for the operation of the New England Transmission System and administration of the New England Markets and the Transmission, Markets and Services Tariff.

ITC Agreement is defined in Attachment M to the OATT.

ITC Rate Schedule is defined in Section 3.1 of Attachment M to the OATT.

ITC System is defined in Section 2.2 of Attachment M to the OATT.

ITC System Planning Procedures is defined in Section 15.4 of Attachment M to the OATT.

Joint ISO/RTO Planning Committee (JIPC) is the committee described as such in the Northeastern Planning Protocol.

Late Payment Account is a segregated interest-bearing account into which the ISO deposits Late Payment Charges due from ISO Charges and interest owed from participants for late payments that are collected and not distributed to the Covered Entities, until the Late Payment Account Limit is reached, under the ISO New England Billing Policy and penalties collected under the ISO New England Financial Assurance Policy.

Late Payment Account Limit is defined in Section 4.2 of the ISO New England Billing Policy.

Late Payment Charge is defined in Section 4.1 of the ISO New England Billing Policy.

Lead Market Participant, for purposes other than the Forward Capacity Market, is the entity authorized to submit Supply Offers or Demand Bids for a Resource and to whom certain Energy TUs are assessed under Schedule 2 of Section IV.A of the Tariff. For purposes of the Forward Capacity Market, the Lead Market Participant is the entity designated to participate in that market on behalf of an Existing Capacity Resource or a New Capacity Resource.

Limited Energy Resource means generating resources that, due to design considerations, environmental restriction on operations, cyclical requirements, such as the need to recharge or refill or manage water flow, or fuel limitations, are unable to operate continuously at full output on a daily basis.

Load Asset means a physical load that has been registered in accordance with the Asset Registration Process.

Load Management means installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that curtail electrical usage or shift electrical usage from Demand Resource On-Peak Hours, Demand Resource Seasonal Peak Hours, or Real-Time Demand Response Event Hours to other hours and reduce the amount of capacity needed, while delivering a comparable or acceptable level of end-use service. Such measures include, but are not limited to, energy management systems, load control end-use cycling, load curtailment strategies, chilled water storage, and other forms of electricity storage.

Load Response Program means the program implemented and administered by the ISO to promote demand side response as described in Appendix E to Market Rule 1.

Load Response Program Asset means one or more individual end-use metered customers that report load reduction and consumption, or generator output as a single set of values, are assigned an identification number, that participate in the Load Response Program and which encompass assets registered in the Real-Time Price Response Program or Real-Time Demand Response Assets, and are further described in Appendix E of Market Rule 1.

Load Shedding is the systematic reduction of system demand by temporarily decreasing load.

Load Zone is a Reliability Region, except as otherwise provided for in Section III.2.7 of Market Rule 1.

Local Area Facilities are defined in the TOA.

Local Benefit Upgrade(s) (LBU) is an upgrade, modification or addition to the transmission system that is: (i) rated below 115kV or (ii) rated 115kV or above and does not meet all of the non-voltage criteria for PTF classification specified in the OATT.

Local Control Centers are those control centers in existence as of the effective date of the OATT (including the CONVEX, REMVEC, Maine and New Hampshire control centers) or established by the PTOs in accordance with the TOA that are separate from the ISO Control Center and perform certain functions in accordance with the OATT and the TOA.

Local Delivery Service is the service of delivering electric energy to end users. This service is subject to state jurisdiction regardless of whether such service is provided over local distribution or transmission facilities. An entity that is an Eligible Customer under the OATT is not excused from any requirements of state law, or any order or regulation issued pursuant to state law, to arrange for Local Delivery Service with the Participating Transmission Owner and/or distribution company providing such service and to pay all applicable charges associated with such service, including charges for stranded costs and benefits.

Local Network is defined as the transmission facilities constituting a local network as identified in Attachment E, as such Attachment may be modified from time to time in accordance with the Transmission Operating Agreement.

Local Network Load is the load that a Network Customer designates for Local Network Service under Schedule 21 to the OATT.

Local Network RNS Rate is the rate applicable to Regional Network Service to effect a delivery to load in a particular Local Network, as determined in accordance with Schedule 9 to the OATT.

Local Network Service (LNS) is the network service provided under Schedule 21 and the Local Service Schedules to permit the Transmission Customer to efficiently and economically utilize its resources to serve its load.

Local Point-To-Point Service (LPTP) is Point-to-Point Service provided under Schedule 21 of the OATT and the Local Service Schedules to permit deliveries to or from an interconnection point on the PTF.

Local Resource Adequacy Requirement is calculated pursuant to Section III.12.2.1.1.

Local Second Contingency Protection Resources are those Resources identified by the ISO on a daily basis as necessary for the provision of Operating Reserve requirements and adherence to NERC, NPCC and ISO reliability criteria over and above those Resources required to meet first contingency reliability criteria within a Reliability Region.

Local Service is transmission service provided under Schedule 21 and the Local Service Schedules thereto.

Local Service Schedule is a PTO-specific schedule to the OATT setting forth the rates, charges, terms and conditions applicable to Local Service.

Local Sourcing Requirement (LSR) is the minimum amount of capacity that must be located within an import-constrained Load Zone, calculated as described in Section III.12.2 of Market Rule 1.

Local System Planning (LSP) is the process defined in Appendix 1 of Attachment K to the OATT.

Localized Costs are the incremental costs resulting from a RTEP02 Upgrade or a Regional Benefit Upgrade that exceeds those requirements that the ISO deems reasonable and consistent with Good Utility Practice and the current engineering design and construction practices in the area in which the Transmission Upgrade is built. In making its determination of whether Localized Costs exist, the ISO will consider, in accordance with Schedule 12C of the OATT, the reasonableness of the proposed engineering design and construction method with respect to alternate feasible Transmission Upgrades and the relative costs, operation, timing of implementation, efficiency and reliability of the proposed Transmission Upgrade. The ISO, with advisory input from the Reliability Committee, as appropriate, shall review such Transmission Upgrade, and determine whether there are any Localized Costs resulting from such Transmission Upgrade. If there are any such costs, the ISO shall identify them in the Regional System Plan.

Location is a Node, External Node, Load Zone or Hub. For Capacity Commitment Periods commencing on or after June 1, 2017, the Location also is a Dispatch Zone.

Locational Marginal Price (LMP) is defined in Section III.2 of Market Rule 1. The Locational Marginal Price for a Node is the nodal price at that Node; the Locational Marginal Price for an External Node is the nodal price at that External Node; the Locational Marginal Price for a Load Zone or Reliability Region is the Zonal Price for that Load Zone or Reliability Region, respectively; and the Locational Marginal Price for a Hub is the Hub Price for that Hub. For Capacity Commitment Periods commencing on or after June 1, 2017, the Location Marginal Price for a Dispatch Zone is the Zonal Price for that Dispatch Zone.

Long Lead Time Generating Facility (Long Lead Facility) has the meaning specified in Section I of Schedule 22 of the OATT.

Long-Term is a term of one year or more.

Long-Term Transmission Outage is a long-term transmission outage scheduled in accordance with ISO New England Operating Procedure No. 3.

Loss Component is the component of the nodal LMP at a given Node or External Node on the PTF that reflects the cost of losses at that Node or External Node relative to the reference point. The Loss Component of the nodal LMP at a given Node on the non-PTF system reflects the relative cost of losses at that Node adjusted as required to account for losses on the non-PTF system already accounted for through tariffs associated with the non-PTF. When used in connection with Hub Price or Zonal Price, the term Loss Component refers to the Loss Components of the nodal LMPs that comprise the Hub Price or Zonal Price, which Loss Components are averaged or weighted in the same way that nodal LMPs are averaged to determine Hub Price or weighted to determine Zonal Price.

Loss of Load Expectation (LOLE) is the probability of disconnecting non-interruptible customers due to a resource deficiency.

Lost Opportunity Cost (LOC) is one of four forms of compensation that may be paid to resources providing VAR Service under Schedule 2 of the OATT.

LSE means load serving entity.

Lump Sum Blackstart Payment is defined and calculated as specified in Section 5.4 of Schedule 16 to the OATT.

Lump Sum Blackstart Capital Payment is defined and calculated as specified in Section 5.4 of Schedule 16 to the OATT.

Lump Sum Blackstart CIP Capital Payment is defined and calculated as specified in Section 5.4 of Schedule 16 to the OATT.

Major Transmission Outage is a major transmission outage scheduled in accordance with ISO New England Operating Procedure No. 3.

Manual Response Rate is the rate, in MW/Minute, at which the output of a Generator Asset is capable of changing.

Marginal Loss Revenue Load Obligation is defined in Section III.3.2.1(b)(v) of Market Rule 1.

Market Credit Limit is a credit limit for a Market Participant's Financial Assurance Obligations (except FTR Financial Assurance Requirements) established for each Market Participant in accordance with Section II.C of the ISO New England Financial Assurance Policy.

Market Credit Test Percentage is calculated in accordance with Section III.B.1(a) of the ISO New England Financial Assurance Policy.

Market Efficiency Transmission Upgrade is defined as those additions and upgrades that are not related to the interconnection of a generator, and, in the ISO's determination, are designed to reduce bulk power system costs to load system-wide, where the net present value of the reduction in bulk power system costs to load system-wide exceeds the net present value of the cost of the transmission addition or upgrade. For purposes of this definition, the term "bulk power system costs to load system-wide" includes, but is not limited to, the costs of energy, capacity, reserves, losses and impacts on bilateral prices for electricity.

Market Participant is a participant in the New England Markets (including a FTR-Only Customer) that has executed a Market Participant Service Agreement, or on whose behalf an unexecuted Market Participant Service Agreement has been filed with the Commission.

Market Participant Financial Assurance Requirement is defined in Section III of the ISO New England Financial Assurance Policy.

Market Participant Obligations is defined in Section III.B.1.1 of Appendix B of Market Rule 1.

Market Participant Service Agreement (MPSA) is an agreement between the ISO and a Market Participant, in the form specified in Attachment A or Attachment A-1 to the Tariff, as applicable.

Market Rule 1 is ISO Market Rule 1 and appendices set forth in Section III of this ISO New England Inc. Transmission, Markets and Services Tariff, as it may be amended from time to time.

Market Violation is a tariff violation, violation of a Commission-approved order, rule or regulation, market manipulation, or inappropriate dispatch that creates substantial concerns regarding unnecessary market inefficiencies.

Material Adverse Change is any change in financial status including, but not limited to a downgrade to below an Investment Grade Rating by any Rating Agency, being placed on credit watch with negative implication by any Rating Agency if the Market Participant or Non-Market Participant Transmission Customer does not have an Investment Grade Rating, a bankruptcy filing or other insolvency, a report of a significant quarterly loss or decline of earnings, the resignation of key officer(s), the sanctioning of the Market Participant or Non-Market Participant Transmission Customer or any of its Principles imposed by the Federal Energy Regulatory Commission, the Securities Exchange Commission, any exchange monitored by the National Futures Association, or any state entity responsible for regulating activity in energy markets; the filing of a material lawsuit that could materially adversely impact current or future financial results; a significant change in the Market Participant's or Non-Market Participant Transmission Customer's credit default spreads; or a significant change in market capitalization.

Material Adverse Impact is defined, for purposes of review of ITC-proposed plans, as a proposed facility or project will be deemed to cause a "material adverse impact" on facilities outside of the ITC System if: (i) the proposed facility or project causes non-ITC facilities to exceed their capabilities or

exceed their thermal, voltage or stability limits, consistent with all applicable reliability criteria, or (ii) the proposed facility or project would not satisfy the standards set forth in Section I.3.9 of the Transmission, Markets and Services Tariff. This standard is intended to assure the continued service of all non-ITC firm load customers and the ability of the non-ITC systems to meet outstanding transmission service obligations.

Maximum Capacity Limit is the maximum amount of capacity that can be procured in an export-constrained Load Zone, calculated as described in Section III.12.2 of Market Rule 1, to meet the Installed Capacity Requirement.

Maximum Consumption Limit is the maximum amount, in MW, available from the Dispatchable Asset Related Demand for economic dispatch and is based on the physical characteristics as submitted as part of a Resource's Offer Data except that a Self-Scheduled Dispatchable Asset Related Demand may modify its Minimum Consumption Limit on an hourly basis, as part of its Demand Bid, in order to indicate the desired level of Self-Scheduled MW.

Maximum Facility Load is the most recent annual non-coincident peak demand or, if unavailable, an estimate of the annual non-coincident peak demand of a Real-Time Demand Response Asset or a Real-Time Emergency Generation Asset, where the demand evaluated is established by adding actual metered demand and the output of all generators located behind the asset's end-use customer meter in the same time intervals.

Maximum Generation is the maximum generation output of a Real-Time Demand Response Asset comprised of Distributed Generation or the maximum generation output of a Demand Response Asset comprised of Distributed Generation.

Maximum Interruptible Capacity is an estimate of the maximum hourly demand reduction amount that a Real-Time Demand Response Asset, Real-Time Emergency Generation Asset or a Demand Response Asset can deliver. For assets that deliver demand reduction, the Maximum Interruptible Capacity is the asset's peak load less its uninterruptible load. For assets that deliver reductions through the use of generation, the Maximum Interruptible Capacity is the difference between the generator's maximum possible output and its expected output when not providing demand reduction.

Maximum Load is the most recent annual non-coincident peak demand or, if unavailable, an estimate of the annual non-coincident peak demand, of a Demand Response Asset, Real-Time Demand Response Asset or Real-Time Emergency Generation Asset.

Maximum Net Supply is an estimate of the maximum hourly Net Supply for a Demand Response Asset as measured from the Demand Response Asset's Retail Delivery Point.

Maximum Reduction is the maximum available demand reduction, in MW, of a Demand Response Resource that a Market Participant offers to deliver in the Day-Ahead Energy Market or Real-Time Energy Market, as reflected in the Demand Response Resource's Demand Reduction Offer.

Measure Life is the estimated time a Demand Resource measure will remain in place, or the estimated time period over which the facility, structure, equipment or system in which a measure is installed continues to exist, whichever is shorter. Suppliers of Demand Resources comprised of an aggregation of measures with varied Measures Lives shall determine and document the Measure Life either: (i) for each type of measure with a different Measure Life and adjust the aggregate performance based on the individual measure life calculation in the portfolio; or (ii) as the average Measure Life for the aggregated measures as long as the Demand Reduction Value of the Demand Resource is greater than or equal to the amount that cleared in the Forward Capacity Auction or reconfiguration auction for the entire Capacity Commitment Period, and the Demand Reduction Value for an Existing Demand Resource is not overstated in a subsequent Capacity Commitment Period. Measure Life shall be determined consistent with the Demand Resource's Measurement and Verification Plan, which shall be reviewed by the ISO to ensure consistency with the measurement and verification requirements of Market Rule 1 and the ISO New England Manuals.

Measurement and Verification Documents mean the measurement and verification documents described in Section 13.1.4.3.1 of Market Rule 1, which includes Measurement and Verification Plans, Updated Measurement and Verification Plans, Measurement and Verification Summary Reports, and Measurement and Verification Reference Reports.

Measurement and Verification Plan means the measurement and verification plan submitted by a Demand Resource supplier as part of the qualification process for the Forward Capacity Auction pursuant to the requirements of Section III.13.1.4.3 of Market Rule 1 and the ISO New England Manuals.

Measurement and Verification Reference Reports are optional reports submitted by Demand Resource suppliers during the Capacity Commitment Period subject to the schedule in the Measurement and Verification Plan and consistent with the schedule and reporting standards set forth in the ISO New England Manuals. Measurement and Verification Reference Reports update the prospective Demand Reduction Value of the Demand Resource project based on measurement and verification studies performed during the Capacity Commitment Period.

Measurement and Verification Summary Report is the monthly report submitted by a Demand Resource supplier with the monthly settlement report for the Forward Capacity Market, which documents the total Demand Reduction Values for all Demand Resources in operation as of the end of the previous month.

MEPCO Grandfathered Transmission Service Agreement (MGTSA) is a MEPCO long-term firm point-to-point transmission service agreement with a POR or POD at the New Brunswick border and a start date prior to June 1, 2007 where the holder has elected, by written notice delivered to MEPCO within five (5) days following the filing of the settlement agreement in Docket Nos. ER07-1289 and EL08-56 or by September 1, 2008 (whichever is later), MGTSA treatment as further described in Section II.45.1.

Merchant Transmission Facilities (MTF) are the transmission facilities owned by MTOs, defined and classified as MTF pursuant to Schedule 18 of the OATT, over which the ISO shall exercise Operating Authority in accordance with the terms set forth in a MTOA or Attachment K to the OATT, rated 69 kV or above and required to allow energy from significant power sources to move freely on the New England Transmission System.

Merchant Transmission Facilities Provider (MTF Provider) is an entity as defined in Schedule 18 of the OATT.

Merchant Transmission Facilities Service (MTF Service) is transmission service over MTF as provided for in Schedule 18 of the OATT.

Merchant Transmission Operating Agreement (MTOA) is an agreement between the ISO and an MTO with respect to its MTF.

Merchant Transmission Owner (MTO) is an owner of MTF.

Meter Data Error means an error in meter data, including an error in Coincident Peak Contribution values, on an Invoice issued by the ISO after the completion of the data reconciliation process as described in the ISO New England Manuals and in Section III.3.8 of Market Rule 1.

Meter Data Error RBA Submission Limit means the date thirty 30 calendar days after the issuance of the Invoice containing the results of the data reconciliation process as described in the ISO New England Manuals and in Section III.3.6 of Market Rule 1.

Minimum Consumption Limit is the minimum amount, in MW, available from a Dispatchable Asset Related Demand that is not available for economic dispatch and is based on the physical characteristics as submitted as part of a Resource's Offer Data.

Minimum Generation Emergency means an Emergency declared by the ISO in which the ISO anticipates requesting one or more generating Resources to operate at or below Economic Minimum Limit, in order to manage, alleviate, or end the Emergency.

Minimum Generation Emergency Charge means the charge used to allocate the cost of Minimum Generation Emergency Credits. Minimum Generation Emergency Charges are discussed in Appendix F of Market Rule 1.

Minimum Generation Emergency Credits are credits calculated pursuant to Appendix F of Market Rule 1 to compensate certain generating Resources for operation in excess of their Economic Minimum Limits during a Minimum Generation Emergency.

Minimum Reduction is the minimum available demand reduction, in MW, of a Demand Response Resource that a Market Participant offers to deliver in the Day-Ahead Energy Market or Real-Time Energy Market, as reflected in the Demand Response Resource's Demand Reduction Offer.

Minimum Reduction Time is the minimum number of hours of demand reduction at or above the Minimum Reduction for which the ISO must dispatch a Demand Response Resource to reduce demand.

Minimum Time Between Reductions is the minimum number of hours that a Market Participant requires between the time the Demand Response Resource receives a Dispatch Instruction from the ISO to not reduce demand and the time the Demand Response Resource receives a Dispatch Instruction from the ISO to reduce demand.

Monthly Blackstart Service Charge is the charge made to Transmission Customers pursuant to Section 6 of Schedule 16 to the OATT.

Monthly Capacity Variance means a Demand Resource's actual monthly Capacity Value established pursuant to Section III.13.7.1.5.1 of Market Rule 1, minus the Demand Resource's final Capacity Supply Obligation for the month.

Monthly Peak is defined in Section II.21.2 of the OATT.

Monthly PER is calculated in accordance with Section III.13.7.2.7.1.1.2(a) of Market Rule 1.

Monthly Real-Time Generation Obligation is the sum, for all hours in a month, at all Locations, of a Customer's Real-Time Generation Obligation, in MWs.

Monthly Real-Time Load Obligation is the absolute value of a Customer's hourly Real-Time Load Obligation summed for all hours in a month, in MWs.

Monthly Regional Network Load is defined in Section II.21.2 of the OATT.

Monthly Statement is the first weekly Statement issued on a Monday after the tenth of a calendar month that includes both the Hourly Charges for the relevant billing period and Non-Hourly Charges for the immediately preceding calendar month.

MUI is the market user interface.

Municipal Market Participant is defined in Section II of the ISO New England Financial Assurance Policy.

MW is megawatt.

MWh is megawatt-hour.

Native Load Customers are the wholesale and retail power customers of a Transmission Owner on whose behalf the Transmission Owner, by statute, franchise, regulatory requirement, or contract, has undertaken an obligation to construct and operate its system to meet the reliable electric needs of such customers.

NCPC Charge means the charges to Market Participants as provided in Section III.3.2.3, Section III.6.4 and Appendix F.

NCPC Credit means the payment made to a Resource as provided in Section III.3.2.3, Section III.6.4 and Appendix F.

Needs Assessment is defined in Section 4.1 of Attachment K to the OATT.

NEMA, for purposes of Section III of the Tariff, is the Northeast Massachusetts Reliability Region.

NEMA Contract is a contract described in Appendix C of Market Rule 1 and listed in Exhibit 1 of Appendix C of Market Rule 1.

NEMA Load Serving Entity (NEMA LSE) is a Transmission Customer or Congestion Paying LSE Entity that serves load within NEMA.

NEMA or Northeast Massachusetts Upgrade, for purposes of Section II of the Tariff, is an addition to or modification of the PTF into or within the Northeast Massachusetts Reliability Region that was not, as of December 31, 1999, the subject of a System Impact Study or application filed pursuant to Section I.3.9 of the Transmission, Markets and Services Tariff; that is not related to generation interconnections; and that will be completed and placed in service by June 30, 2004. Such upgrades include, but are not limited to, new transmission facilities and related equipment and/or modifications to existing transmission facilities and related equipment. The list of NEMA Upgrades is contained in Schedule 12A of the OATT.

NEPOOL is the New England Power Pool, and the entities that collectively participated in the New England Power Pool.

NEPOOL Agreement is the agreement among the participants in NEPOOL.

NEPOOL GIS is the generation information system.

NEPOOL GIS Administrator is the entity or entities that develop, administer, operate and maintain the NEPOOL GIS.

NERC is the North American Electric Reliability Corporation or its successor organization.

Net Commitment Period Compensation (NCPC) is the compensation methodology for Resources that is described in Appendix F to Market Rule 1.

Net CONE is an estimate of the Cost of New Entry, net of the first-year non-capacity market revenues, for a reference technology resource type and is intended to equal the amount of capacity revenue the reference technology resource would require, in its first year of operation, to be economically viable given reasonable expectations of the first year energy and ancillary services revenues, and projected revenue for subsequent years.

Net Regional Clearing Price is described in Section III.13.7.3 of Market Rule 1.

Net Supply is energy injected at the Retail Delivery Point by a Demand Response Asset with Distributed Generation.

Net Supply Generator Asset is the Generator Asset registered in the energy market at the same Retail Delivery Point as a Demand Response Asset with Distributed Generation capable of delivering Net Supply.

Network Capability Interconnection Standard has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Network Customer is a Transmission Customer receiving RNS or LNS.

Network Resource is defined as follows: (1) With respect to Market Participants, (a) any generating resource located in the New England Control Area which has been placed in service prior to the Compliance Effective Date (including a unit that has lost its capacity value when its capacity value is restored and a deactivated unit which may be reactivated without satisfying the requirements of Section II.46 of the OATT in accordance with the provisions thereof) until retired; (b) any generating resource located in the New England Control Area which is placed in service after the Compliance Effective Date until retired, provided that (i) the Generator Owner has complied with the requirements of Sections II.46 and II.47 and Schedules 22 and 23 of the OATT, and (ii) the output of the unit shall be limited in accordance with Sections II.46 and II.47 and Schedules 22 and 23, if required; and (c) any generating resource or combination of resources (including bilateral purchases) located outside the New England Control Area for so long as any Market Participant has an Ownership Share in the resource or resources which is being delivered to it in the New England Control Area to serve Regional Network Load located in the New England Control Area or other designated Regional Network Loads contemplated by Section II.18.3 of the OATT taking Regional Network Service. (2) With respect to Non-Market Participant Transmission Customers, any generating resource owned, purchased or leased by the Non-Market Participant Transmission Customer which it designates to serve Regional Network Load.

New Brunswick Security Energy is defined in Section III.3.2.6A of Market Rule 1.

New Capacity Offer is an offer in the Forward Capacity Auction to provide capacity from a New Generating Capacity Resource, New Import Capacity Resource, or New Demand Resource, as described in Section III.13.2.3.2 of Market Rule 1.

New Capacity Qualification Deadline is a deadline, specified in Section III.13.1.10 of Market Rule 1, for submission of certain qualification materials for the Forward Capacity Auction, as discussed in Section III.13.1 of Market Rule 1.

New Capacity Qualification Package is information submitted by certain new resources prior to participation in the Forward Capacity Auction, as described in Section III.13.1 of Market Rule 1.

New Capacity Required is the amount of additional capacity required to meet the Installed Capacity Requirement or a Capacity Zone's Local Sourcing Requirement, as described in Section III.13.2.8.1.1 of Market Rule 1.

New Capacity Resource is a resource (i) that never previously received any payment as a capacity resource including any capacity payment pursuant to the market rules in effect prior to June 1, 2010 and that has not cleared in any previous Forward Capacity Auction; or (ii) that is otherwise eligible to participate in the Forward Capacity Auction as a New Capacity Resource.

New Capacity Show of Interest Form is described in Section III.13.1.1.2.1 of Market Rule 1.

New Capacity Show of Interest Submission Window is the period of time during which a Project Sponsor may submit a New Capacity Show of Interest Form or a New Demand Resource Show of Interest Form, as described in Section III.13.1.10 of Market Rule 1.

New Demand Resource is a type of Demand Resource participating in the Forward Capacity Market, as defined in Section III.13.1.4.1.2 of Market Rule 1.

New Demand Resource Qualification Package is the information that a Project Sponsor must submit, in accordance with Section III 13.1.4.2.3 of Market Rule 1, for each resource that it seeks to offer in the Forward Capacity Auction as a New Demand Resource.

New Demand Resource Show of Interest Form is described in Section III.13.1.4.2 of Market Rule 1.

New Demand Response Asset is a Real-Time Demand Response Asset, Real-Time Emergency Generation Asset or Demand Response Asset that is registered with the ISO, has been mapped to a resource, is ready to respond, and has been included in the dispatch model of the remote terminal unit but does not have a winter audit value and a summer audit value.

New Demand Response Asset Audit is an audit of a New Demand Response Asset performed pursuant to Section III.13.6.1.5.4.8.

New England Control Area is the Control Area for New England, which includes PTF, Non-PTF, MTF and OTF. The New England Control Area covers Connecticut, Rhode Island, Massachusetts, New Hampshire, Vermont, and part of Maine (i.e., excluding the portions of Northern Maine and the northern portion of Eastern Maine which are in the Maritimes Control Area).

New England Markets are markets or programs for the purchase of energy, capacity, ancillary services, demand response services or other related products or services (including Financial Transmission Rights) that are delivered through or useful to the operation of the New England Transmission System and that are administered by the ISO pursuant to rules, rates, or agreements on file from time to time with the Federal Energy Regulatory Commission.

New England System Restoration Plan is the plan that is developed by ISO, in accordance with NERC Reliability Standards, NPCC regional criteria and standards, ISO New England Operating Documents and ISO operating agreements, to facilitate the restoration of the New England Transmission System following a partial or complete shutdown of the New England Transmission System.

New England Transmission System is the system of transmission facilities, including PTF, Non-PTF, OTF and MTF, within the New England Control Area under the ISO's operational jurisdiction.

New Generating Capacity Resource is a type of resource participating in the Forward Capacity Market, as described in Section III.13.1.1.1 of Market Rule 1.

New Import Capacity Resource is a type of resource participating in the Forward Capacity Market, as defined in Section III.13.1.3.4 of Market Rule 1.

NMPTC means Non-Market Participant Transmission Customer.

NMPTC Credit Threshold is described in Section V.A.2 of the ISO New England Financial Assurance Policy.

NMPTC Financial Assurance Requirement is an amount of additional financial assurance for Non-Market Participant Transmission Customers described in Section V.D of the ISO New England Financial Assurance Policy.

Nodal Amount is node(s)-specific on-peak and off-peak proxy value to which an FTR bid or awarded FTR bid relates.

Node is a point on the New England Transmission System at which LMPs are calculated.

No-Load Fee is the amount, in dollars per hour, for a generating unit that must be paid to Market Participants with an Ownership Share in the unit for being scheduled in the New England Markets, in addition to the Start-Up Fee and price offered to supply energy, for each hour that the generating unit is scheduled in the New England Markets.

Nominated Consumption Limit is the consumption level specified by the Market Participant for a Dispatchable Asset Related Demand as adjusted in accordance with the provisions of Section III.13.7.3.1.3.

Non-Commercial Capacity is the capacity of a New Capacity Resource or an increment of an Existing Capacity Resource that is treated as a New Capacity Resource in the Forward Capacity Auction and that has not been declared commercial and has not had its capacity rating verified by the ISO.

Non-Commercial Capacity Cure Period is the time period described in Section VII.D of the ISO New England Financial Assurance Policy.

Non-Commercial Capacity Financial Assurance Amount (Non-Commercial Capacity FA Amount) is the financial assurance amount held on Non-Commercial Capacity cleared in a Forward Capacity Auction as calculated in accordance with Section VII.B.2 of the ISO New England Financial Assurance Policy.

Non-Designated Blackstart Resource Study Cost Payments are the study costs reimbursed under Section 5.3 of Schedule 16 of the OATT.

Non-Hourly Charges are defined in Section 1.3 of the ISO New England Billing Policy.

Non-Hourly Requirements are determined in accordance with Section III.A(ii) of the ISO New England Financial Assurance Policy, which is Exhibit 1A of Section I of the Tariff.

Non-Intermittent Settlement Only Resource is a Settlement Only Resource that is not an Intermittent Power Resource.

Non-Market Participant is any entity that is not a Market Participant.

Non-Market Participant Transmission Customer is any entity which is not a Market Participant but is a Transmission Customer.

Non-Municipal Market Participant is defined in Section II of the ISO New England Financial Assurance Policy.

Non-Price Retirement Request is a binding request to retire the entire capacity of a Generating Capacity Resource as described in Section III.13.1.2.3.1.5.

Non-PTF Transmission Facilities (Non-PTF) are the transmission facilities owned by the PTOs that do not constitute PTF, OTF or MTF.

Non-Qualifying means a Market Participant that is not a Credit Qualifying Market Participant.

Notice of RBA is defined in Section 6.3.2 of the ISO New England Billing Policy.

Notification Time is the time required for a Generator Asset to synchronize to the system from the time a startup Dispatch Instruction is received from the ISO.

Northeastern Planning Protocol is the Amended and Restated Northeastern ISO/RTO Planning Coordination Protocol on file with the Commission.

NPCC is the Northeast Power Coordinating Council.

Obligation Month means a time period of one calendar month for which capacity payments are issued and the costs associated with capacity payments are allocated.

Offer Data means the scheduling, operations planning, dispatch, new Resource, and other data, including generating unit and Dispatchable Asset Related Demand, and for Capacity Commitment Periods commencing on or after June 1, 2017, Demand Response Resource operating limits based on physical characteristics, and information necessary to schedule and dispatch generating and Dispatchable Asset Related Demand Resources, and for Capacity Commitment Periods commencing on or after June 1, 2017.

Demand Response Resources for the provision of energy and other services and the maintenance of the reliability and security of the transmission system in the New England Control Area, and specified for submission to the New England Markets for such purposes by the ISO.

Offered CLAIM10 is a Supply Offer value between 0 and the CLAIM10 of a Resource that represents the amount of TMNSR available from the Resource.

Offered CLAIM30 is a Supply Offer value between 0 and the CLAIM30 of a Resource that represents the amount of offline TMOR available from the Resource.

Offered Full Reduction Time is the value calculated pursuant to Section III.13.6.1.5.4.6.

On-Peak Demand Resource is a type of Demand Resource and means installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that reduce the total amount of electrical energy consumed during Demand Resource On-Peak Hours, while delivering a comparable or acceptable level of end-use service. Such measures include Energy Efficiency, Load Management, and Distributed Generation.

Open Access Same-Time Information System (OASIS) is the ISO information system and standards of conduct responding to requirements of 18 C.F.R. §37 of the Commission's regulations and all additional requirements implemented by subsequent Commission orders dealing with OASIS.

Open Access Transmission Tariff (OATT) is Section II of the ISO New England Inc. Transmission, Markets and Services Tariff.

Operating Authority is defined pursuant to a MTOA, an OTOA, the TOA or the OATT, as applicable.

Operating Data means GADS Data, data equivalent to GADS Data, CARL Data, metered load data, or actual system failure occurrences data, all as described in the ISO New England Operating Procedures.

Operating Day means the calendar day period beginning at midnight for which transactions on the New England Markets are scheduled.

Operating Reserve means Ten-Minute Spinning Reserve (TMSR), Ten-Minute Non-Spinning Reserve (TMNSR) and Thirty-Minute Operating Reserve (TMOR).

Operations Date is February 1, 2005.

OTF Service is transmission service over OTF as provided for in Schedule 20.

Other Transmission Facility (OTF) are the transmission facilities owned by Transmission Owners, defined and classified as OTF pursuant to Schedule 20, over which the ISO shall exercise Operating Authority in accordance with the terms set forth in the OTOA, rated 69 kV or above, and required to allow energy from significant power sources to move freely on the New England Transmission System. OTF classification shall be limited to the Phase I/II HVDC-TF.

Other Transmission Operating Agreements (OTOA) is the agreement(s) between the ISO, an OTO and/or the associated service provider(s) with respect to an OTF, which includes the HVDC Transmission Operating Agreement and the Phase I/II HVDC-TF Transmission Service Administration Agreement. With respect to the Phase I/II HVDC-TF, the HVDC Transmission Operating Agreement covers the rights and responsibilities for the operation of the facility and the Phase I/II HVDC-TF Transmission Service Administration Agreement covers the rights and responsibilities for the administration of transmission service.

Other Transmission Owner (OTO) is an owner of OTF.

Ownership Share is a right or obligation, for purposes of settlement, to a percentage share of all credits or charges associated with a generating unit asset or Load Asset, where such unit or load is interconnected to the New England Transmission System.

Participant Expenses are defined in Section 1 of the Participants Agreement.

Participant Required Balance is defined in Section 5.3 of the ISO New England Billing Policy.

Participant Vote is defined in Section 1 of the Participants Agreement.

Participants Agreement is the agreement among the ISO, the New England Power Pool and Individual Participants, as amended from time to time, on file with the Commission.

Participants Committee is the principal committee referred to in the Participants Agreement.

Participating Transmission Owner (PTO) is a transmission owner that is a party to the TOA.

Payment is a sum of money due to a Covered Entity from the ISO.

Payment Default Shortfall Fund is defined in Section 5.1 of the ISO New England Billing Policy.

Peak Energy Rent (PER) is described in Section III.13.7.2.7.1 of Market Rule 1.

PER Proxy Unit is described in Section III.13.7.2.7.1 of Market Rule 1.

Percent of Total Demand Reduction Value Complete means the delivery schedule as a percentage of a Demand Resource's total Demand Reduction Value that will be or has been achieved as of specific target dates, as described in Section III.13 of Market Rule 1.

Permanent De-list Bid is a bid that may be submitted by an Existing Generating Capacity Resource, Existing Import Capacity Resource, or Existing Demand Resource in the Forward Capacity Auction to permanently remove itself from the capacity market, as described in Section III.13.1.2.3.1.2 of Market Rule 1.

Phase I Transfer Credit is 40% of the HQICC, or such other fraction of the HQICC as the ISO may establish.

Phase I/II HVDC-TF is defined in Schedule 20A to Section II of this Tariff.

Phase I/II HVDC-TF Transfer Capability is the transfer capacity of the Phase I/II HVDC-TF under normal operating conditions, as determined in accordance with Good Utility Practice. The "Phase I Transfer Capability" is the transfer capacity under normal operating conditions, as determined in accordance with Good Utility Practice, of the Phase I terminal facilities as determined initially as of the time immediately prior to Phase II of the Phase I/II HVDC-TF first being placed in service, and as

adjusted thereafter only to take into account changes in the transfer capacity which are independent of any effect of Phase II on the operation of Phase I. The “Phase II Transfer Capability” is the difference between the Phase I/II HVDC-TF Transfer Capability and the Phase I Transfer Capability.

Determinations of, and any adjustment in, Phase I/II HVDC-TF Transfer Capability shall be made by the ISO, and the basis for any such adjustment shall be explained in writing and posted on the ISO website.

Phase II Transfer Credit is 60% of the HQICC, or such other fraction of the HQICC as the ISO may establish.

Planning Advisory Committee is the committee described in Attachment K of the OATT.

Planning and Reliability Criteria is defined in Section 3.3 of Attachment K to the OATT.

Planning Authority is an entity defined as such by the North American Electric Reliability Corporation.

Point(s) of Delivery (POD) is point(s) of interconnection where capacity and/or energy transmitted by a Transmission Customer will be made available to the Receiving Party under the OATT.

Point(s) of Receipt (POR) is point(s) of interconnection where capacity and/or energy transmitted by a Transmission Customer will be made available by the Delivering Party under the OATT.

Point-To-Point Service is the transmission of capacity and/or energy on either a firm or non-firm basis from the Point(s) of Receipt to the Point(s) of Delivery under the OATT pursuant to Local Point-To-Point Service or OTF Service or MTF Service; and the transmission of capacity and/or energy from the Point(s) of Receipt to the Point(s) of Delivery under the OATT pursuant to Through or Out Service.

Pool-Planned Unit is one of the following units: New Haven Harbor Unit 1 (Coke Works), Mystic Unit 7, Canal Unit 2, Potter Unit 2, Wyman Unit 4, Stony Brook Units 1, 1A, 1B, 1C, 2A and 2B, Millstone Unit 3, Seabrook Unit 1 and Waters River Unit 2 (to the extent of 7 megawatts of its Summer capability and 12 megawatts of its Winter capability).

Pool PTF Rate is the transmission rate determined in accordance with Schedule 8 to the OATT.

Pool RNS Rate is the transmission rate determined in accordance with paragraph (2) of Schedule 9 of Section II of the Tariff.

Pool-Scheduled Resources are described in Section III.1.10.2 of Market Rule 1.

Pool Supported PTF is defined as: (i) PTF first placed in service prior to January 1, 2000; (ii) Generator Interconnection Related Upgrades with respect to Category A and B projects (as defined in Schedule 11), but only to the extent not paid for by the interconnecting Generator Owner; and (iii) other PTF upgrades, but only to the extent the costs therefore are determined to be Pool Supported PTF in accordance with Schedule 12.

Pool Transmission Facility (PTF) means the transmission facilities owned by PTOs which meet the criteria specified in Section II.49 of the OATT.

Poorly Performing Resource is described in Section III.13.7.1.1.5 of Market Rule 1.

Posting Entity is any Market Participant or Non-Market Participant Transmission Customer providing financial security under the provisions of the ISO New England Financial Assurance Policy.

Posture means an action of the ISO to deviate from the jointly optimized security constrained economic dispatch for Energy and Operating Reserves solution for a Resource produced by the ISO's technical software for the purpose of maintaining sufficient Operating Reserve (both online and off-line) or for the provision of voltage or VAR support.

Posturing Credit is calculated pursuant to Section III.F.2.6.2 of Appendix F to Market Rule 1.

Power Purchaser is the entity that is purchasing the capacity and/or energy to be transmitted under the OATT.

Principal is (i) the sole proprietor of a sole proprietorship; (ii) a general partner of a partnership; (iii) a president, chief executive officer, chief operating officer or chief financial officer (or equivalent position) of an organization; (iv) a manager, managing member or a member vested with the management authority for a limited liability company or limited liability partnership; (v) any person or entity that has the power to exercise a controlling influence over an organization's activities that are subject to regulation by the

Federal Energy Regulatory Commission, the Securities and Exchange Commission, the Commodity Futures Trading Commission, any exchange monitored by the National Futures Association, or any state entity responsible for regulating activity in energy markets; or (vi) any person or entity that: (a) is the direct owner of 10% or more of any class of an organization's equity securities; or (b) has directly contributed 10% or more of an organization's capital.

Profiled Load Assets include all Load Assets that are not directly metered by OP-18 compliant metering as currently described in Section IV (Metering and Recording for Settlements) of OP18, and some Load Assets that are measured by OP-18 compliant metering (as currently described in Section IV of OP-18) to which the Host Participant Assigned Meter Reader allocates non-PTF losses.

Project Sponsor is an entity seeking to have a New Generating Capacity Resource or New Demand Resource participate in the Forward Capacity Market, as described in Section III.13.

Provisional Member is defined in Section I.68A of the Restated NEPOOL Agreement.

PTO Administrative Committee is the committee referred to in Section 11.04 of the TOA.

Publicly Owned Entity is defined in Section I of the Restated NEPOOL Agreement.

Qualification Process Cost Reimbursement Deposit is described in Section III.13.1.9.3 of Market Rule 1.

Qualified Capacity is the amount of capacity a resource may provide in the summer or winter in a Capacity Commitment Period, as determined in the Forward Capacity Market qualification processes.

Qualified Generator Reactive Resource(s) is any generator source of dynamic reactive power that meets the criteria specified in Schedule 2 of the OATT.

Qualified Non-Generator Reactive Resource(s) is any non-generator source of dynamic reactive power that meets the criteria specified in Schedule 2 of the OATT.

Qualified Reactive Resource(s) is any Qualified Generator Reactive Resource and/or Qualified Non-Generator Reactive Resource that meets the criteria specified in Schedule 2 of the OATT.

Queue Position has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Rated means a Market Participant that receives a credit rating from one or more of the Rating Agencies, or, if such Market Participant is not rated by one of the Rating Agencies, then a Market Participant that has outstanding unsecured debt rated by one or more of the Rating Agencies.

Rating Agencies are Standard and Poor's (S&P), Moody's, and Fitch.

RBA Decision is a written decision provided by the ISO to a Disputing Party and to the Chair of the NEPOOL Budget and Finance Subcommittee accepting or denying a Requested Billing Adjustment within twenty Business Days of the date the ISO distributes a Notice of RBA, unless some later date is agreed upon by the Disputing Party and the ISO.

Reactive Supply and Voltage Control Service is the form of Ancillary Service described in Schedule 2 of the OATT.

Real-Time is a period in the current Operating Day for which the ISO dispatches Resources for energy and Regulation, designates Resources for Regulation and Operating Reserve and, if necessary, commits additional Resources.

Real-Time Adjusted Load Obligation is defined in Section III.3.2.1(b)(iii) of Market Rule 1.

Real-Time Adjusted Load Obligation Deviation is defined in Section III.3.2.1(c)(iii) of Market Rule 1.

Real-Time Commitment Periods are periods of continuous operation bounded by a start up and the earlier to occur of a shut-down or a unit trip used to determine eligibility for Real Time NCPC Credit.

Real-Time Congestion Revenue is defined in Section III.3.2.1(f) of Market Rule 1.

Real-Time Demand Reduction Obligation is a Real-Time demand reduction amount determined pursuant to Section III.E1.8 for Capacity Commitment Periods commencing prior to June 1, 2017, and Section III.E2.7 for Capacity Commitment Periods commencing on or after June 1, 2017.

Real-Time Demand Resource Dispatch Hours means those hours, or portions thereof, in which ISO New England Operating Procedure No. 4 is implemented and the ISO has begun to allow the depletion of Thirty-Minute Operating Reserve on a Dispatch Zone, Load Zone, or system-wide basis, and the ISO notifies the Market Participants with Real-Time Demand Response Resources of such hours.

Real-Time Demand Response Asset means one or more individual end-use metered customers that are located at a single Node, report load reduction and consumption, or generator output as a single set of values, are assigned a unique asset identification number by the ISO, and that participate in the Forward Capacity Market as part of a Market Participant's Real-Time Demand Response Resource.

Real-Time Demand Response Event Hours means hours when the ISO dispatches Real-Time Demand Response Resources in response to Real-Time Demand Resource Dispatch Hours, which may include Dispatch Zone, Load Zone, or system-wide dispatch of such resources.

Real-Time Demand Response Resource is a type of Demand Resource that is comprised of installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that: (i) curtail electrical usage in response to a Dispatch Instruction; and (ii) continue curtailing electrical usage until receiving Dispatch Instructions to restore electrical usage. Such measures include Load Management and Distributed Generation. The period of curtailment shall be consistent with Real-Time Demand Response Event Hours.

Real-Time Emergency Generation Asset means one or more individual end-use metered customers that are located at a single Node, report load reduction and consumption, or generator output as a single set of values, are assigned a unique asset identification number by the ISO, and that participate in the Forward Capacity Market as part of a Market Participant's Real-Time Emergency Generation Resource.

Real-Time Emergency Generation Event Hours means those hours, or portions thereof, between 7 a.m. and 7 p.m. Monday through Friday, non-Demand Response Holidays in which the ISO dispatches Real-Time Emergency Generation Resources on a Dispatch Zone, Load Zone, or system-wide basis when deficient in Thirty-Minute Operating Reserve and when the ISO implements voltage reductions of five percent of normal operating voltage that require more than 10 minutes to implement.

Real-Time Emergency Generation Resource is Distributed Generation whose federal, state and/or local air quality permits, rules or regulations limit operation in response to requests from the ISO to the times when the ISO implements voltage reductions of five percent of normal operating voltage that require more than 10 minutes to implement. A Real-Time Emergency Generation Resource must be capable of: (i) curtailing its end-use electric consumption from the New England grid within 30 minutes of receiving a Dispatch Instruction; and (ii) continuing that curtailment until receiving a Dispatch Instruction to restore consumption.

Real-Time Energy Market means the purchase or sale of energy, purchase of demand reductions pursuant to Appendix III.E2 of Market Rule 1, payment of Congestion Costs, and payment for losses for quantity deviations from the Day-Ahead Energy Market in the Operating Day and designation of and payment for provision of Operating Reserve in Real-Time.

Real-Time Energy Market Deviation Congestion Charge/Credit is defined in Section III.3.2.1(e) of Market Rule 1.

Real-Time Energy Market Deviation Energy Charge/Credit is defined in Section III.3.2.1(e) of Market Rule 1.

Real-Time Energy Market Deviation Loss Charge/Credit is defined in Section III.3.2.1(e) of Market Rule 1.

Real-Time Generation Obligation is defined in Section III.3.2.1(b)(ii) of Market Rule 1.

Real-Time Generation Obligation Deviation is defined in Section III.3.2.1(c)(ii) of Market Rule 1.

Real-Time High Operating Limit is the maximum output, in MW, of a resource that could be achieved, consistent with Good Utility Practice, in response to an ISO request for Energy under Section III.13.6.4 of Market Rule 1, for each hour of the Operating Day, as reflected in the resource's Offer Data. This value is based on real-time operating conditions and the physical operating characteristics and operating permits of the unit.

Real-Time Load Obligation is defined in Section III.3.2.1(b)(i) of Market Rule 1.

Real-Time Load Obligation Deviation is defined in Section III.3.2.1(c)(i) of Market Rule 1.

Real-Time Locational Adjusted Net Interchange is defined in Section III.3.2.1(b)(iv) of Market Rule 1.

Real-Time Locational Adjusted Net Interchange Deviation is defined in Section III.3.2.1(c)(iv) of Market Rule 1.

Real-Time Loss Revenue is defined in Section III.3.2.1(i) of Market Rule 1.

Real-Time Loss Revenue Charges or Credits are defined in Section III.3.2.1(m) of Market Rule 1.

Real-Time NCP Load Obligation is the maximum hourly value, during a month, of a Market Participant's Real-Time Load Obligation summed over all Locations, excluding exports, in kilowatts.

Real-Time Price Response Program is the program described in Appendix E to Market Rule 1.

Real-Time Prices means the Locational Marginal Prices resulting from the ISO's dispatch of the New England Markets in the Operating Day.

Real-Time Reserve Charge is a Market Participant's share of applicable system and Reserve Zone Real-Time Operating Reserve costs attributable to meeting the Real-Time Operating Reserve requirement as calculated in accordance with Section III.10 of Market Rule 1.

Real-Time Reserve Clearing Price is the Real-Time TMSR, TMNSR or TMOR clearing price, as applicable, for the system and each Reserve Zone that is calculated in accordance with Section III.2.4 of Market Rule 1.

Real-Time Reserve Credit is a Market Participant's compensation associated with that Market Participant's Resources' Real-Time Reserve Designation as calculated in accordance with Section III.10 of Market Rule 1.

Real-Time Reserve Designation is the amount, in MW, of Operating Reserve designated to a Resource in Real-Time by the ISO as adjusted after-the-fact utilizing revenue quality meter data as described under Section III.10 of Market Rule 1.

Real-Time Reserve Opportunity Cost is defined in Section III.2.7A(b) of Market Rule 1.

Real-Time System Adjusted Net Interchange means, for each hour, the sum of Real-Time Locational Adjusted Net Interchange for a Market Participant over all Locations, in kilowatts.

Receiving Party is the entity receiving the capacity and/or energy transmitted to Point(s) of Delivery under the OATT.

Reference Level is defined in Section III.A.5.6.1 of Appendix A of Market Rule 1.

Regional Benefit Upgrade(s) (RBU) means a Transmission Upgrade that: (i) is rated 115kV or above; (ii) meets all of the non-voltage criteria for PTF classification specified in the OATT; and (iii) is included in the Regional System Plan as either a Reliability Transmission Upgrade or an Market Efficiency Transmission Upgrade identified as needed pursuant to Attachment K of the OATT. The category of RBU shall not include any Transmission Upgrade that has been categorized under any of the other categories specified in Schedule 12 of the OATT (e.g., an Elective Transmission Upgrade shall not also be categorized as an RBU). Any upgrades to transmission facilities rated below 115kV that were PTF prior to January 1, 2004 shall remain classified as PTF and be categorized as an RBU if, and for so long as, such upgrades meet the criteria for PTF specified in the OATT.

Regional Network Load is the load that a Network Customer designates for Regional Network Service under Part II.B of the OATT. The Network Customer's Regional Network Load shall include all load designated by the Network Customer (including losses) and shall not be credited or reduced for any behind-the-meter generation. A Network Customer may elect to designate less than its total load as Regional Network Load but may not designate only part of the load at a discrete Point of Delivery. Where a Transmission Customer has elected not to designate a particular load at discrete Points of Delivery as Regional Network Load, the Transmission Customer is responsible for making separate arrangements under Part II.C of the OATT for any Point-To-Point Service that may be necessary for such non-designated load.

Regional Network Service (RNS) is the transmission service over the PTF described in Part II.B of the OATT, including such service which is used with respect to Network Resources or Regional Network Load that is not physically interconnected with the PTF.

Regional Planning Dispute Resolution Process is described in Section 12 of Attachment K to the OATT.

Regional System Plan (RSP) is the plan developed under the process specified in Attachment K of the OATT.

Regional Transmission Service (RTS) is Regional Network Service and Through or Out Service as provided over the PTF in accordance with Section II.B, Section II.C, Schedule 8 and Schedule 9 of the OATT.

Regulation is the capability of a specific generating unit with appropriate telecommunications, control and response capability to increase or decrease its output in response to a regulating control signal, in accordance with the specifications in the ISO New England Manuals and ISO New England Administrative Procedures.

Regulation and Frequency Response Service is the form of Ancillary Service described in Schedule 3 of the OATT. The capability of performing Regulation and Frequency Response Service is referred to as automatic generation control (AGC).

Regulation Capability (REGCAP) means the amount of Regulation capability available on a Market Participant's Resource as calculated by the ISO based upon that Resource's Automatic Response Rate and the available regulating range as specified in ISO New England Manual 11 – Market Operations.

Regulation Clearing Price is defined in Section III.3.2.2(e) of Market Rule 1.

Regulation High Limit is the maximum amount of energy that a generating unit can reliably produce when that unit is providing Regulation. The Regulation High Limit may be less than or equal to the unit's Economic Maximum Limit.

Regulation Low Limit is the minimum amount of energy that a generating unit can reliably produce when that unit is providing Regulation. The Regulation Low Limit may be greater than or equal to the unit's Economic Minimum Limit.

Regulation Opportunity Cost is defined in Section III.3.2.2(i) of Market Rule 1.

Regulation Rank Price is calculated in accordance with Section III.1.11.5(b) of Market Rule 1.

Regulation Requirement is the hourly amount of Regulation MWs required by the ISO to maintain system control and reliability as calculated and posted on the ISO website.

Regulation Service Credit is the credit associated with provision of Regulation Service Megawatts and is calculated in accordance with Section III.3.2.2(c) of Market Rule 1.

Regulation Service Megawatts are calculated in accordance with Section III.3.2.2(f) of Market Rule 1.

Related Person is defined pursuant to Section 1.1 of the Participants Agreement.

Related Transaction is defined in Section III.1.4.3 of Market Rule 1.

Reliability Administration Service (RAS) is the service provided by the ISO, as described in Schedule 3 of Section IV.A of the Tariff, in order to administer the Reliability Markets and provide other reliability-related and informational functions.

Reliability Committee is the committee whose responsibilities are specified in Section 8.2.3 of the Participants Agreement.

Reliability Markets are, collectively, the ISO's administration of Regulation, the Forward Capacity Market, and Operating Reserve.

Reliability Region means any one of the regions identified on the ISO's website. Reliability Regions are intended to reflect the operating characteristics of, and the major transmission constraints on, the New England Transmission System.

Reliability Transmission Upgrade means those additions and upgrades not required by the interconnection of a generator that are nonetheless necessary to ensure the continued reliability of the New England Transmission System, taking into account load growth and known resource changes, and include those upgrades necessary to provide acceptable stability response, short circuit capability and system voltage levels, and those facilities required to provide adequate thermal capability and local

voltage levels that cannot otherwise be achieved with reasonable assumptions for certain amounts of generation being unavailable (due to maintenance or forced outages) for purposes of long-term planning studies. Good Utility Practice, applicable reliability principles, guidelines, criteria, rules, procedures and standards of ERO and NPCC and any of their successors, applicable publicly available local reliability criteria, and the ISO System Rules, as they may be amended from time to time, will be used to define the system facilities required to maintain reliability in evaluating proposed Reliability Transmission Upgrades. A Reliability Transmission Upgrade may provide market efficiency benefits as well as reliability benefits to the New England Transmission System.

Remittance Advice is an issuance from the ISO for the net Payment owed to a Covered Entity where a Covered Entity's total Payments exceed its total Charges in a billing period.

Remittance Advice Date is the day on which the ISO issues a Remittance Advice.

Renewable Technology Resource is a Generating Capacity Resource that satisfies the requirements specified in Section III.13.1.1.1.7.

Re-Offer Period is the period that normally occurs between the posting of the of the Day-Ahead Energy Market results and 2:00 p.m. on the day before the Operating Day during which a Market Participant may submit revised Supply Offers, revised External Transactions, or revised Demand Bids associated with Dispatchable Asset Related Demands or, for Capacity Commitment Periods commencing on or after June 1, 2017, revised Demand Reduction Offers associated with Demand Response Resources.

Replacement Reserve is described in Part III, Section VII of ISO New England Operating Procedure No. 8.

Request for Alternative Proposals (RFAP) is the request described in Attachment K of the OATT.

Requested Billing Adjustment (RBA) is defined in Section 6.1 of the ISO New England Billing Policy.

Required Balance is an amount as defined in Section 5.3 of the Billing Policy.

Reseller is a MGTTSA holder that sells, assigns or transfers its rights under its MGTTSA, as described in Section II.45.1(a) of the OATT.

Reserve Constraint Penalty Factors (RCPFs) are rates, in \$/MWh, that are used within the Real-Time dispatch and pricing algorithm to reflect the value of Operating Reserve shortages and are defined in Section III.2.7A(c) of Market Rule 1.

Reserve Zone is defined in Section III.2.7 of Market Rule 1.

Reserved Capacity is the maximum amount of capacity and energy that is committed to the Transmission Customer for transmission over the New England Transmission System between the Point(s) of Receipt and the Point(s) of Delivery under Part II.C or Schedule 18, 20 or 21 of the OATT, as applicable. Reserved Capacity shall be expressed in terms of whole kilowatts on a sixty-minute interval (commencing on the clock hour) basis, or, in the case of Reserved Capacity for Local Point-to-Point Service, in terms of whole megawatts on a sixty-minute interval basis.

Resource means a generating unit, a Dispatchable Asset Related Demand, an External Resource or an External Transaction or, for Capacity Commitment Periods commencing on or after June 1, 2017, a Demand Response Resource.

Restated New England Power Pool Agreement (RNA) is the Second Restated New England Power Pool Agreement, which restated for a second time by an amendment dated as of August 16, 2004 the New England Power Pool Agreement dated September 1, 1971, as the same may be amended and restated from time to time, governing the relationship among the NEPOOL members.

Rest-of-Pool Capacity Zone is a single Capacity Zone made up of the adjacent Load Zones that are neither export-constrained nor import-constrained.

Rest of System is an area established under Section III.2.7(d) of Market Rule 1.

Retail Delivery Point is the point on the transmission or distribution system at which the load of an end-use facility, which is metered and assigned a unique account number by the Host Participant, is measured to determine the amount of energy delivered to the facility from the transmission and distribution system. If an end-use facility is connected to the transmission or distribution system at more than one location, the Retail Delivery Point shall consist of the metered load at each connection point, summed to measure the net energy delivered to the facility in each interval.

Returning Market Participant is a Market Participant, other than an FTR-Only Customer or a Governance Only Member, whose previous membership as a Market Participant was involuntarily terminated due to a Financial Assurance Default or a payment default and, since returning, has been a Market Participant for less than six consecutive months.

Revenue Requirement is defined in Section IV.A.2.1 of the Tariff.

Reviewable Action is defined in Section III.D.1.1 of Appendix D of Market Rule 1.

Reviewable Determination is defined in Section 12.4(a) of Attachment K to the OATT.

RSP Project List is defined in Section 1 of Attachment K to the OATT.

RTEP02 Upgrade(s) means a Transmission Upgrade that was included in the annual NEPOOL Transmission Plan (also known as the “Regional Transmission Expansion Plan” or “RTEP”) for the year 2002, as approved by ISO New England Inc.’s Board of Directors, or the functional equivalent of such Transmission Upgrade, as determined by ISO New England Inc. The RTEP02 Upgrades are listed in Schedule 12B of the OATT.

RTO is a regional transmission organization or comparable independent transmission organization that complies with Order No. 2000 and the Commission’s corresponding regulation.

Same Reserve Zone Export Transaction is defined in Section III.1.10.7(f)(iii) of Market Rule 1.

Sanctionable Behavior is defined in Section III.B.3 of Appendix B of Market Rule 1.

Schedule, Schedules, Schedule 1, 2, 3, 4 and 5 are references to the individual or collective schedules to Section IV.A. of the Tariff.

Schedule 20A Service Provider (SSP) is defined in Schedule 20A to Section II of this Tariff.

Scheduling Service, for purposes of Section IV.A and Section IV.B of the Tariff, is the service described in Schedule 1 to Section IV.A of the Tariff.

Scheduling, System Control and Dispatch Service, for purposes of Section II of the Tariff, is the form of Ancillary Service described in Schedule 1 of the OATT.

Seasonal Claimed Capability is the summer or winter claimed capability of a generating unit or ISO-approved combination of units, and represent the maximum dependable load carrying ability of such unit or units, excluding capacity required for station use.

Seasonal Claimed Capability Audit is the audit performed pursuant to Section III.1.5.1.3.

Seasonal DR Audit is a seasonal audit of the demand response capability of a Demand Resource initiated pursuant to Section III.13.6.1.5.4.1.

Seasonal Peak Demand Resource is a type of Demand Resource and shall mean installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that reduce the total amount of electrical energy consumed during Demand Resource Seasonal Peak Hours, while delivering a comparable or acceptable level of end-use service. Such measures include Energy Efficiency, Load Management, and Distributed Generation.

Section III.1.4 Transactions are defined in Section III.1.4.2 of Market Rule 1.

Section III.1.4 Conforming Transactions are defined in Section III.1.4.2 of Market Rule 1.

Security Agreement is Attachment 1 to the ISO New England Financial Assurance Policy.

Self-Schedule is the action of a Market Participant in committing and/or scheduling its Resource, in accordance with applicable ISO New England Manuals, to provide service in an hour, whether or not in the absence of that action the Resource would have been scheduled or dispatched by the ISO to provide the service. Demand Response Resources are not permitted to Self-Schedule.

Self-Scheduled MW is an amount, in megawatts, that is Self-Scheduled and is equal to the greater of: (i) the Resource's Economic Minimum Limit; or (ii) the Resource's Minimum Consumption Limit; or (iii) for a generating Resource for which the Regulation Self-Schedule flag is set for the hour and the unit was

on Regulation for at least 20 minutes during the applicable hour of the Operating Day, the median value of all Regulation setpoints (Desired Dispatch Point) used by the Resource while regulating.

Self-Supplied FCA Resource is described in Section III.13.1.6 of Market Rule 1.

Senior Officer means an officer of the subject entity with the title of vice president (or similar office) or higher, or another officer designated in writing to the ISO by that office.

Service Agreement is a Transmission Service Agreement or an MPSA.

Service Commencement Date is the date service is to begin pursuant to the terms of an executed Service Agreement, or the date service begins in accordance with the sections of the OATT addressing the filing of unexecuted Service Agreements.

Services means, collectively, the Scheduling Service, EAS and RAS; individually, a Service.

Settlement Financial Assurance is an amount of financial assurance required from a Designated FTR Participant awarded a bid in an FTR Auction. This amount is calculated pursuant to Section VI.D of the ISO New England Financial Assurance Policy.

Settlement Only Resources are generators of less than 5 MW or otherwise eligible for Settlement Only Resource treatment as described in ISO New England Operating Procedure No. 14 and that have elected Settlement Only Resource treatment as described in the ISO New England Manual for Registration and Performance Auditing.

Seven-Day Forecast has the meaning specified in Section III.H.3.3(a).

Shortage Event is defined in Section III.13.7.1.1.1 of Market Rule 1.

Shortage Event Availability Score is the average of the hourly availability scores for each hour or portion of an hour during a Shortage Event, as described in Section III.13.7.1.1.1.A of Market Rule 1.

Shortfall Funding Arrangement, as specified in Section 5.1 of the ISO New England Billing Policy, is a separate financing arrangement that can be used to make up any non-congestion related differences between amounts received on Invoices and amounts due for ISO Charges in any bill issued.

Short-Term is a period of less than one year.

Significantly Reduced Congestion Costs are defined in Section III.G.2.2 of Appendix G to Market Rule 1.

SMD Effective Date is March 1, 2003.

Solutions Study is described in Section 4.2(b) of Attachment K to the OATT.

Special Constraint Resource (SCR) is a Resource that provides Special Constraint Resource Service under Schedule 19 of the OATT.

Special Constraint Resource Service is the form of Ancillary Service described in Schedule 19 of the OATT.

Specified-Term Blackstart Capital Payment is the annual compensation level, as calculated pursuant to Section 5.1 of Schedule 16 of the OATT, for a Designated Blackstart Resource's capital Blackstart Equipment costs associated with the provision of Blackstart Service (except for capital costs associated with adhering to NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Standard Blackstart Capital Payment is the annual compensation level, as calculated pursuant to Section 5.1 of Schedule 16 of the OATT, for a Designated Blackstart Resource's capital Blackstart Equipment costs associated with the provision of Blackstart Service (except for capital costs associated with adhering to NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Start-of-Round Price is the highest price associated with a round of a Forward Capacity Auction as described in Section III.13.2.3.1 of Market Rule 1.

Start-Up Fee is the amount, in dollars, that must be paid for a generating unit to Market Participants with an Ownership Share in the unit each time the unit is scheduled in the New England Markets to start-up.

Start-Up Time is the time it takes the Generator Asset, after synchronizing to the system, to reach its Economic Minimum Limit and, for dispatchable Generator Assets, be ready for further dispatch by the ISO.

State Estimator means the computer model of power flows specified in Section III.2.3 of Market Rule 1.

Statements, for the purpose of the ISO New England Billing Policy, refer to both Invoices and Remittance Advices.

Static De-List Bid is a bid that may be submitted by an Existing Generating Capacity Resource, Existing Import Capacity Resource, or Existing Demand Resource in the Forward Capacity Auction to remove itself from the capacity market for a one year period, as described in Section III.13.1.2.3.1.1 of Market Rule 1.

Station is one or more Existing Generating Capacity Resources consisting of one or more assets located within a common property boundary.

Station Going Forward Common Costs are the net risk-adjusted going forward costs associated with a Station that are avoided only by (1) the clearing of the Static De-List Bids or the Permanent De-List Bids of all the Existing Generating Capacity Resources comprising the Station; or (2) the acceptance of a Non-Price Retirement Request of the Station, calculated in the same manner as the net-risk adjusted going forward costs of Existing Generating Capacity Resources as described in Section III.13.1.2.3.2.1.2.

Station-level Blackstart O&M Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Station-level Specified-Term Blackstart Capital Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Station-level Standard Blackstart Capital Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Successful FCA is a Forward Capacity Auction in which a Capacity Zone has neither Inadequate Supply nor Insufficient Competition.

Summer ARA Qualified Capacity is described in Section III.13.4.2.1.2.1.1.1 of Market Rule 1.

Summer Capability Period means one of two time periods defined by the ISO for the purposes of rating and auditing resources. The time period associated with the Summer Capability Period is the period of June 1 through September 30.

Summer Intermittent Reliability Hours are defined in Section III.13.1.2.2.2.1(c) of Market Rule 1.

Supplemental Availability Bilateral is described in Section III.13.5.3.2 of Market Rule 1.

Supplemental Capacity Resources are described in Section III.13.5.3.1 of Market Rule 1.

Supplemented Capacity Resource is described in Section III.13.5.3.2 of Market Rule 1.

Supply Offer is a proposal to furnish energy at a Node or Regulation from a Resource that meets the applicable requirements set forth in the ISO New England Manuals submitted to the ISO by a Market Participant with authority to submit a Supply Offer for the Resource. The Supply Offer will be submitted pursuant to Market Rule 1 and applicable ISO New England Manuals, and include a price and information with respect to the quantity proposed to be furnished, technical parameters for the Resource, timing and other matters. A Supply Offer is a subset of the information required in a Market Participant's Offer Data.

Supply Offer Block-Hours are Block-Hours assigned to the Lead Market Participant for each Supply Offer. The daily bid Blocks in the price-based Real-Time offer/bid will be multiplied by the number of hours in the day to determine the quantity of Supply Offer Block-Hours for a given day. In the case that a Resource has a Real-Time unit status of "unavailable" for the entire day, that day will not contribute to the quantity of Supply Offer Block-Hours. However, if the Resource has at least one hour of the day with a unit status of "available," the entire day will contribute to the quantity of Supply Offer Block-Hours.

Synchronous Condenser is a generator that is synchronized to the grid but supplying no energy for the purpose of providing Operating Reserve or VAR or voltage support.

System Condition is a specified condition on the New England Transmission System or on a neighboring system, such as a constrained transmission element or flowgate, that may trigger Curtailment of Long-Term Firm MTF or OTF Service on the MTF or the OTF using the curtailment priority pursuant to Section II.44 of the Tariff or Curtailment of Local Long-Term Firm Point-to-Point Transmission Service on the non-PTF using the curtailment priority pursuant to Schedule 21 of the Tariff. Such conditions must be identified in the Transmission Customer's Service Agreement.

System Impact Study is an assessment pursuant to Part II.B, II.C, II.G, Schedule 21, Schedule 22, or Schedule 23 of the OATT of (i) the adequacy of the PTF or Non-PTF to accommodate a request for the interconnection of a new or materially changed generating unit or a new or materially changed interconnection to another Control Area or new Regional Network Service or new Local Service or an Elective Transmission Upgrade, and (ii) whether any additional costs may be required to be incurred in order to provide the interconnection or transmission service.

System Operator shall mean ISO New England Inc. or a successor organization.

System-Wide Capacity Demand Curve is the demand curve used in the Forward Capacity Market as specified in Section III.13.2.2.

TADO is the total amount due and owing (not including any amounts due under Section 14.1 of the RNA) at such time to the ISO, NEPOOL, the PTOs, the Market Participants and the Non-Market Participant Transmission Customers, by all PTOs, Market Participants and Non-Market Participant Transmission Customers.

Tangible Net Worth is the value, determined in accordance with international accounting standards or generally accepted accounting principles in the United States, of all of that entity's assets less the following: (i) assets the ISO reasonably believes to be restricted or potentially unavailable to settle a claim in the event of a default (e.g., regulatory assets, restricted assets, and Affiliate assets), net of any matching liabilities, to the extent that the result of that netting is a positive value; (ii) derivative assets, net of any matching liabilities, to the extent that the result of that netting is a positive value; (iii) the amount at which the liabilities of the entity would be shown on a balance sheet in accordance with international

accounting standards or generally accepted accounting principles in the United States; (iv) preferred stock; (v) non-controlling interest; and (vi) all of that entity's intangible assets (e.g., patents, trademarks, franchises, intellectual property, goodwill and any other assets not having a physical existence), in each case as shown on the most recent financial statements provided by such entity to the ISO.

Technical Committee is defined in Section 8.2 of the Participants Agreement.

Ten-Minute Non-Spinning Reserve (TMNSR) is the reserve capability of a generating unit that can be converted fully into energy within ten minutes from the request of the ISO, and is provided by generating units that are either electrically synchronized or not electrically synchronized to the New England Transmission System or the reserve capability of a Dispatchable Asset Related Demand that can be fully utilized within ten minutes from the request of the ISO to reduce consumption.

Ten-Minute Non-Spinning Reserve Service is the form of Ancillary Service described in Schedule 6 of the OATT.

Ten-Minute Spinning Reserve (TMSR) is the reserve capability of a generating unit that can be converted fully into energy within ten minutes from the request of the ISO or a Dispatchable Asset Related Demand pump that can reduce energy consumption to provide reserve capability within ten minutes from the request of the ISO, and is provided by generating units and Dispatchable Asset Related Demand pumps electrically synchronized to the New England Transmission System.

Ten-Minute Spinning Reserve Service is the form of Ancillary Service described in Schedule 5 of the OATT.

Third-Party Sale is any sale for resale in interstate commerce to a Power Purchaser that is not designated as part of Regional Network Load or Local Network Load under the Regional Network Service or Local Network Service, as applicable.

Thirty-Minute Operating Reserve (TMOR) means the reserve capability of a generating unit that can be converted fully into energy within thirty minutes from the request of the ISO, and is provided by generating units that are either not electrically synchronized or synchronized to the New England Transmission System or the reserve capability of a Dispatchable Asset Related Demand that can be fully utilized within thirty minutes from the request of the ISO to reduce consumption.

Thirty-Minute Operating Reserve Service is the form of Ancillary Service described in Schedule 7 of the OATT.

Through or Out Rate (TOUT Rate) is the rate per hour for Through or Out Service, as defined in Section II.25.2 of the OATT.

Through or Out Service (TOUT Service) means Point-To-Point Service over the PTF provided by the ISO with respect to a transaction that goes through the New England Control Area, as, for example, a single transaction where energy or capacity is transmitted into the New England Control Area from New Brunswick and subsequently out of the New England Control Area to New York, or a single transaction where energy or capacity is transmitted into the New England Control Area from New York through one point on the PTF and subsequently flows over the PTF prior to passing out of the New England Control Area to New York, or with respect to a transaction which originates at a point on the PTF and flows over the PTF prior to passing out of the New England Control Area, as, for example, from Boston to New York.

Tie-Line Asset is a physical transmission tie-line, or an inter-state or intra-state border arrangement created according to the ISO New England Manuals and registered in accordance with the Asset Registration Process.

Time-on-Regulation Credit is the credit associated with provision of Time-on-Regulation Megawatts and is calculated in accordance with Section III.3.2.2(b) of Market Rule 1.

Time-on-Regulation Megawatts is the amount of Regulation capability provided during one hour calculated in accordance with Section III.3.2.2(g) of Market Rule 1.

Total Available Amount is the sum of the available amount of the Shortfall Funding Arrangement and the balance in the Payment Default Shortfall Fund.

Total Blackstart Capital Payment is the annual compensation calculated under either Section 5.1 or Section 5.2 of Schedule 16 of the OATT, as applicable.

Total Blackstart O&M Payment is the annual compensation calculated under either Section 5.1 or 5.2 of Schedule 16 of the OATT, as applicable.

Total Blackstart Service Payments is monthly compensation to Blackstart Owners or Market Participants, as applicable, and as calculated pursuant to Section 5.6 of Schedule 16 to the OATT.

Total Negative Hourly Demand Response Resource Deviation means the absolute value of the sum of the negative Hourly Real-Time Demand Response Resource Deviations and negative Hourly Real-Time Emergency Generation Deviations from all Real-Time Demand Response Resources and Real-Time Emergency Generation Resources receiving Dispatch Instructions in the same hour in the same Dispatch Zone.

Total Positive Hourly Demand Response Resource Deviation means the sum of the positive Hourly Real-Time Demand Response Resource Deviations and positive Hourly Real-Time Emergency Generation Deviations from all Real-Time Demand Response Resources and Real-Time Emergency Generation Resources receiving Dispatch Instructions in the same hour in the same Dispatch Zone.

Total System Capacity is the aggregate capacity supply curve for the New England Control Area as determined in accordance with Section III.13.2.3.3 of Market Rule 1.

Transaction Unit (TU) is a type of billing determinant under Schedule 2 of Section IV.A of the Tariff used to assess charges to Customers.

Transition Period: The six-year period commencing on March 1, 1997.

Transmission Charges, for the purposes of the ISO New England Financial Assurance Policy and the ISO New England Billing Policy, are all charges and payments under Schedules 1, 8 and 9 of the OATT.

Transmission Congestion Credit means the allocated share of total Transmission Congestion Revenue credited to each holder of Financial Transmission Rights, calculated and allocated as specified in Section III.5.2 of Market Rule 1.

Transmission Congestion Revenue is defined in Section III.5.2.5(a) of Market Rule 1.

Transmission Credit Limit is a credit limit, not to be used to meet FTR Requirements, established for each Market Participant in accordance with Section II.D and each Non-Market Participant Transmission Customer in accordance with Section V.B.2 of the ISO New England Financial Assurance Policy.

Transmission Credit Test Percentage is calculated in accordance with Section III.B.1(c) of the ISO New England Financial Assurance Policy.

Transmission Customer is any Eligible Customer that (i) executes, on its own behalf or through its Designated Agent, an MPSA or TSA, or (ii) requests in writing, on its own behalf or through its Designated Agent, that the ISO, the Transmission Owner, or the Schedule 20A Service Provider, as applicable, file with the Commission, a proposed unexecuted MPSA or TSA containing terms and conditions deemed appropriate by the ISO (in consultation with the applicable PTO, OTO or Schedule 20A Service Provider) in order that the Eligible Customer may receive transmission service under Section II of this Tariff. A Transmission Customer under Section II of this Tariff includes a Market Participant or a Non-Market Participant taking Regional Network Service, Through or Out Service, MTF Service, OTF Service, Ancillary Services, or Local Service.

Transmission Default Amount is all or any part of any amount of Transmission Charges due to be paid by any Covered Entity that the ISO, in its reasonable opinion, believes will not or has not been paid when due.

Transmission Default Period is defined in Section 3.4.f of the ISO New England Billing Policy.

Transmission Late Payment Account is defined in Section 4.2 of the ISO New England Billing Policy.

Transmission Late Payment Account Limit is defined in Section 4.2 of the ISO New England Billing Policy.

Transmission Late Payment Charge is defined in Section 4.1 of the ISO New England Billing Policy.

Transmission, Markets and Services Tariff (Tariff) is the ISO New England Inc. Transmission, Markets and Services Tariff, as amended from time to time.

Transmission Obligations are determined in accordance with Section III.A(vi) of the ISO New England Financial Assurance Policy.

Transmission Operating Agreement (TOA) is the Transmission Operating Agreement between and among the ISO and the PTOs, as amended and restated from time to time.

Transmission Owner means a PTO, MTO or OTO.

Transmission Provider is the ISO for Regional Network Service and Through or Out Service as provided under Section II.B and II.C of the OATT; Cross-Sound Cable, LLC for Merchant Transmission Service as provided under Schedule 18 of the OATT; the Schedule 20A Service Providers for Phase I/II HVDC-TF Service as provided under Schedule 20A of the OATT; and the Participating Transmission Owners for Local Service as provided under Schedule 21 of the OATT.

Transmission Requirements are determined in accordance with Section III.A(iii) of the ISO New England Financial Assurance Policy.

Transmission Security Analysis Requirement shall be determined pursuant to Section III.12.2.1.2.

Transmission Service Agreement (TSA) is the initial agreement and any amendments or supplements thereto: (A) in the form specified in either Attachment A or B to the OATT, entered into by the Transmission Customer and the ISO for Regional Network Service or Through or Out Service; (B) entered into by the Transmission Customer with the ISO and PTO in the form specified in Attachment A to Schedule 21 of the OATT; (C) entered into by the Transmission Customer with an OTO or Schedule 20A Service Provider in the appropriate form specified under Schedule 20 of the OATT; or (D) entered into by the Transmission Customer with a MTO in the appropriate form specified under Schedule 18 of the OATT. A Transmission Service Agreement shall be required for Local Service, MTF Service and OTF Service, and shall be required for Regional Network Service and Through or Out Service if the Transmission Customer has not executed a MPSA.

Transmission Upgrade(s) means an upgrade, modification or addition to the PTF that becomes subject to the terms and conditions of the OATT governing rates and service on the PTF on or after January 1, 2004. This categorization and cost allocation of Transmission Upgrades shall be as provided for in Schedule 12 of the OATT.

UDS is unit dispatch system software.

Unconstrained Export Transaction is defined in Section III.1.10.7(f)(iv) of Market Rule 1.

Uncovered Default Amount is defined in Section 3.3(i) of the ISO New England Billing Policy.

Uncovered Transmission Default Amounts are defined in Section 3.4.f of the ISO New England Billing Policy.

Unrated means a Market Participant that is not a Rated Market Participant.

Unsecured Covered Entity is, collectively, an Unsecured Municipal Market Participant and an Unsecured Non-Municipal Covered Entity.

Unsecured Municipal Default Amount is defined in Section 3.3(i) of the ISO New England Billing Policy.

Unsecured Municipal Market Participant is defined in Section 3.3(h) of the ISO New England Billing Policy.

Unsecured Municipal Transmission Default Amount is defined in Section 3.4.f of the ISO New England Billing Policy.

Unsecured Non-Municipal Covered Entity is a Covered Entity that is not a Municipal Market Participant or a Non-Market Participant Transmission Customer and has a Market Credit Limit or Transmission Credit Limit of greater than \$0 under the ISO New England Financial Assurance Policy.

Unsecured Non-Municipal Default Amount is defined in Section 3.3(i) of the ISO New England Billing Policy.

Unsecured Non-Municipal Transmission Default Amount is defined in Section 3.3(i) of the ISO New England Billing Policy.

Unsecured Transmission Default Amounts are, collectively, the Unsecured Municipal Transmission Default Amount and the Unsecured Non-Municipal Transmission Default Amount.

Updated Measurement and Verification Plan is an optional Measurement and Verification Plan that may be submitted as part of a subsequent qualification process for a Forward Capacity Auction prior to the beginning of the Capacity Commitment Period of the Demand Resource project. The Updated Measurement and Verification Plan may include updated Demand Resource project specifications, measurement and verification protocols, and performance data as described in Section III.13.1.4.3.1.2 of Market Rule 1 and the ISO New England Manuals.

VAR CC Rate is the CC rate paid to Qualified Reactive Resources for VAR Service capability under Section IV.A of Schedule 2 of the OATT.

VAR Payment is the payment made to Qualified Reactive Resources for VAR Service capability under Section IV.A of Schedule 2 of the OATT.

VAR Service is the provision of reactive power voltage support to the New England Transmission System by a Qualified Reactive Resource or by other generators that are dispatched by the ISO to provide dynamic reactive power as described in Schedule 2 of the OATT.

Virtual Requirements are determined in accordance with Section III.A(iv) of the ISO New England Financial Assurance Policy.

Volt Ampere Reactive (VAR) is a measurement of reactive power.

Volumetric Measure (VM) is a type of billing determinant under Schedule 2 of Section IV.A of the Tariff used to assess charges to Customers under Section IV.A of the Tariff.

Winter ARA Qualified Capacity is described in Section III.13.4.2.1.2.1.1.2 of Market Rule 1.

Winter Capability Period means one of two time periods defined by the ISO for the purposes of rating and auditing resources. The time period associated with the Winter Capability Period is the period October 1 through May 31.

Winter Intermittent Reliability Hours are defined in Section III.13.1.2.2.2(c) of Market Rule 1.

Year means a period of 365 or 366 days, whichever is appropriate, commencing on, or on the anniversary of March 1, 1997. Year One is the Year commencing on March 1, 1997, and Years Two and higher follow it in sequence.

Zonal Price is calculated in accordance with Section III.2.7 of Market Rule 1.

III.12 Calculation of Capacity Requirements

III.12.1 Installed Capacity Requirement.

Prior to each Forward Capacity Auction, the ISO shall calculate the Installed Capacity Requirement for the New England Control Area for each upcoming Capacity Commitment Period through the Capacity Commitment Period associated with that Forward Capacity Auction in accordance with this Section III.12.1.

The ISO shall determine the Installed Capacity Requirement such that the probability of disconnecting non-interruptible customers due to resource deficiency, on ~~the~~ average, will be no more than once in ten years. Compliance with this resource adequacy planning criterion shall be evaluated probabilistically, such that the Loss of Load Expectation (“LOLE”) of disconnecting non-interruptible customers due to resource deficiencies shall be no more than 0.1 day each year. The forecast Installed Capacity Requirement shall meet this resource adequacy planning criterion for each Capacity Commitment Period. The Installed Capacity Requirement shall be determined assuming all resources pursuant to Sections III.12.7 and III.12.9 will be deliverable to meet the forecasted demand determined pursuant to Section III.12.8.

If the Installed Capacity Requirement shows a consistent bias over time, either high or low, the ISO shall make adjustments to the modeling assumptions and/or methodology through the stakeholder process to eliminate the bias in the Installed Capacity Requirement. The modeling assumptions used in determining the Installed Capacity Requirement are specified in Sections III.12.7, III.12.8 and III.12.9. For the purpose of this Section III.12, a “resource” shall include generating resources, demand resources, and import capacity resources eligible to receive capacity payments in the Forward Capacity Market.

[The ISO shall determine, by applying the same modeling assumptions and methodology used in determining the Installed Capacity Requirement, the capacity requirement value for each LOLE probability specified in Section III.13.2.2 for the System-Wide Capacity Demand Curve.](#)

III.12.2 Local Sourcing Requirements and Maximum Capacity Limits.

Prior to each Forward Capacity Auction, the ISO shall calculate the capacity requirements and limitations, accounting for relevant transmission interface limits which shall be determined pursuant to Section III.12.5, for each modeled Capacity Zone (as described in Section III.12.4) for each upcoming Capacity Commitment Period through the Capacity Commitment Period associated with that Forward Capacity

Auction. The Local Sourcing Requirement shall represent the minimum amount of capacity that must be procured within an import-constrained Capacity Zone. The Maximum Capacity Limit shall represent the maximum amount of capacity that can be procured in an export-constrained Capacity Zone to meet the Installed Capacity Requirement.

The ISO shall use consistent assumptions and standards to establish a resource's electrical location for purposes of qualifying a resource for the Forward Capacity Market and for purposes of calculating Local Sourcing Requirements [and Maximum Capacity Limits](#). The methodology used in determining the Local Sourcing Requirements and the Maximum Capacity Limits are specified in Sections III.12.2.1 and III.12.2.2, respectively. The modeling assumptions used in determining the Local Sourcing Requirements and the Maximum Capacity Limits are specified in Sections III.12.5, III.12.6, III.12.7, III.12.8 and III.12.9.

III.12.2.1 Calculation of Local Sourcing Requirements for Import-Constrained Capacity Zones.

For each import-constrained Capacity Zone, the Local Sourcing Requirement shall be the amount needed to satisfy the higher of: (i) the Local Resource Adequacy Requirement as determined pursuant to Section III.12.2.1.1; or (ii) the Transmission Security Analysis [Requirement](#) as determined pursuant to Section III.12.2.1.2.

III.12.2.1.1 Local Resource Adequacy Requirement.

The Local Resource Adequacy Requirement shall be calculated as follows:

- (a) Two areas shall be modeled: (i) the Capacity Zone under study which includes all load and all resources electrically located within the Capacity Zone, including external Control Area support from tie benefits on the import-constrained side of the interface, if any; and (ii) the rest of the New England Control Area which includes all load and all resources electrically located within the rest of the New England Control Area, including external Control Area support from tie benefits on the unconstrained side of the interface, if any.
- (b) The only transmission constraint to be modeled shall be the transmission interface limit between the Capacity Zone under study and the rest of the New England Control Area as identified pursuant to Section III.12.5.

(c) Any proxy units that are required in the New England Control Area pursuant to Section III.12.7.1 shall be modeled as specified in Section III.12.7.1, in order to ensure that the New England Control Area meets the resource adequacy planning criterion specified in Section III.12.1. If the system LOLE is less than 0.1 days/year, firm load is added (or unforced capacity is subtracted) so that the system LOLE equals 0.1 days/year.

(d) The Local Resource Adequacy Requirement for the import-constrained Capacity Zone Z shall be determined in accordance with the following formula:

$$LRA_Z = Resources_Z + Proxy Units_Z - (Proxy Units Adjustment_Z(1-FOR_Z)) - (Firm Load Adjustment_Z(1-FOR_Z))$$

In which:

LRA_Z = MW of Local Resource Adequacy Requirement for Capacity Zone Z;

$Resources_Z$ = MW of resources electrically located within Capacity Zone Z, including import Capacity Resources on the import-constrained side of the interface, if any;

$Proxy Units_Z$ = MW of proxy unit additions in Load Zone Z;

$Firm Load Adjustment_Z$ = MW of firm load added (or subtracted) within Capacity Zone Z to make the LOLE of the New England Control Area equal to 0.105 days per year; and

FOR_Z = Capacity weighted average of the forced outage rate modeled for all resources within Capacity Zone Z, including and proxy unit additions to Capacity Zone Z.

$Proxy Units Adjustment$ = MW of firm load added to (or unforced

capacity subtracted from) Capacity Zone Z
 until the system LOLE equals 0.1
 days/year.

To determine the Local Resource Adequacy Requirement, the firm load is adjusted within Capacity Zone Z until the LOLE of the New England Control Area reaches 0.105 days per year. The LOLE of 0.105 days per year includes an allowance for transmission related LOLE of 0.005 days per year associated with each interface. As firm load is added to (or subtracted from) Capacity Zone Z, an equal amount of firm load is removed from (or added to) the rest of New England Control Area.

III.12.2.1.2 Transmission Security Analysis Requirement.

A Transmission Security Analysis shall be used to determine the requirement of the zone being studied, and shall include the following features:

- (a) The ISO shall perform a series of transmission load flow studies and/or a deterministic operable capacity analysis targeted at determining the performance of the system under stressed conditions, and at developing a resource requirement sufficient to allow the system to operate through those stressed conditions.
- (b) The Transmission Security Analysis Requirement shall be set at a level sufficient to cover most reasonably anticipated events, but will not guarantee that every combination of obligated resources within the zone will meet system needs.
- (c) In performing the Transmission Security Analysis, the ISO may establish static transmission interface transfer limits, as identified pursuant to Section III.12.5, as a reasonable representation of the transmission system's capability to serve load with available existing resources.
- (d) The Transmission Security Analysis may model the entire New England system and individual zones, for both the first contingency (N-1) and second contingency (N-1-1) conditions. First contingency conditions (N-1) shall include the loss of the most critical generator or most critical transmission element with respect to the zone. Second contingency conditions (N-1-1) shall include both: (i) the loss of the most critical generator with respect to the zone followed by the loss of the most critical transmission element ("Line-Gen"); and (ii) the loss of the most critical transmission element followed by the loss of the next most critical transmission element ("Line-Line") with respect to the zone.

III.12.2.2 Calculation of Maximum Capacity Limit for Export-Constrained Capacity Zones.

For each export-constrained Capacity Zone, the Maximum Capacity Limit shall be calculated using the following method:

- (a) Two areas shall be modeled: (i) the Capacity Zone under study which includes all load and all resources electrically located within the Capacity Zone, including external Control Area support from tie benefits on the export-constrained side of the interface, if any; and (ii) the rest of the New England Control Area, which includes all load and all resources electrically located within the rest of the New England Control Area, including external Control Area support from tie benefits to the rest of the New England Control Area, if any.
- (b) The only transmission constraint to be modeled shall be the transmission interface limit between the Capacity Zone under study and the rest of the New England Control Area as identified pursuant to Section III.12.5.
- (c) Any proxy units that are required in the New England Control Area pursuant to Section III.12.7.1 shall be modeled as specified in Section III.12.7.1, in order to ensure that the New England Control Area meets the resource adequacy planning criterion specified in Section III.12.1. If the system LOLE is less than 0.1 days/year, firm load is added (or unforced capacity is subtracted) so that the system LOLE equals 0.1 days/year.
- (d) The Maximum Capacity Limit for the export-constrained Capacity Zone Y shall be determined in accordance with the following formula:

$$\text{Maximum Capacity Limit}_Y = \text{ICR} - \text{LRA}_{\text{RestofNewEngland}}$$

In which:

Maximum Capacity Limit_Y = Maximum MW amount of resources, including Import Capacity Resources on the export-constrained side of the interface, if any, that can be procured in the export-constrained Capacity Zone Y to meet the Installed Capacity Requirement;

ICR = MW of Installed Capacity Requirement for the New England Control Area, determined in accordance with Section III.12.1; and

$LRA_{\text{RestofNewEngland}}$ = MW of Local Sourcing Requirement for the rest of the New England Control Area, which for the purposes of this calculation is treated as an import-constrained region, determined in accordance with Section III.12.2.1.

III.12.3 Consultation and Filing of Capacity Requirements.

At least two months prior to filing the Installed Capacity Requirements, ~~and~~ Local Sourcing Requirements, [Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve](#) for each upcoming Capacity Commitment Period through the relevant Capacity Commitment Period with the Commission, the ISO shall review the modeling assumptions and resulting Installed Capacity Requirements, ~~and the~~ Local Sourcing Requirements, [Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve](#) with the Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies. Following consultation with Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies, the ISO shall file the Installed Capacity Requirements, ~~and~~ Local Sourcing Requirements, [Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve](#) for each upcoming Capacity Commitment Period through the relevant Capacity Commitment Period with the Commission pursuant to Section 205 of the Federal Power Act 90 days prior to the Forward Capacity Auction for the Capacity Commitment Period. The ISO shall file with the Commission pursuant to Section 205 of the Federal Power Act, the proposed identification of a potential new Capacity Zone when the boundary of the potential new Capacity Zone differs from the boundaries of existing Load Zones or Capacity Zones. In order to be used in a given FCA, any new Capacity Zone must have received approval from the Commission prior to the Existing Capacity Qualification Deadline of the applicable FCA.

III.12.4 Capacity Zones.

For each Forward Capacity Auction, the ISO shall, using the results of the most recent annual assessment of transmission transfer capability conducted pursuant to ISO Tariff Section II, Attachment K, determine the Capacity Zones to model as described below, and will include such designations in its filing with the Commission pursuant to Section III.13.8.1:

- (a) The ISO shall model in the Forward Capacity Auction, as separate export-constrained Capacity Zones, those zones identified in the most recent annual assessment of transmission transfer capability pursuant to ISO Tariff Section II, Attachment K, for which the Maximum Capacity Limit is less than the sum of the existing qualified capacity and proposed new capacity that could qualify to be procured in the export constrained Capacity Zone, including existing and proposed new Import Capacity Resources on the export-constrained side of the interface.
- (b) The ISO shall model in the Forward Capacity Auction, as separate import-constrained Capacity Zones, those zones identified in the most recent annual assessment of transmission transfer capability pursuant to ISO Tariff Section II, Attachment K, for which the second contingency transmission capability results in a line-line Transmission Security Analysis ~~requirement~~[Requirement](#), calculated pursuant to Section III.12.2.1.2 and pursuant to ISO New England Planning Procedures, that is greater than the Existing Qualified Capacity in the zone, with the largest generating station in the zone modeled as out-of-service. Each assessment will model out-of-service all Non-Price Retirement Requests (including any received for the current FCA at the time of this calculation) and Permanent De-List Bids as well as rejected for reliability Static De-List Bids from the most recent previous Forward Capacity Auction and rejected for reliability Dynamic De-List Bids from the most recent previous Forward Capacity Auction.
- (c) Adjacent Load Zones that are neither export-constrained nor import-constrained shall be modeled together as the Rest of Pool Capacity Zone in the Forward Capacity Auction.

III.12.5 Transmission Interface Limits.

Transmission interface limits, used in the determination of Local Sourcing Requirements, shall be determined pursuant to ISO Tariff Section II, Attachment K using network models that include all resources, existing transmission lines and proposed transmission lines that the ISO determines, in accordance with Section III.12.6, will be in service no later than the first day of the relevant Capacity Commitment Period. The transmission interface limits shall be established, using deterministic analyses, at levels that provide acceptable thermal, voltage and stability performance of the system both with all lines in service and after any criteria contingency occurs as specified in ISO New England Manuals and ISO New England Administrative Procedures.

III.12.6 Modeling Assumptions for Determining the Network Model.

The ISO shall determine, in accordance with this Section III.12.6, the generating units and transmission infrastructure to include in the network model that: (i) are expected to be in service no later than the first day of the relevant Capacity Commitment Period; and (ii) may have a material impact on the network model, a potential interface constraint, or on one or more Local Sourcing Requirements. The network model shall be used, among other purposes, (i) for the Forward Capacity Market qualification process and (ii) to calculate transmission interface limits in order to forecast the Local Sourcing Requirements. The network model shall include generating units and associated Interconnection Facilities as specified in subsection (a) and Transmission Upgrades as specified in subsection (b).

(a) Generating units and associated Interconnection Facilities that shall be included in the network model for the relevant Capacity Commitment Period shall include:

(i) all existing resources that have not been approved to be retired for the relevant Capacity Commitment Period, as described in Section III.13.2.5.2.5.3;

(ii) all generating units that are resources cleared in previous Forward Capacity Auctions or obligated for the relevant Capacity Commitment Period that have a valid Interconnection Request for which a draft Interconnection System Impact Study report has been submitted to the Interconnection Customer; and

iii. any generating unit that has a valid Interconnection Request for which a draft Interconnection Feasibility Study report has been submitted to the Interconnection Customer and is reasonably expected to declare commercial operation no later than the first day of the relevant Capacity Commitment Period whether or not such unit is participating in the Forward Capacity Market qualification process.

(b) Prior to each Forward Capacity Auction and each annual reconfiguration auction, the ISO shall determine and publish a list of the transmission projects and elements of transmission projects that will be included in the network model. During the process of making the transmission infrastructure determinations, as described in Section III.12.6.1, the ISO shall consult with the Governance Participants, the Transmission Owners, any transmission project proponents, the state utility regulatory agencies in New England and, as appropriate, other state agencies.

III.12.6.1 Process for Establishing the Network Model

- (a) The ISO shall establish an initial network model prior to the Forward Capacity Auction that only includes transmission infrastructure that is already in service at the time that the initial network model is developed.
- (b) After establishing the initial network model, the ISO shall compile a preliminary list of the transmission projects or elements of transmission projects in the RSP Project List, individually or in combination with each other, as appropriate, to identify transmission projects that may achieve an in-service date no later than the first day of the relevant Capacity Commitment Period and that will have a material impact on the network model, on a potential interface constraint or one or more Local Sourcing Requirements.
- (c) For the transmission projects or elements of transmission projects in the RSP Project List that are included in the preliminary list developed pursuant to subsection (b), the ISO shall determine whether the transmission projects or elements of transmission projects meet all of the initial threshold milestones specified in Section III.12.6.2 and will be considered for further evaluation pursuant to subsection (d).
- (d) For those transmission projects or elements of transmission projects that meet the initial threshold milestones in subsection (c), the ISO shall use the evaluation criteria specified in Section III.12.6.3, and any other relevant information, to determine whether to include a transmission project or element of a transmission project in the final network model.
- (e) If after completing its evaluation pursuant to Sections III.12.6.1 through III.12.6.3 and conferring with the transmission project proponents, the Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies, the ISO determines that the transmission project or a portion of the transmission project is reasonably expected to be in service no later than the first day for the relevant Capacity Commitment Period, then such transmission project or portion of transmission project shall be considered in service in the finalized network model to calculate the transmission interface limits pursuant to Section III.12.5.

III.12.6.2 Initial Threshold to be Considered In-Service.

The ISO shall determine whether transmission projects or elements of transmission projects meet all of the following initial threshold milestones:

- (a) A critical path schedule for the transmission project has been furnished to ISO showing that the transmission project or the element of the transmission project will be in-service no later than the first day

of the relevant Capacity Commitment Period. The critical path schedule must be sufficiently detailed to allow the ISO to evaluate the feasibility of the schedule.

(b) At the time of the milestone review, siting and permitting processes, if required, are on schedule as shown on the critical path schedule.

(c) At the time of the milestone review, engineering is on schedule as shown on the critical path schedule.

(d) At the time of the milestone review, land acquisition, if required, is on schedule as shown on the critical path schedule.

(e) Corporate intent to build the transmission project has been furnished to the ISO. An officer of the host Transmission Owner has submitted to the ISO a statement verifying that the officer has reviewed the proposal and critical path schedule submitted to the ISO, and the Transmission Owner concurs that the schedule is achievable, and it is the intent of the Transmission Owner to build the proposed transmission project in accordance with that schedule. The Transmission Owner may develop alternatives or modifications to the transmission project during the course of design of the transmission project that accomplish at least the same transfer capability. Such alternatives or modifications are acceptable, so long as the ISO determines that the alternative or modification is reasonably expected to achieve an in-service date no later than the first day of the relevant Capacity Commitment Period. The provision of an officer's statement shall be with the understanding that the statement shall not create any liability on the officer and that any liability with respect to the Transmission Owner's obligations shall be as set forth in the Transmission Operating Agreement and shall not be affected by such officer's statement.

III.12.6.3 Evaluation Criteria.

For a transmission project or element of a transmission project that meets the initial threshold milestones specified in Section III.12.6.2, the ISO shall consider the following factors and any other relevant information to determine whether to include the transmission project or element of the transmission project in the network model for the relevant Capacity Commitment Period.

(a) Sufficient engineering to initiate construction is on schedule as shown on the critical path schedule.

- (b) Approval under Section I.3.9 of the Transmission, Markets and Services Tariff, if required, has been obtained or is on schedule to be obtained as shown on the critical path schedule.
- (c) Significant permits, including local permits, if required to initiate construction have been obtained or are on schedule consistent with the critical path schedule.
- (d) Easements, if required, have been obtained or are on schedule consistent with the critical path schedule. Needed land purchases, if required, have been made or are on schedule consistent with the critical path schedule.
- (e) Any contracts required to procure or construct a transmission project are in place consistent with the critical path schedule. The ISO's analysis may also take into account whether such contracts contain incentive and/or penalty clauses to encourage third parties to advance the delivery of material services to conform with the critical path schedule.
- (f) Physical site work is on schedule consistent with the critical path schedule.
- (g) The transmission project is in a designated National Interest Electric Transmission Corridor in accordance with Section 216 of the Federal Power Act, 16 U.S.C. §§ 824p.

III.12.7 Resource Modeling Assumptions.

III.12.7.1 Proxy Units.

When the available resources are insufficient for the unconstrained New England Control Area to meet the resource adequacy planning criterion specified in Section III.12.1, proxy units shall be used as additional capacity to determine the Installed Capacity Requirement, ~~and the~~ Local Resource Adequacy Requirements, [Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve](#). The proxy units shall reflect resource capacity and outage characteristics such that when the proxy units are used in place of all other resources in the New England Control Area, the reliability, or LOLE, of the New England Control Area does not change. The outage characteristics are the summer capacity weighted average availability of the resources in the New England Control Area as determined in accordance with Section III.12.7.3. The capacity of the proxy unit is determined by adjusting the capacity of the proxy unit until the LOLE of the New England Control Area is equal to the LOLE calculated while using the capacity assumptions described in Section III.12.7.2.

When modeling transmission constraints for the determination of Local Resource Adequacy Requirements, the same proxy units may be added to the import-constrained zone or elsewhere in the rest of the New England Control Area depending on where system constraints exist.

III.12.7.2 Capacity.

The resources included in the calculation of the Installed Capacity Requirement, ~~and the~~ Local Sourcing Requirements, [Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve](#) shall include:

- (a) all Existing Generating Capacity Resources,
- (b) resources cleared in previous Forward Capacity Auctions or obligated for the relevant Capacity Commitment Period,
- (c) all Existing Import Capacity Resources backed by a multiyear contract to provide capacity in the New England Control Area, where that multiyear contract requires delivery of capacity for the Commitment Period for which the Installed Capacity Requirement is being calculated, and
- (d) Existing Demand Resources that are qualified to participate in the Forward Capacity Market and New Demand Resources that have cleared in previous Forward Capacity Auctions and obligated for the relevant Capacity Commitment Period,

but shall exclude:

- (e) capacity associated with Export Bids cleared in previous Forward Capacity Auctions and obligated for the relevant Capacity Commitment Period, and
- (f) resources for which Permanent De-list Bids cleared in previous Forward Capacity Auctions or for which Non-Price Retirement Requests have been received.

The rating of Existing Generating Capacity Resources and Existing Import Capacity Resources used in the calculation of the Installed Capacity Requirement, Local Sourcing Requirements, ~~and~~ Maximum Capacity Limits [and capacity requirement values for the System-Wide Capacity Demand Curve](#) shall be

the summer Qualified Capacity value of such resources for the relevant zone. The rating of Demand Resources shall be the summer Qualified Capacity value reduced by any reserve margin adjustment factor that is otherwise included in the summer Qualified Capacity value. The rating of resources, except for Demand Resources, cleared in previous Forward Capacity Auctions and obligated for the relevant Capacity Commitment Period shall be based on the amount of Qualified Capacity that cleared in previous Forward Capacity Auctions or obligated for the relevant Capacity Commitment Period. Resources are located within the Capacity Zones in which they are electrically ~~located~~ connected as determined during the qualification process.

III.12.7.2.1 [Reserved.]

III.12.7.3 Resource Availability.

The Installed Capacity Requirement, ~~and the~~ Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve shall be calculated taking resource availability into account and shall be determined as follows:

For Existing Generating Capacity Resources:

(a) The most recent five-year moving average of EFORd shall be used as the measure of resource availability used in the calculation of the Installed Capacity Requirement, ~~and the~~ Local Resource Adequacy Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve. The most recent five-year moving average of EFORd shall be used as the measure of resource availability for non-peaking resources used in the calculation of Transmission Security Analysis Requirements. A deterministic adjustment factor, based on the operational experience of the ISO, shall be used as the measure of resource availability for peaking resources used in the calculation of Transmission Security Analysis Requirements, and will be reviewed periodically.

(b) [Reserved.]

(c) Once sufficient data are collected under the availability incentives in the Forward Capacity Market, a resource availability metric, which reflects resource availability in a manner that is consistent with the availability incentives in the Forward Capacity Market, shall be developed and reviewed with Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies and used in the calculation of the Installed Capacity Requirement, ~~and the~~ Local Sourcing

Requirements, [Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve](#).

For resources cleared in previous Forward Capacity Auctions or obligated for the relevant Capacity Commitment Period that do not have sufficient data to calculate an availability metric as defined in subsections (a) or (c) above, class average data for similar resource types shall be used. For Demand Resources, including Real-Time Emergency Generation, historical performance data for those resources will be used to develop an availability metric for use in the calculation of the Installed Capacity

Requirement, ~~and~~ Local Sourcing Requirements, [Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve](#).

III.12.7.4 Load and Capacity Relief.

Load and capacity relief expected from system-wide implementation of the following actions ~~during a capacity deficiency (specified in ISO New England Operating Procedure No. 4)~~. [Action During a Capacity Deficiency](#), shall be included in the calculation of the Installed Capacity Requirement, ~~and the Local Sourcing Resource Adequacy Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve. The Installed Capacity Requirements and Local Sourcing Requirements shall reflect the impact of the following actions during a capacity deficiency which are specified in the ISO New England Manuals and ISO New England Administrative Procedures:~~

(a) **Implement voltage reduction.** The MW value of the load relief shall be equal to the percentage load reduction achieved in the most applicable voltage reduction tests multiplied by the forecasted seasonal peak loads.

(b) **Arrange for available Emergency energy from Market Participants or neighboring Control Areas.** These actions are included in the calculation through the use of tie benefits to meet system needs. The MW value of tie benefits is calculated in accordance with Section III.12.9.

(c) **Maintain an adequate amount of ten-minute synchronized reserves.** The amount of system reserves included in the [determination of the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve](#) shall be consistent with those needed for reliable system operations during Emergency Conditions. When modeling transmission constraints, the reserve requirement for a zone shall be the

zone's pro rata share of the forecasted system peak load multiplied by the system reserves needed for reliable system operations during Emergency Conditions.

III.12.8 Load Modeling Assumptions.

The ISO shall forecast load for the New England Control Area and for each Load Zone within the New England Control Area. The load forecasts shall be based on appropriate models and data inputs. Each year, the load forecasts and underlying methodologies, inputs and assumptions shall be reviewed with Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies. If the load forecast shows a consistent bias over time, either high or low, the ISO shall propose adjustments to the load modeling methodology to the Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies to eliminate the bias.

Demand Resources shall be reflected in the load forecast as specified below:

- (a) Expected reductions from an installed or forecast Demand Resource not qualifying for or not participating in the Forward Capacity Auction shall be reflected as a reduction in the load forecast ~~and resultant~~that will be used to determine the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve for the relevant Capacity Commitment Period. The expected reduction from these resources will be included in the load forecast to the extent that they meet the qualification process rules, including monitoring and verification plan and financial assurance requirements. If no qualification process rules are in place for the expected reductions from these resources, they shall not be included within the load forecast.
- (b) Expected reductions from an installed or forecast Demand Resource that qualifies to participate in the Forward Capacity Market, participates but does not clear in the Forward Capacity Auction, or has cleared in a previous Forward Capacity Auction and is expected to continue in the Forward Capacity Market shall not be reflected as a reduction in the load forecast ~~and the resultant~~that will be used to determine the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve for the relevant Capacity Commitment Period.
- (c) [Reserved.]

(d) Any realized Demand Resource reductions in the historical period that received Forward Capacity Market payments for these reductions, or Demand Resource reductions that are expected to receive Forward Capacity Market payments by participating in the upcoming Forward Capacity Auction or having cleared in a previous Forward Capacity Auction, shall be added back into the appropriate historical loads to ensure that such resources are not reflected as a reduction in the load forecast ~~and the result that will be used to determine the~~ Installed Capacity Requirement, [Local Sourcing Requirements](#), [Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve](#) for the relevant Capacity Commitment Period.

III.12.9 Tie Benefits.

The Installed Capacity Requirement, Local Sourcing Requirements, ~~and~~ Maximum Capacity Limits ~~and capacity requirement values for the System-Wide Capacity Demand Curve~~ shall be calculated assuming appropriate tie benefits, if any, available from interconnections with neighboring Control Areas. Tie benefits shall be calculated only for interconnections with directly interconnected neighboring Control Areas with which the ISO has in effect agreements providing for emergency support to New England, including but not limited to inter-Control Area coordination agreements, emergency aid agreements and the NPCC Regional Reliability Plan.

Tie benefits shall be calculated using a probabilistic multi-area reliability model, by comparing the LOLE for the New England system before and after interconnecting the system to the neighboring Control Areas. To quantify tie benefits, firm capacity equivalents shall be added until the LOLE of the isolated New England Control Area is equal to the LOLE of the interconnected New England Control Area.

III.12.9.1. Overview of Tie Benefits Calculation Procedure.

III.12.9.1.1. Tie Benefits Calculation for the Forward Capacity Auction and Annual Reconfiguration Auctions; Modeling Assumptions and Simulation Program.

For each Capacity Commitment Period, tie benefits shall be calculated for the Forward Capacity Auction and the third annual reconfiguration auction using the calculation methodology in this Section III.12.9.

For the first and second annual reconfiguration auctions for a Capacity Commitment Period, the tie benefits calculated for the associated Forward Capacity Auction shall be utilized in determining the

Installed Capacity Requirement, Local Sourcing Requirements, ~~and~~ Maximum Capacity Limits ~~and capacity requirement values for the System-Wide Capacity Demand Curve~~, as adjusted to account for

any changes in import capability of interconnections with neighboring Control Areas and changes in import capacity resources using the methodologies in Section III.12.9.6.

Tie benefits shall be calculated using the modeling assumptions developed in accordance with Section III.12.9.2 and using the General Electric Multi-area Reliability Simulation (MARS) program.

III.12.9.1.2. Tie Benefits Calculation.

The total tie benefits to New England from all directly interconnected neighboring Control Areas are calculated first using the methodology in Section III.12.9.3. Following the calculation of total tie benefits, individual tie benefits from each qualifying neighboring Control Area are calculated using the methodology in Section III.12.9.4.1. If the sum of the tie benefits from each Control Area does not equal the total tie benefits to New England, then each Control Area's tie benefits are adjusted based on the ratio of the individual Control Area tie benefits to the sum of the tie benefits calculated for each Control Area using the methodology in Section III.12.9.4.2. Following this calculation, tie benefits are calculated for each qualifying individual interconnection or group of interconnections using the methodology in Section III.12.9.5.1. If the sum of the tie benefits from individual interconnections or groups of interconnections does not equal their associated Control Area's tie benefits, then the tie benefits of each individual interconnection or group of interconnections is adjusted based on the ratio of the tie benefits of the individual interconnection or group of interconnections to the sum of the tie benefits within the Control Area using the methodology in Section III.12.9.5.2.

III.12.9.1.3. Adjustments to Account for Transmission Import Capability and Capacity Imports.

Once the initial calculation of tie benefits is performed, the tie benefits for each individual interconnection or group of interconnections is adjusted to account for capacity imports and any changes in the import capability of interconnections with neighboring Control Areas, using the methodologies in Section III.12.9.6. Once the import capability and capacity import adjustments are completed, the sum of the tie benefits of all individual interconnections and groups of interconnections for a Control Area, with the import capability and capacity import adjustments, represents the tie benefits associated with that Control Area, and the sum of the tie benefits from

all Control Areas, with the import capability and capacity import adjustments, represents the total tie benefits available to New England.

III.12.9.2. Modeling Assumptions and Procedures for the Tie Benefits Calculation.

III.12.9.2.1. Assumptions Regarding System Conditions.

In calculating tie benefits, “at criterion” system conditions shall be used to model the New England Control Area and all interconnected Control Areas.

III.12.9.2.2. Modeling Internal Transmission Constraints in New England.

In calculating tie benefits, all New England internal transmission constraints that (i) are modeled in the most recent Regional System Plan resource adequacy studies and assessments and (ii) are not addressed by either a Local Sourcing Requirement or a Maximum Capacity Limit calculation shall be modeled, using the procedures in Section III.12.9.2.5.

III.12.9.2.3. Modeling Transmission Constraints in Neighboring Control Areas.

The ISO will review annually NPCC’s assumptions regarding transmission constraints in all directly interconnected neighboring Control Areas that are modeled for the tie benefits calculations. In the event that NPCC models a transmission constraint in one of the modeled neighboring Control Areas, the ISO will perform an evaluation to determine which interfaces are most critical to the ability of the neighboring Control Area to reliably provide tie benefits to New England from both operational and planning perspectives, and will model those transmission constraints in the tie benefits calculation, using the procedures in Section III.12.9.2.5.

III.12.9.2.4. Other Modeling Assumptions.

- A. External transfer capability determinations. The transfer capability of all external interconnections with New England will be determined using studies that take account of the load, resource and other electrical system conditions that are consistent with those expected during the Capacity Commitment Period for which the calculation is being performed. Transfer capability studies will be performed using simulations that consider the contingencies enumerated in sub-section (iii) below.

- (i) The transmission system will be modeled using the following conditions:
1. The forecast 90/10 peak load conditions for the Capacity Commitment Period;
 2. Qualified Existing Generating Capacity Resources reflecting their output at their Capacity Network Resource level;
 3. Qualified Existing Demand Resources reflecting their Capacity Supply Obligation received in the most recent Forward Capacity Auction;
 4. Transfers on the transmission system that impact the transfer capability of the interconnection under study.
- (ii) The system will be modeled in a manner that reflects the design of the interconnection. If an interconnection and its supporting system upgrades were designed to provide incremental capacity into the New England Control Area, simulations will assume imports up to the level that the interconnection was designed to support. If the interconnection was not designed to be so comparably integrated, simulations will determine the amount of power that can be delivered into New England over the interconnection.
- (iii) The simulations will take into account contingencies that address a fault on a generator or transmission facility, loss of an element without a fault, and circuit breaker failure following the loss of an element or an association with the operation of a special protection system.

B. In calculating tie benefits, New England capacity exports are removed from the internal capacity resources and are modeled as a resource in the receiving Control Area. The transfer capability of external interconnections is not adjusted to account for capacity exports.

III.12.9.2.5. Procedures for Adding or Removing Capacity from Control Areas to Meet the 0.1 Days Per Year LOLE Standard.

In calculating tie benefits, capacity shall be added or removed from the interconnected system of New England and its neighboring Control Areas, until the LOLE of New England and the LOLE of each Control Area of the interconnected system equals 0.1 days per year simultaneously. The following procedures shall be used to add or remove capacity within New England and the interconnected Control Areas to achieve that goal.

- A.** Adding Proxy Units within New England when the New England system is short of capacity. In modeling New England as part of the interconnected system, if New England is short of capacity to meet the 0.1 days per year LOLE, proxy units (with the characteristics identified in Section III.12.7.1) will be added to the sub-areas that are created by any modeled internal transmission constraints within New England, beginning with the sub-area with the highest LOLE. If there are no modeled internal transmission constraints in the New England Control Area, then proxy units will be added to the entire Control Area. If, as a result of the addition of one or more proxy units, the system is surplus of capacity, then the methodology in Section III.12.9.2.5(b) will be used to remove the surplus capacity.
- B.** Removing capacity from New England when the New England system is surplus of capacity. In modeling New England as part of the interconnected system, if New England is surplus of capacity to meet the 0.1 days per year LOLE, the surplus capacity will be removed from the sub-areas as follows. Resources will be removed from sub-areas with capacity surplus based on the ratio of capacity surplus in the sub-area to the total capacity surplus in these surplus sub-areas. The amount of capacity surplus for a sub-area is the amount of the Existing Qualified Capacity, and any amount of proxy units added in that sub-area that is above its 50-50 peak load forecast. Notwithstanding the foregoing, if removing resources will exacerbate a binding transmission constraint, then capacity will not be removed from that sub-area and will instead be removed from the remaining sub-areas using the same ratios described above for the removal of capacity surplus. If there are no modeled internal transmission constraints in the New England Control Area, then the surplus capacity shall be removed from the entire Control Area.
- C.** Adding capacity within neighboring Control Areas when the neighboring Control Area is short of capacity. In modeling neighboring Control Areas as part of the

interconnected system, if the neighboring Control Area is short of capacity to meet the 0.1 days per year LOLE, additional capacity will be added to the neighboring Control Area's sub-areas that are created by any modeled internal transmissions constraints, beginning with the sub-area with the highest LOLE. If there are no modeled internal transmission constraints in the Control Area, then capacity will be added to the entire Control Area. The process that the neighboring Control Area utilizes in its resource adequacy study to meet its resource adequacy criterion will be utilized to add capacity to that Control Area. In filing the Installed Capacity Requirement values pursuant to Section III.12.3, the ISO will provide citations to any resource adequacy studies relied upon for these purposes. If, as a result of the capacity addition, the system is surplus of capacity, then the methodology in Section III.12.9.2.5(d) shall be used to remove the surplus capacity.

- D.** Removing capacity from neighboring Control Areas when the neighboring Control Area is surplus of capacity. In modeling neighboring Control Areas as part of the interconnected system, if the neighboring Control Area is surplus of capacity to meet the 0.1 days per year LOLE, the surplus capacity will be removed from the neighboring Control Area's sub-areas as follows. Resources will be removed from sub-areas with capacity surplus based on the ratio of capacity surplus in the sub-area to the total capacity surplus in the surplus sub-areas. The amount of capacity surplus for a sub-area is the amount of the installed capacity in the sub-area above its 50/50 peak load forecast. For a sub-area that has a minimum locational resource requirement above its 50/50 peak load forecast, the amount of capacity surplus is the amount of the installed capacity in the sub-area above its minimum locational resource requirement. Notwithstanding the foregoing, if removing resources from a sub-area will exacerbate a binding transmission constraint, then capacity will not be removed from that sub-area and will instead be removed from the remaining sub-areas using the same ratio of capacity surplus in the sub-area to the total capacity surplus in the those remaining surplus sub-areas. If there are no modeled internal transmission constraints in the neighboring Control Area, then the surplus capacity will be removed from the entire Control Area.

- E.** Maintaining the neighboring Control Area's locational resource requirements. In modeling a neighboring Control Area with internal transmission constraints, all minimum locational resource requirements in the Control Area's sub-areas as established by the neighboring Control Area's installed capacity requirement calculations shall be observed.

III.12.9.3. Calculating Total Tie Benefits.

The total tie benefits with all qualifying directly interconnected neighboring Control Areas shall be calculated by comparing the interconnection state of the New England system with all interconnections to neighboring Control Areas connected with the interconnection state of the New England system with all interconnections with neighboring Control Areas disconnected. To calculate total tie benefits:

- A.** The New England system shall be interconnected with all directly interconnected neighboring Control Areas and the New England Control Area, and each neighboring Control Area shall be brought to 0.1 days per year LOLE simultaneously by adjusting the capacity of each Control Area, utilizing the methods for adding or removing capacity in Section III.12.9.2.5.
- B.** Once the interconnected system is brought to 0.1 days per year LOLE, the LOLE of the New England Control Area shall be calculated a second time, with the New England system isolated from the rest of the interconnected system that was brought to 0.1 days per year LOLE.
- C.** Total tie benefits shall be the sum of the amounts of firm capacity that needs to be added to the isolated New England Control Area at the point at which each interconnection with neighboring Control Areas interconnects in New England to bring the New England LOLE back to 0.1 days per year. This value is subject to adjustment in accordance with Section III.12.9.6.

III.12.9.4. Calculating Each Control Area's Tie Benefits.

III.12.9.4.1. Initial Calculation of a Control Area's Tie Benefits.

Tie benefits from each neighboring Control Area shall be determined by calculating the tie benefits for every possible interconnection state that has an impact on the tie benefit value between the New England system and the target neighboring Control Area. If two or more

interconnections between New England and the target neighboring Control Area exist, then all interconnections grouped together will be used to represent the state of interconnection between New England and the target neighboring Control Area. The tie benefits from the target neighboring Control Area shall be equal to the simple average of the tie benefits calculated from all possible interconnection states, subject to adjustment in accordance with Section III.12.9.4.2.

III.12.9.4.2. Pro Ration Based on Total Tie Benefits.

If the sum of the individual Control Area tie benefits calculated in accordance with Section III.12.9.4.1 is different than the total tie benefits from all Control Areas calculated in accordance with Section III.12.9.3, then each Control Area's tie benefits shall be increased or decreased based on the ratio of the individual Control Area tie benefits to the sum of the tie benefits for each individual Control Area, so that the sum of each Control Area's tie benefits, after the pro-ration, is equal to the total tie benefits calculated in accordance with Section III.12.9.3. The pro-rated Control Area tie benefits are subject to further adjustment in accordance with Section III.12.9.6.

III.12.9.5. Calculating Tie Benefits for Individual Ties.

Tie benefits shall be calculated for an individual interconnection or group of interconnections to the extent that a discrete and material transfer capability can be identified for the interconnection or group of interconnections. All interconnections or groups of interconnections shall have equal rights in calculating individual tie benefits, with no grandfathering or incremental tie capability treatment.

For purposes of calculating tie benefits, a group of interconnections refers to two or more AC lines that operate in parallel to form a transmission interface in which there are significant overlapping contributions of each line toward establishing the transfer limit, such that the individual lines in a group of interconnections cannot be assigned individual contributions.

III.12.9.5.1. Initial Calculation of Tie Benefits for an Individual Interconnection or Group of Interconnections.

Tie benefits for an individual interconnection or group of interconnections shall be calculated by calculating tie benefits for each possible interconnection state between the New England system and the individual interconnection or group of interconnections. The tie benefits from that interconnection or group of interconnections shall be equal to the simple average of the tie benefits calculated from all possible interconnection states, subject to adjustment in accordance with Section III.12.9.5.2.

III.12.9.5.2. Pro Ration Based on Total Tie Benefits.

If the sum of the individual interconnection's or group of interconnection's tie benefits calculated in accordance with Section III.12.9.5.1 is different than the associated Control Area's tie benefits calculated in accordance with Section III.12.9.4, then the tie benefits of the individual interconnection or group of interconnections shall be adjusted based on the ratio of the tie benefits of the individual interconnection or group of interconnections to the sum of the tie benefits for each interconnection or group of interconnections in that Control Area, so that the sum of the tie benefits for each interconnection or group of interconnections in the Control Area, after the pro-ration, is equal to the total tie benefits for the Control Area calculated in accordance with Section III.12.9.4. The pro-rated tie benefits for each interconnection or group of interconnections is subject to further adjustment in accordance with Section III.12.9.6.

III.12.9.6. Accounting for Capacity Imports and Changes in External Transmission Facility Import Capability.

III.12.9.6.1. Accounting for Capacity Imports.

In the initial tie benefits calculations, capacity imports are modeled as internal resources in New England, and the import capability of the interconnections with neighboring Control Areas is not reduced to reflect the impact of capacity imports. After the initial tie benefits calculations, total tie benefits, tie benefits for each Control Area, and tie benefits from each individual interconnection or group of interconnections shall be adjusted to account for capacity imports using the methodology contained in this Section III.12.9.6.1. For the Forward Capacity Auction and third annual reconfiguration auction, this adjustment shall be applied to the tie benefit values calculated in accordance with Sections III.12.9.3, III.12.9.4 and III.12.9.5 respectively. For the

first and second annual reconfiguration auctions, this adjustment shall be applied to the tie benefits values calculated for the Forward Capacity Auction.

- A.** Capacity imports shall be deducted from the import capability of each individual interconnection or group of interconnections to determine the available import capability of the interconnection or group of interconnections prior to accounting for tie benefits from those interconnections. The transfer capability of an interconnection or group of interconnections shall be determined using the procedures in Section III.12.9.2.4.A.
- B.** If the tie benefits value of an individual interconnection or group of interconnections, as determined in accordance with Section III.12.9.5, is greater than the remaining transmission import capability of the interconnection or group of interconnections after accounting for capacity imports, the tie benefit value of the individual interconnection or group of interconnections shall be equal to the remaining transmission import capability (taking into account any further adjustments to transmission import capability in accordance with Section III.12.9.6.2). If the tie benefits value of an individual interconnection or group of interconnections is not greater than the remaining transmission import capability after accounting for capacity imports, then the tie benefit value of the individual interconnection or group of interconnections shall be equal to the value determined in accordance with Section III.12.9.5 (taking into account any further adjustments to transmission import capability in accordance with Section III.12.9.6.2).
- C.** The tie benefits for each Control Area shall be the sum of the tie benefits from the individual interconnections or groups of interconnections with that Control Area, after accounting for any adjustment for capacity imports and any further adjustments to transmission import capability in accordance with Section III.12.9.6.2.
- D.** The total tie benefits from all qualifying neighboring Control Areas shall be the sum of the Control Area tie benefits, after accounting for any adjustment for capacity imports and any further adjustments to transmission import capability in accordance with Section III.12.9.6.2.
- E.** For purposes of determining the adjustment to tie benefits to account for capacity imports under this Section III.12.9.6.1, the capacity imports applicable for

determining tie benefits for the Forward Capacity Auction shall be the Qualified Existing Import Capacity Resources for the relevant Capacity Commitment Period, and the capacity imports applicable for determining tie benefits for the annual reconfiguration auctions are those Import Capacity Resources that hold Capacity Supply Obligations for the relevant Capacity Commitment Period as of the time the tie benefits calculation is being performed for the annual reconfiguration auction.

III.12.9.6.2. Changes in the Import Capability of Interconnections with Neighboring Control Areas.

For purposes of calculating tie benefits for the Forward Capacity Auction and third annual reconfiguration auction, the most recent import capability values for an interconnection or group of interconnections with a neighboring Control Area shall be reflected in the modeling of system conditions for the tie benefits calculation. In addition, for the first and second annual reconfiguration auctions, any changes to the import capability of an interconnection or group of interconnections with a neighboring Control Area shall be reflected in the adjustment to tie benefits to account for capacity imports under Section III.12.9.6.1.

III.12.9.7 Tie Benefits Over the HQ Phase I/II HVDC-TF.

The tie benefits from the Quebec Control Area over the HQ Phase I/II HVDC-TF calculated in accordance with Section III.12.9.1 shall be allocated to the Interconnection Rights Holders or their designees in proportion to their respective percentage shares of the HQ Phase I and the HQ Phase II facilities, in accordance with Section I of the Transmission, Markets and Services Tariff.

III.12.10 Calculating the Maximum Amount of Import Capacity Resources that May be Cleared Over External Interfaces in the Forward Capacity Auction and Reconfiguration Auctions.

For external interfaces, Import Capacity Resources shall be allowed in the Forward Capacity Auction and reconfiguration auctions up to the interface limit minus the tie benefits, calculated pursuant to Section III.12.9.1 or 12.9.2 over the applicable interface.

I.2 Rules of Construction; Definitions

I.2.1 Rules of Construction:

In this Tariff, unless otherwise provided herein:

- (a) words denoting the singular include the plural and vice versa;
- (b) words denoting a gender include all genders;
- (c) references to a particular part, clause, section, paragraph, article, exhibit, schedule, appendix or other attachment shall be a reference to a part, clause, section, paragraph, or article of, or an exhibit, schedule, appendix or other attachment to, this Tariff;
- (d) the exhibits, schedules and appendices attached hereto are incorporated herein by reference and shall be construed with an as an integral part of this Tariff to the same extent as if they were set forth verbatim herein;
- (e) a reference to any statute, regulation, proclamation, ordinance or law includes all statutes, regulations, proclamations, amendments, ordinances or laws varying, consolidating or replacing the same from time to time, and a reference to a statute includes all regulations, policies, protocols, codes, proclamations and ordinances issued or otherwise applicable under that statute unless, in any such case, otherwise expressly provided in any such statute or in this Tariff;
- (f) a reference to a particular section, paragraph or other part of a particular statute shall be deemed to be a reference to any other section, paragraph or other part substituted therefor from time to time;
- (g) a definition of or reference to any document, instrument or agreement includes any amendment or supplement to, or restatement, replacement, modification or novation of, any such document, instrument or agreement unless otherwise specified in such definition or in the context in which such reference is used;
- (h) a reference to any person (as hereinafter defined) includes such person's successors and permitted assigns in that designated capacity;
- (i) any reference to "days" shall mean calendar days unless "Business Days" (as hereinafter defined) are expressly specified;
- (j) if the date as of which any right, option or election is exercisable, or the date upon which any amount is due and payable, is stated to be on a date or day that is not a Business Day, such right, option or election may be exercised, and such amount shall be deemed due and payable, on the next succeeding Business Day with the same effect as if the same was exercised or made on such date or day (without, in the case of any such payment, the payment or accrual of any interest or

other late payment or charge, provided such payment is made on such next succeeding Business Day);

- (k) words such as “hereunder,” “hereto,” “hereof” and “herein” and other words of similar import shall, unless the context requires otherwise, refer to this Tariff as a whole and not to any particular article, section, subsection, paragraph or clause hereof; and a reference to “include” or “including” means including without limiting the generality of any description preceding such term, and for purposes hereof the rule of *ejusdem generis* shall not be applicable to limit a general statement, followed by or referable to an enumeration of specific matters, to matters similar to those specifically mentioned.

I.2.2. Definitions:

In this Tariff, the terms listed in this section shall be defined as described below:

Actual Load is the consumption at the Retail Delivery Point for the hour.

Adjusted Audited Demand Reduction is the Audited Demand Reduction of a Demand Response Resource adjusted in accordance with Section III.13.7.1.5.10.1.1.

Additional Resource Blackstart O&M Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Additional Resource Specified-Term Blackstart Capital Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Additional Resource Standard Blackstart Capital Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Administrative Costs are those costs incurred in connection with the review of Applications for transmission service and the carrying out of System Impact Studies and Facilities Studies.

Administrative Export De-List Bid is a bid that may be submitted in a Forward Capacity Auction by certain Existing Generating Capacity Resources subject to a multi-year contract to sell capacity outside of the New England Control Area during the associated Capacity Commitment Period, as described in Section III.13.1.2.3.1.4 of Market Rule 1.

Administrative Sanctions are defined in Section III.B.4.1.2 of Appendix B of Market Rule 1.

ADR Neutrals are one or more firms or individuals identified by the ISO with the advice and consent of the Participants Committee that are prepared to act as neutrals in ADR proceedings under Appendix D to Market Rule 1.

Advance is defined in Section IV.A.3.2 of the Tariff.

Affected Party, for purposes of the ISO New England Billing Policy, is defined in Section 6.3.5 of the ISO New England Billing Policy.

Affiliate is any person or entity that controls, is controlled by, or is under common control by another person or entity. For purposes of this definition, "control" means the possession, directly or indirectly, of the authority to direct the management or policies of an entity. A voting interest of ten percent or more shall create a rebuttable presumption of control.

AGC is automatic generation control.

Allocated Assessment is a Covered Entity's right to seek and obtain payment and recovery of its share in any shortfall payments under Section 3.3 or Section 3.4 of the ISO New England Billing Policy.

Alternative Capacity Price Rule is a rule potentially affecting Capacity Clearing Prices in a Forward Capacity Auction, as described in Section III.13.2.7.8 of Market Rule 1.

Alternative Dispute Resolution (ADR) is the procedure set forth in Appendix D to Market Rule 1.

Alternative Technologies Regulation Pilot Program is the pilot described in Appendix J to Market Rule 1.

Ancillary Services are those services that are necessary to support the transmission of electric capacity and energy from resources to loads while maintaining reliable operation of the New England Transmission System in accordance with Good Utility Practice.

Announced Schedule 1 EA Amount, Announced Schedule 2 EA Amount, Announced Schedule 3 EA Amount are defined in Section IV.B.2.2 of the Tariff.

Annual Transmission Revenue Requirements are the annual revenue requirements of a PTO's PTF or of all PTOs' PTF for purposes of the OATT shall be the amount determined in accordance with Attachment F to the OATT.

Annualized FCA Payment is used to determine a resource's availability penalties and is calculated in accordance with Section III.13.7.2.7.1.2(b) of Market Rule 1.

Applicants, for the purposes of the ISO New England Financial Assurance Policy, are entities applying for Market Participant status or for transmission service from the ISO.

Application is a written request by an Eligible Customer for transmission service pursuant to the provisions of the OATT.

APR-1 means the first of three Alternative Capacity Price Rule mechanisms described in Section III.13.2.7.8.

APR-2 means the second of three Alternative Capacity Price Rule mechanisms described in Section III.13.2.7.8.

APR-3 means the third of three Alternative Capacity Price Rule mechanisms described in Section III.13.2.7.8.

Asset is a generating unit, interruptible load, a component of a demand response resource or load asset.

Asset Registration Process is the ISO business process for registering a physical load, generator, or tie-line for settlement purposes. The Asset Registration Process is posted on the ISO's website.

Asset Related Demand is a physical load that has been discretely modeled within the ISO's dispatch and settlement systems, settles at a Node and, except for pumped storage load, is made up of one or more individual end-use metered customers receiving service from the same point or points of electrical supply, with an aggregate average hourly load of 1 MW or greater during the 12 months preceding its registration.

Asset Related Demand Bid Block-Hours are Block-Hours assigned to the Lead Market Participant for each Asset Related Demand bid. The daily bid Blocks in the price-based Real-Time bid will be multiplied by the number of hours in the day to determine the daily quantity of Asset Related Demand Bid Block-Hours. In the case that a Resource has a Real-Time unit status of “unavailable” for an entire day, that day will not contribute to the quantity of Asset Related Demand Bid Block-Hours. However, if the Resource has at least one hour of the day with a unit status of “available,” the entire day will contribute to the quantity of Asset Related Demand Bid Block-Hours.

Asset-Specific Going Forward Costs are the net risk-adjusted going forward costs of an asset that is part of an Existing Generating Capacity Resource, calculated for the asset in the same manner as the net-risk adjusted going forward costs of Existing Generating Capacity Resources as described in Section III.13.1.2.3.2.1.2.

Assigned Meter Reader reports to the ISO the hourly and monthly MWh associated with the Asset. These MWh are used for settlement. The Assigned Meter Reader may designate an agent to help fulfill its Assigned Meter Reader responsibilities; however, the Assigned Meter Reader remains functionally responsible to the ISO.

Auction Revenue Right (ARR) is a right to receive FTR Auction Revenues in accordance with Appendix C of Market Rule 1.

Auction Revenue Right Allocation (ARR Allocation) is defined in Section 1 of Appendix C of Market Rule 1.

Auction Revenue Right Holder (ARR Holder) is an entity which is the record holder of an Auction Revenue Right (excluding an Incremental ARR) in the register maintained by the ISO.

Audited Demand Reduction is the seasonal claimed capability of a Demand Response Resource as established pursuant to Section III.13.6.1.5.4.

Audited Full Reduction Time is the Offered Full Reduction Time associated with the Demand Response Resource’s most recent audit.

Authorized Commission is defined in Section 3.3 of the ISO New England Information Policy.

Authorized Person is defined in Section 3.3 of the ISO New England Information Policy.

Automatic Response Rate is the response rate, in MW/Minute, at which a Market Participant is willing to have a generating unit change its output while providing Regulation between the Regulation High Limit and Regulation Low Limit.

Average Hourly Load Reduction is either: (i) the sum of the Demand Resource's electrical energy reduction during Demand Resource On-Peak Hours in the month divided by the number of Demand Resource On-Peak Hours in the month; (ii) the sum of the Demand Resource's electrical energy reduction during Demand Resource Seasonal Peak Hours in the month divided by the number of Demand Resource Seasonal Peak Hours in the month; or (iii) in each Real-Time Demand Response Event Hour, the sum of the baseline electrical energy consumption less the sum of the actual electrical energy consumption of all of the Real-Time Demand Response Assets associated with the Real-Time Demand Response Resource as registered with the ISO as of the first day of the month; or (iv) in each Real-Time Emergency Generation Event Hour, the sum of the baseline electrical energy consumption less the sum of the actual electrical energy consumption of all of the Real-Time Emergency Generation Assets associated with the Real-time Emergency Generation Resource as registered with the ISO as of the first day of the month. The Demand Resource's electrical energy reduction and Average Hourly Load Reduction shall be determined consistent with the Demand Resource's Measurement and Verification Plan, which shall be reviewed by the ISO to ensure consistency with the measurement and verification requirements, as described in Section III.13.1.4.3 of Market Rule 1 and the ISO New England Manuals.

Average Hourly Output is either: (i) the sum of the Demand Resource's electrical energy output during Demand Resource On-Peak Hours in the month divided by the number of Demand Resource On-Peak Hours in the month; (ii) the sum of the Demand Resource's electrical energy output during Demand Resource Seasonal Peak Hours in the month divided by the number of Demand Resource Seasonal Peak Hours in the month; or (iii) in each Real-Time Demand Response Event Hour or Real-Time Emergency Generation Event Hour, the sum of the electrical energy output of all of the Real-Time Demand Response Assets or Real-Time Emergency Generation Assets associated with the Real-Time Demand Response Resource or Real-Time Emergency Generation Resource as registered with the ISO as of the first day of the month. Electrical energy output and Average Hourly Output shall be determined consistent with the Demand Resource's Measurement and Verification Plan, which shall be reviewed by the ISO to ensure

consistency with the measurement and verification requirements, as described in Section III.13.1.4.3 of Market Rule 1 and the ISO New England Manuals.

Average Monthly PER is calculated in accordance with Section III.13.7.2.7.1.1.2(a) of Market Rule 1.

Bankruptcy Code is the United States Bankruptcy Code.

Bankruptcy Event occurs when a Covered Entity files a voluntary or involuntary petition in bankruptcy or commences a proceeding under the United States Bankruptcy Code or any other applicable law concerning insolvency, reorganization or bankruptcy by or against such Covered Entity as debtor.

Bilateral Contract (BC) is any of the following types of contracts: Internal Bilateral for Load, Internal Bilateral for Market for Energy, and External Transactions.

Bilateral Contract Block-Hours are Block-Hours assigned to the seller and purchaser of an Internal Bilateral for Load, Internal Bilateral for Market for Energy and External Transactions; provided, however, that only those contracts which apply to the Real-Time Energy Market will accrue Block-Hours.

Blackstart Capability Test is the test, required by ISO New England Operating Documents, of a resource's capability to provide Blackstart Service.

Blackstart Capital Payment is the annual compensation, as calculated pursuant to Section 5.1, or as referred to in Section 5.2, of Schedule 16 to the OATT, for a Designated Blackstart Resource's Blackstart Equipment capital costs associated with the provision of Blackstart Service (excluding the capital costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Blackstart CIP Capital Payment is the annual compensation level, as calculated pursuant to Section 5.1 utilizing data from Table 6 of Appendix A to this Schedule 16, or as referred to in Section 5.2, of Schedule 16 to the OATT, for a Blackstart Station's costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service.

Blackstart CIP O&M Payment is the annual compensation level, as calculated pursuant to Section 5.1 of Schedule 16 to the OATT, utilizing data from Table 6 of Appendix A to this Schedule 16, for a

Blackstart Station's operating and maintenance costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of the provision of Blackstart Service.

Blackstart Equipment is any equipment that is solely necessary to enable the Designated Blackstart Resource to provide Blackstart Service and is not required to provide other products or services under the Tariff.

Blackstart O&M Payment is the annual compensation, as calculated pursuant to Section 5.1 of Schedule 16 to the OATT, for a Designated Blackstart Resource's operating and maintenance costs associated with the provision of Blackstart Service (except for operating and maintenance costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Blackstart Owner is the Market Participant who is authorized on behalf of the Generator Owner(s) to offer or operate the resource as a Designated Blackstart Resource and is authorized to commit the resource to provide Blackstart Service.

Blackstart Service is the Ancillary Service described in Section II.47 of the Tariff and Schedule 16 of the OATT, which also encompasses "System Restoration and Planning Service" under the predecessor version of Schedule 16.

Blackstart Service Commitment is the commitment by a Blackstart Owner for its resource to provide Blackstart Service and the acceptance of that commitment by the ISO, in the manner detailed in ISO New England Operating Procedure No. 11 – Designated Blackstart Resource Administration (OP 11), and which includes a commitment to provide Blackstart Service under a "Signature Page for Schedule 16 of the NEPOOL OATT" that was executed and in effect prior to January 1, 2013 for Category A Designated Blackstart Resources or a commitment to provide Blackstart Service established under Operating Procedure 11 – Designated Blackstart Resource Administration (OP11) for Category B Designated Blackstart Resources.

Blackstart Service Minimum Criteria are the minimum criteria that a Blackstart Owner and its resource must meet in order to establish and maintain a resource as a Designated Blackstart Resource.

Blackstart Standard Rate Payment is the formulaic rate of monthly compensation, as calculated pursuant to Section 5 of Schedule 16 to the OATT, paid to a Blackstart Owner for the provision of Blackstart Service from a Designated Blackstart Resource.

Blackstart Station is comprised of (i) a single Designated Blackstart Resource or (ii) two or more Designated Blackstart Resources that share Blackstart Equipment.

Blackstart Station-specific Rate Payment is the Commission-approved compensation, as calculated pursuant to Section 5.2 of Schedule 16 to the OATT, paid to a Blackstart Owner on a monthly basis for the provision of Blackstart Service by Designated Blackstart Resources located at a specific Blackstart Station.

Blackstart Station-specific Rate Capital Payment is a component of the Blackstart Station-specific Rate Payment that reflects a Blackstart Station's capital Blackstart Equipment costs associated with the provision of Blackstart Service (excluding the capital costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Blackstart Station-specific Rate CIP Capital Payment is a component of the Blackstart Station-specific Rate Payment that reflects a Blackstart Station's capital costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service.

Block is defined as follows: (1) With respect to Bilateral Contracts, a Bilateral Contract administered by the ISO for an hour; (2) with respect to Supply Offers administered by the ISO, a quantity with a related price for Energy (Supply Offers for Energy may contain multiple sets of quantity and price pairs for the day); (3) with respect to Demand Bids administered by the ISO, a quantity with a related price for Energy (Demand Bids for Energy may contain multiple sets of quantity and price pairs for each hour); (4) with respect to Increment Offers administered by the ISO, a quantity with a related price for Energy (Increment Offers for Energy may contain multiple sets of quantity and price pairs for each hour); (5) with respect to Decrement Bids administered by the ISO, a quantity with a related price for Energy (Decrement Bids for Energy may contain multiple sets of quantity and price pairs for each hour); (6) with respect to Asset Related Demand bids administered by the ISO, a quantity with a related price for Energy (Asset Related Demand bids may contain multiple sets of quantity and price pairs for each hour); and (7) with respect to Demand Reduction Offers administered by the ISO, a quantity of reduced demand with a

related price (for Capacity Commitment Periods commencing on or after June 1, 2017, Demand Reduction Offers may contain multiple sets of quantity and price pairs for the day).

Block-Hours are the number of Blocks administered for a particular hour.

Budget and Finance Subcommittee is a subcommittee of the Participants Committee, the responsibilities of which are specified in Section 8.4 of the Participants Agreement.

Business Day is any day other than a Saturday or Sunday or ISO holidays as posted by the ISO on its website.

Cancellation Fee is defined in Section III.1.10.2(d).

Cancelled Start Credit is a credit calculated pursuant to Section III.F.2.5 of Appendix F to Market Rule 1 as the NCPC Credit due to each Market Participant for pool-scheduled generating Resources that were scheduled by the ISO to start after the close of the Day-Ahead Energy Market and that were cancelled by the ISO prior to their assigned commitment time.

Capability Demonstration Year is the one year period from September 1 through August 31.

Capability Year means a year's period beginning on June 1 and ending May 31.

Capacity Acquiring Resource is a resource that is seeking to acquire a Capacity Supply Obligation through a Capacity Supply Obligation Bilateral, as described in Section III.13.5.1 of Market Rule 1.

Capacity Balancing Ratio is a ratio used in calculating the Capacity Performance Payment in the Forward Capacity Market beginning on June 1, 2018 pursuant to rules filed with the Commission on January 17, 2014.

Capacity Capability Interconnection Standard has the meaning specified in Schedule 22 and Schedule 23 of the OATT.

Capacity Carried Forward Due to Rationing is described in Section III.13.2.7.8.2.1(c)(b)(ii) of Market Rule 1.

Capacity Clearing Price is the clearing price for a Capacity Zone for a Capacity Commitment Period resulting from the Forward Capacity Auction conducted for that Capacity Commitment Period, as determined in accordance with Section III.13.2.7 of Market Rule 1.

Capacity Clearing Price Floor is described in Section III.13.2.7.

Capacity Commitment Period is the one-year period from June 1 through May 31 for which obligations are assumed and payments are made in the Forward Capacity Market.

Capacity Cost (CC) is one of four forms of compensation that may be paid to resources providing VAR Service under Schedule 2 of the OATT.

Capacity Export Through Import Constrained Zone Transaction is defined in Section III.1.10.7(f)(i) of Market Rule 1.

Capacity Load Obligation is the quantity of capacity for which a Market Participant is financially responsible, equal to that Market Participant's Capacity Requirement (if any) adjusted to account for any relevant Capacity Load Obligation Bilaterals, as described in Section III.13.7.3.1 of Market Rule 1.

Capacity Load Obligation Acquiring Participant is a load serving entity or any other Market Participant seeking to acquire a Capacity Load Obligation through a Capacity Load Obligation Bilateral, as described in Section III.13.5.2 of Market Rule 1.

Capacity Load Obligation Bilateral is a bilateral contract through which a Market Participant may transfer all or a portion of its Capacity Load Obligation to another entity, as described in Section III.13.5 of Market Rule 1.

Capacity Load Obligation Transferring Participant is an entity that has a Capacity Load Obligation and is seeking to shed such obligation through a Capacity Load Obligation Bilateral, as described in Section III.13.5.2 of Market Rule 1.

Capacity Network Resource (CNR) is defined in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Capacity Network Resource Interconnection Service is defined in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Capacity Performance Payment is the performance-dependent portion of revenue received in the Forward Capacity Market beginning on June 1, 2018 pursuant to rules filed with the Commission on January 17, 2014.

Capacity Rationing Rule addresses whether offers and bids in a Forward Capacity Auction may be rationed, as described in Section III.13.2.6 of Market Rule 1.

Capacity Requirement is described in Section III.13.7.3.1 of Market Rule 1.

Capacity Supply Obligation is an obligation to provide capacity from a resource, or a portion thereof, to satisfy a portion of the Installed Capacity Requirement that is acquired through a Forward Capacity Auction in accordance with Section III.13.2, a reconfiguration auction in accordance with Section III.13.4, or a Capacity Supply Obligation Bilateral in accordance with Section III.13.5.1 of Market Rule 1.

Capacity Supply Obligation Bilateral is a bilateral contract through which a Market Participant may transfer all or a part of its Capacity Supply Obligation to another entity, as described in Section III.13.5.1 of Market Rule 1.

Capacity-to-Service Ratio is defined in Section III.3.2.2(h) of Market Rule 1.

Capacity Transfer Right (CTR) is a financial right that entitles the holder to the difference in the Net Regional Clearing Prices between Capacity Zones for which the transfer right is defined, in the MW amount of the holder's entitlement.

Capacity Transferring Resource is a resource that has a Capacity Supply Obligation and is seeking to shed such obligation, or a portion thereof, through a Capacity Supply Obligation Bilateral, as described in Section III.13.5.1 of Market Rule 1.

Capacity Value is the value (in kW-month) of a Demand Resource for a month determined pursuant to Section III.13.7.1.5 of Market Rule 1.

Capacity Zone is a geographic sub-region of the New England Control Area as determined in accordance with Section III.12.4 of Market Rule 1.

Capital Funding Charge (CFC) is defined in Section IV.B.2 of the Tariff.

CARL Data is Control Area reliability data submitted to the ISO to permit an assessment of the ability of an external Control Area to provide energy to the New England Control Area in support of capacity offered to the New England Control Area by that external Control Area.

Carried Forward Excess Capacity is calculated as described in Section III.13.2.7.8.2.1(c) of Market Rule 1.

Category A Designated Blackstart Resource is a Designated Blackstart Resource that has committed to provide Blackstart Service under a “Signature Page for Schedule 16 of the NEPOOL OATT” that was executed and in effect prior to January 1, 2013 and has not been converted to a Category B Designated Blackstart Resource.

Category B Designated Blackstart Resource is a Designated Blackstart Resource that is not a Category A Designated Blackstart Resource.

Charge is a sum of money due from a Covered Entity to the ISO, either in its individual capacity or as billing and collection agent for NEPOOL pursuant to the Participants Agreement.

CLAIM10 is the value, expressed in megawatts, calculated pursuant to Section III.9.5.3 of the Tariff.

CLAIM30 is the value, expressed in megawatts, calculated pursuant to Section III.9.5.3 of the Tariff.

Claimed Capability Audit is performed to determine the real power output capability of a Generator Asset.

CNR Capability is defined in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Coincident Peak Contribution is a Market Participant's share of the New England Control Area coincident peak demand for the prior calendar year as determined prior to the start of each power year, which reflects the sum of the prior year's annual coincident peak contributions of the customers served by the Market Participant at each Load Asset in all Load Zones. Daily Coincident Peak Contribution values shall be submitted by the Assigned Meter Reader or Host Participant by the meter reading deadline to the ISO.

Cold Weather Conditions means any calendar day when that day's Effective Temperatures are forecast to be equal to or less than zero degrees Fahrenheit for any single on-peak hour and that day's total Effective Heating Degree Days are forecast to be greater than or equal to 65.

Cold Weather Event means days when Cold Weather Conditions are forecast to exist and the Seven-Day Forecast indicates a capacity margin less than or equal to 0 MW for an Operating Day. Cold Weather Events are declared by 1100 two days prior to the Operating Day. A Cold Weather Warning will be used for all future days within the Seven-Day Forecast when a capacity margin of less than or equal to 0 MW exists, until such time that the ISO declares a Cold Weather Event.

Cold Weather Warning means days when Cold Weather Conditions are forecast to exist and the Seven-Day Forecast indicates a capacity margin less than 1,000 MW. In addition, a Cold Weather Warning will be used for all future days within the Seven-Day Forecast when a capacity margin of less than or equal to 0 MW exists for days not yet declared as a Cold Weather Event.

Cold Weather Watch means days when Cold Weather Conditions are forecast to exist and the Seven-Day Forecast indicates a capacity margin greater than or equal to 1,000 MW.

Commercial Capacity, for the purposes of the ISO New England Financial Assurance Policy, is defined in Section VII.A of that policy.

Commission is the Federal Energy Regulatory Commission.

Common Costs are those costs associated with a Station that are avoided only by (1) the clearing of the Static De-List Bids or the Permanent De-List Bids of all the Existing Generating Capacity Resources comprising the Station; or (2) the acceptance of a Non-Price Retirement Request of the Station.

Completed Application is an Application that satisfies all of the information and other requirements of the OATT, including any required deposit.

Compliance Effective Date is the date upon which the changes in the predecessor NEPOOL Open Access Transmission Tariff which have been reflected herein to comply with the Commission's Order of April 20, 1998 became effective.

Composite FCM Transaction is a transaction for separate resources seeking to participate as a single composite resource in a Forward Capacity Auction in which multiple Designated FCM Participants provide capacity, as described in Section III.13.1.5 of Market Rule 1.

Conditional Qualified New Generating Capacity Resource is defined in Section III.13.1.1.2.3(f) of Market Rule 1.

Confidential Information is defined in Section 2.1 of the ISO New England Information Policy, which is Attachment D to the Tariff.

Confidentiality Agreement is Attachment 1 to the ISO New England Billing Policy.

Congestion is a condition of the New England Transmission System in which transmission limitations prevent unconstrained regional economic dispatch of the power system. Congestion is the condition that results in the Congestion Component of the Locational Marginal Price at one Location being different from the Congestion Component of the Locational Marginal Price at another Location during any given hour of the dispatch day in the Day-Ahead Energy Market or Real-Time Energy Market.

Congestion Component is the component of the nodal price that reflects the marginal cost of congestion at a given Node or External Node relative to the reference point. When used in connection with Zonal Price and Hub Price, the term Congestion Component refers to the Congestion Components of the nodal prices that comprise the Zonal Price and Hub Price weighted and averaged in the same way that nodal prices are weighted to determine Zonal Price and averaged to determine the Hub Price.

Congestion Cost is the cost of congestion as measured by the difference between the Congestion Components of the Locational Marginal Prices at different Locations and/or Reliability Regions on the New England Transmission System.

Congestion Paying LSE is, for the purpose of the allocation of FTR Auction Revenues to ARR Holders as provided for in Appendix C of Market Rule 1, a Market Participant or Non-Market Participant Transmission Customer that is responsible for paying for Congestion Costs as a Transmission Customer paying for Regional Network Service under the Transmission, Markets and Services Tariff, unless such Transmission Customer has transferred its obligation to supply load in accordance with ISO New England System Rules, in which case the Congestion Paying LSE shall be the Market Participant supplying the transferred load obligation. The term Congestion Paying LSE shall be deemed to include, but not be limited to, the seller of internal bilateral transactions that transfer Real-Time Load Obligations under the ISO New England System Rules.

Congestion Revenue Fund is the amount available for payment of target allocations to FTR Holders from the collection of Congestion Cost.

Congestion Shortfall means congestion payments exceed congestion charges during the billing process in any billing period.

Control Agreement is the document posted on the ISO website that is required if a Market Participant's cash collateral is to be invested in BlackRock funds.

Control Area is an electric power system or combination of electric power systems to which a common automatic generation control scheme is applied in order to:

- (1) match, at all times, the power output of the generators within the electric power system(s) and capacity and energy purchased from entities outside the electric power system(s), with the load within the electric power system(s);
- (2) maintain scheduled interchange with other Control Areas, within the limits of Good Utility Practice;
- (3) maintain the frequency of the electric power system(s) within reasonable limits in accordance with Good Utility Practice and the criteria of the applicable regional reliability council or the North American Electric Reliability Corporation; and
- (4) provide sufficient generating capacity to maintain operating reserves in accordance with Good Utility Practice.

Correction Limit means the date that is one hundred and one (101) calendar days from the last Operating Day of the month to which the data applied. As described in Section III.3.6.1 of Market Rule 1, this will be the period during which meter data corrections must be submitted unless they qualify for submission as a Requested Billing Adjustment under Section III.3.7 of Market Rule 1.

Cost of Energy Consumed (CEC) is one of four forms of compensation that may be paid to resources providing VAR Service under Schedule 2 of the OATT.

Cost of Energy Produced (CEP) is one of four forms of compensation that may be paid to resources providing VAR Service under Schedule 2 of the OATT.

Cost of New Entry (CONE) is the estimated cost of new entry (\$/kW-month) for a capacity resource that is determined by the ISO for each Forward Capacity Auction pursuant to Section III.13.2.4.

Counterparty means the status in which the ISO acts as the contracting party, in its name and own right and not as an agent, to an agreement or transaction with a Customer (including assignments involving Customers) involving sale to the ISO, and/or purchase from the ISO, of Regional Transmission Service and market and other products and services, and other transactions and assignments involving Customers, all as described in the Tariff.

Covered Entity is defined in the ISO New England Billing Policy.

Credit Coverage is third-party credit protection obtained by the ISO, in the form of credit insurance coverage, a performance or surety bond, or a combination thereof.

Credit Qualifying means a Rated Market Participant that has an Investment Grade Rating and an Unrated Market Participant that satisfies the Credit Threshold.

Credit Threshold consists of the conditions for Unrated Market Participants outlined in Section II.B.2 of the ISO New England Financial Assurance Policy.

Critical Energy Infrastructure Information (CEII) is defined in Section 3.0(j) of the ISO New England Information Policy, which is Attachment D to the Tariff.

Current Ratio is, on any date, all of a Market Participant's or Non-Market Participant Transmission Customer's current assets divided by all of its current liabilities, in each case as shown on the most recent financial statements provided by such Market Participant or Non-Market Participant Transmission Customer to the ISO.

Curtailed is a reduction in the dispatch of a transaction that was scheduled, using transmission service, in response to a transfer capability shortage as a result of system reliability conditions.

Customer is a Market Participant, a Transmission Customer or another customer of the ISO.

Data Reconciliation Process means the process by which meter reconciliation and data corrections that are discovered by Governance Participants after the Invoice has been issued for a particular month or that are discovered prior to the issuance of the Invoice for the relevant month but not included in that Invoice or in the other Invoices for that month and are reconciled by the ISO on an hourly basis based on data submitted to the ISO by the Host Participant Assigned Meter Reader or Assigned Meter Reader.

Day-Ahead is the calendar day immediately preceding the Operating Day.

Day-Ahead Adjusted Load Obligation is defined in Section III.3.2.1(a)(iii) of Market Rule 1.

Day-Ahead Congestion Revenue is defined in Section III.3.2.1(f) of Market Rule 1.

Day-Ahead Demand Reduction Obligation is a cleared Demand Reduction Offer multiplied by one plus the percent average avoided peak distribution losses. For Capacity Commitment Periods commencing on or after June 1, 2017, Day-Ahead Demand Reduction Obligation is the hourly demand reduction amounts of a Demand Response Resource scheduled by the ISO as a result of the Day-Ahead Energy Market, multiplied by one plus the percent average avoided peak distribution losses.

Day-Ahead Energy Market means the schedule of commitments for the purchase or sale of energy, payment of Congestion Costs, payment for losses developed by the ISO as a result of the offers and specifications submitted in accordance with Section III.1.10 of Market Rule 1 and purchase of demand reductions pursuant to Appendix III.E2 of Market Rule 1 for Capacity Commitment Periods commencing on or after June 1, 2017.

Day-Ahead Energy Market Congestion Charge/Credit is defined in Section III.3.2.1(d) of Market Rule 1.

Day-Ahead Energy Market Energy Charge/Credit is defined in Section III.3.2.1(d) of Market Rule 1.

Day-Ahead Energy Market Loss Charge/Credit is defined in Section III.3.2.1(d) of Market Rule 1.

Day-Ahead Generation Obligation is defined in Section III.3.2.1(a)(ii) of Market Rule 1.

Day-Ahead Load Obligation is defined in Section III.3.2.1(a)(i) of Market Rule 1.

Day-Ahead Load Response Program provides a Day-Ahead aspect to the Load Response Program. The Day-Ahead Load Response Program allows Market Participants with registered Load Response Program Assets to make energy reduction offers into the Day-Ahead Load Response Program concurrent with the Day-Ahead Energy Market.

Day-Ahead Locational Adjusted Net Interchange is defined in Section III.3.2.1(a)(iv) of Market Rule 1.

Day-Ahead Loss Charges or Credits is defined in Section III.3.2.1(h) of Market Rule 1.

Day-Ahead Loss Revenue is defined in Section III.3.2.1(g) of Market Rule 1.

Day-Ahead Prices means the Locational Marginal Prices resulting from the Day-Ahead Energy Market.

Debt-to-Total Capitalization Ratio is, on any date, a Market Participant's or Non-Market Participant Transmission Customer's total debt (including all current borrowings) divided by its total shareholders' equity plus total debt, in each case as shown on the most recent financial statements provided by such Market Participant or Non-Market Participant Transmission Customer to the ISO.

Decrement Bid means a bid to purchase energy at a specified Location in the Day-Ahead Energy Market which is not associated with a physical load. An accepted Decrement Bid results in scheduled load at the specified Location in the Day-Ahead Energy Market.

Default Amount is all or any part of any amount due to be paid by any Covered Entity that the ISO, in its reasonable opinion, believes will not or has not been paid when due (other than in the case of a payment dispute for any amount due for transmission service under the OATT).

Default Period is defined in Section 3.3.h(i) of the ISO New England Billing Policy.

Delivering Party is the entity supplying capacity and/or energy to be transmitted at Point(s) of Receipt under the OATT.

Demand Bid means a request to purchase an amount of energy, at a specified Location, or an amount of energy at a specified price, that is associated with a physical load. A cleared Demand Bid in the Day-Ahead Energy Market results in scheduled load at the specified Location. Demand Bids submitted for use in the Real-Time Energy Market are specific to Dispatchable Asset Related Demands only.

Demand Bid Block-Hours are the Block-Hours assigned to the submitting Customer for each Demand Bid.

Demand Designated Entity is the entity designated by a Market Participant to receive Dispatch Instructions for Demand Response Resources, Real-Time Demand Response Resources and Real-Time Emergency Generation Resources in accordance with the provisions set forth in ISO New England Operating Procedure No. 14.

Demand Reduction Offer is an offer by a Market Participant with a Real-Time Demand Response Asset to reduce demand. For Capacity Commitment Periods commencing on or after June 1, 2017, Demand Reduction Offer is an offer by a Market Participant with a Demand Response Resource to reduce demand.

Demand Reduction Threshold Price is a minimum offer price calculated pursuant to Section III.E1.6 and Section III.E2.6.

Demand Reduction Value is the quantity of reduced demand calculated pursuant to Section III.13.7.1.5.3 of Market Rule 1.

Demand Resource is a resource defined as Demand Response Capacity Resources, On-Peak Demand Resources, Seasonal Peak Demand Resources, Real-Time Demand Response Resources, or Real-Time

Emergency Generation Resources. Demand Resources are installed measures (i.e., products, equipment, systems, services, practices and/or strategies) that result in additional and verifiable reductions in end-use demand on the electricity network in the New England Control Area pursuant to Appendix III.E1 and Appendix III.E2 of Market Rule 1, or during Demand Resource On-Peak Hours, Demand Resource Seasonal Peak Hours, Real-Time Demand Response Event Hours, or Real-Time Emergency Generation Event Hours, respectively. A Demand Resource may include a portfolio of measures aggregated together to meet or exceed the minimum Resource size requirements of the Forward Capacity Auction.

Demand Resource Commercial Operation Audit is an audit initiated pursuant to Section III.13.6.1.5.4.4.

Demand Resource Forecast Peak Hours are those hours, or portions thereof, in which, absent the dispatch of Real-Time Demand Response Resources, Dispatch Zone, Load Zone, or system-wide implementation of the action of ISO New England Operating Procedure No. 4 where the ISO would have begun to allow the depletion of Thirty-Minute Operating Reserve is forecasted in the ISO's most recent next-day forecast.

Demand Resource On-Peak Hours are hours ending 1400 through 1700, Monday through Friday on non-Demand Response Holidays during the months of June, July, and August and hours ending 1800 through 1900, Monday through Friday on non-Demand Response Holidays during the months of December and January.

Demand Resource Operable Capacity Analysis means an analysis performed by the ISO estimating the expected dispatch hours of active Demand Resources given different assumed levels of Demand Resources clearing in the primary Forward Capacity Auction.

Demand Resource Performance Incentives means the additional monthly capacity payment that a Demand Resource may earn for producing a positive Monthly Capacity Variance in a period where other Demand Resources yield a negative monthly capacity variance.

Demand Resource Performance Penalties means the reduction in the monthly capacity payment to a Demand Resource for producing a negative Monthly Capacity Variance.

Demand Resource Seasonal Peak Hours are those hours in which the actual, real-time hourly load, as measured using real-time telemetry (adjusted for transmission and distribution losses, and excluding load associated with Exports and the pumping load associated with pumped storage generators) for Monday through Friday on non-Demand Response Holidays, during the months of June, July, August, December, and January, as determined by the ISO, is equal to or greater than 90% of the most recent 50/50 system peak load forecast, as determined by the ISO, for the applicable summer or winter season.

Demand Response Asset is the electricity consumption of an individual end-use customer at a Retail Delivery Point or the aggregated electricity consumption of multiple end use customers from multiple delivery points that meets the registration requirements in Section III.E2.2.

Demand Response Available is the capability of the Demand Response Resource, in whole or in part, at any given time, to reduce demand in response to a Dispatch Instruction.

Demand Response Baseline is the expected baseline demand of an individual end-use metered customer or group of end-use metered customers or the expected output levels of the generation of an individual end-use metered customer whose asset is comprised of Distributed Generation as determined pursuant to Section III.8A or Section III.8B.

Demand Response Capacity Resource is one or more Demand Response Resources located within the same Dispatch Zone, that is registered with the ISO, assigned a unique resource identification number by the ISO, and participates in the Forward Capacity Market to fulfill a Market Participant's Capacity Supply Obligation pursuant to Section III.13 of Market Rule 1.

Demand Response Holiday is New Year's Day, Memorial Day, Independence Day, Labor Day, Veterans Day, Thanksgiving Day, and Christmas Day. If the holiday falls on a Saturday, the holiday will be observed on the preceding Friday; if the holiday falls on a Sunday, the holiday will be observed on the following Monday.

Demand Response Resource is an individual Demand Response Asset or aggregation of Demand Response Assets within a Dispatch Zone that meets the registration requirements and participates in the Energy Market pursuant to Appendix III.E2 of Market Rule 1 for Capacity Commitment Periods commencing on or after June 1, 2017.

Demand Response Resource Notification Time is the minimum time, from the receipt of a Dispatch Instruction, that it takes a Demand Response Resource that was not previously reducing demand to start reducing demand.

Demand Response Resource Ramp Rate is the average rate, expressed in MW per minute, at which the Demand Response Resource can reduce demand.

Demand Response Resource Start-Up Time is the time required from the time a Demand Response Resource that was not previously reducing demand starts reducing demand in response to a Dispatch Instruction and the time the resource achieves its Minimum Reduction.

Designated Agent is any entity that performs actions or functions required under the OATT on behalf of the ISO, a Transmission Owner, a Schedule 20A Service Provider, an Eligible Customer, or a Transmission Customer.

Designated Blackstart Resource is a resource that meets the eligibility requirements specified in Schedule 16 of the OATT, and may be a Category A Designated Blackstart Resource or a Category B Designated Blackstart Resource.

Designated Entity is the entity designated by a Market Participant to receive Dispatch Instructions for generation and/or Dispatchable Asset Related Demand in accordance with the provisions set forth in ISO New England Operating Procedure No. 14.

Designated FCM Participant is any Lead Market Participant, including any Provisional Member that is a Lead Market Participant, transacting in any Forward Capacity Auction, reconfiguration auctions or Capacity Supply Obligation Bilateral for capacity that is otherwise required to provide additional financial assurance under the ISO New England Financial Assurance Policy.

Designated FTR Participant is a Market Participant, including FTR-Only Customers, transacting in the FTR Auction that is otherwise required to provide additional financial assurance under the ISO New England Financial Assurance Policy.

Desired Dispatch Point (DDP) is the Dispatch Rate expressed in megawatts.

Direct Assignment Facilities are facilities or portions of facilities that are constructed for the sole use/benefit of a particular Transmission Customer requesting service under the OATT or a Generator Owner requesting an interconnection. Direct Assignment Facilities shall be specified in a separate agreement among the ISO, Interconnection Customer and Transmission Customer, as applicable, and the Transmission Owner whose transmission system is to be modified to include and/or interconnect with the Direct Assignment Facilities, shall be subject to applicable Commission requirements, and shall be paid for by the Customer in accordance with the applicable agreement and the Tariff.

Directly Metered Assets are specifically measured by OP-18 compliant metering as currently described in Section IV (Metering and Recording for Settlements) of OP-18. Directly Metered Assets include all Tie-Line Assets, all Generator Assets, as well as some Load Assets. Load Assets for which the Host Participant is not the Assigned Meter Reader are considered Directly Metered Assets. In addition, the Host Participant Assigned Meter Reader determines which additional Load Assets are considered Directly Metered Assets and which ones are considered Profiled Load Assets based upon the Host Participant Assigned Meter Reader reporting systems and process by which the Host Participant Assigned Meter Reader allocates non-PTF losses.

Disbursement Agreement is the Rate Design and Funds Disbursement Agreement among the PTOs, as amended and restated from time to time.

Dispatch Instruction means directions given by the ISO to Market Participants, which may include instructions to start up, shut down, raise or lower generation, curtail or restore loads from Demand Resources, change External Transactions, or change the status of a Dispatchable Asset Related Demand in accordance with the Resource's or contract's Supply Offer or Demand Bid parameters. Such instructions may also require a change to the operation of a Pool Transmission Facility. Such instructions are given through either electronic or verbal means.

Dispatch Rate means the control signal, expressed in dollars per MWh and/or megawatts, calculated and transmitted to direct the output level of each generating Resource and each Dispatchable Asset Related Demand and each Demand Response Resource dispatched by the ISO in accordance with the Offer Data.

Dispatch Zone means a subset of Nodes located within a Load Zone established by the ISO for each Capacity Commitment Period pursuant to Section III.13.1.4.6.1.

Dispatchable Asset Related Demand is any portion of an Asset Related Demand of a Market Participant that is capable of having its energy consumption modified in Real-Time in response to Dispatch Instructions has Electronic Dispatch Capability, and must be able to increase or decrease energy consumption between its Minimum Consumption Limit and Maximum Consumption Limit in accordance with Dispatch Instructions and must meet the technical requirements specified in the ISO New England Manuals. Pumped storage facilities may qualify as Dispatchable Asset Related Demand resources, however, such resources shall not qualify as a capacity resource for both the generating output and dispatchable pumping demand of the facility.

Dispute Representatives are defined in 6.5.c of the ISO New England Billing Policy.

Disputed Amount is a Covered Entity's disputed amount due on any fully paid monthly Invoice and/or any amount believed to be due or owed on a Remittance Advice, as defined in Section 6 of the ISO New England Billing Policy.

Disputing Party, for the purposes of the ISO New England Billing Policy, is any Covered Entity seeking to recover a Disputed Amount.

Distributed Generation means generation resources directly connected to end-use customer load and located behind the end-use customer's meter, which reduce the amount of energy that would otherwise have been produced by other capacity resources on the electricity network in the New England Control Area during Demand Resource On-Peak Hours, Demand Resource Seasonal Peak Hours, Real-Time Demand Response Event Hours, or Real-Time Emergency Generation Event Hours, provided that the aggregate nameplate capacity of the generation resource does not exceed 5 MW, or does not exceed the most recent annual non-coincident peak demand of the end-use metered customer at the location where the generation resource is directly connected, whichever is greater. Generation resources cannot participate in the Forward Capacity Market or the Energy Markets as Demand Resources or Demand Response Resources, unless they meet the definition of Distributed Generation.

Do Not Exceed Dispatch Point is a Dispatch Instruction indicating a maximum output level that a wind resource must not exceed.

DR Auditing Period is the summer DR Auditing Period or winter DR Auditing Period as defined in Section III.13.6.1.5.4.3.1.

Dynamic De-List Bid is a bid that may be submitted by Existing Generating Capacity Resources, Existing Import Capacity Resources, and Existing Demand Resources in the Forward Capacity Auction at or below the Dynamic De-List Bid Threshold, as described in Section III.13.2.3.2(d) of Market Rule 1.

Dynamic De-List Bid Threshold is the price specified in Section III.13.1.2.3.1.A of Market Rule 1 associated with the submission of Dynamic De-List Bids in the Forward Capacity Auction.

EA Amount is defined in Section IV.B.2.2 of the Tariff.

Early Amortization Charge (EAC) is defined in Section IV.B.2 of the Tariff.

Early Amortization Working Capital Charge (EAWCC) is defined in Section IV.B.2 of the Tariff.

Early Payment Shortfall Funding Amount (EPSF Amount) is defined in Section IV.B.2.4 of the Tariff.

Early Payment Shortfall Funding Charge (EPSFC) is defined in Section IV.B.2 of the Tariff.

EAWW Amount is defined in Section IV.B.2.3 of the Tariff.

EBITDA-to-Interest Expense Ratio is, on any date, a Market Participant's or Non-Market Participant Transmission Customer's earnings before interest, taxes, depreciation and amortization in the most recent fiscal quarter divided by that Market Participant's or Non-Market Participant Transmission Customer's expense for interest in that fiscal quarter, in each case as shown on the most recent financial statements provided by such Market Participant or Non-Market Participant Transmission Customer to the ISO.

Economic Maximum Limit or Economic Max is the maximum available output, in MW, of a resource that a Market Participant offers to supply in the Day-Ahead Energy Market or Real-Time Energy Market, as reflected in the resource's Supply Offer. This represents the highest MW output a Market Participant has offered for a resource for economic dispatch. A Market Participant must maintain an up-to-date Economic Maximum Limit for all hours in which a resource has been offered into the Day-Ahead Energy Market or Real-Time Energy Market.

Economic Minimum Limit or Economic Min is the maximum of the following values: (i) the Emergency Minimum Limit; (ii) a level supported by environmental and/or operating permit restrictions; or (iii) a level that addresses any significant economic penalties associated with operating at lower levels that can not be adequately represented by three part bidding (Start-Up Fee, No-Load Fee and incremental energy price). In no event shall the Economic Minimum Limit submitted as part of a generating unit's Offer Data be higher than the generation level at which a generating unit's incremental heat rate is minimized (i.e., transitioning from decreasing as output increases to increasing as output increases) except that a Self-Scheduled Resource may modify its Economic Minimum Limit on an hourly basis, as part of its Supply Offer, in order to indicate the desired level of Self-Scheduled MWs.

Economic Study is defined in Section 4.1(b) of Attachment K to the OATT.

EFT is electronic funds transfer.

Effective Heating Degree Days is equal to $68 - (\text{average of max and min Effective Temperature of the day})$.

Effective Temperature is equal to $\text{dry bulb temperature} - [\text{windspeed} \times (65 - \text{dry bulb temp}) / 100]$.

Elective Transmission Upgrade is a Transmission Upgrade that is participant-funded (i.e., voluntarily funded by an entity or entities that have agreed to pay for all of the costs of such Transmission Upgrade), and is not: (i) a Generator Interconnection Related Upgrade; (ii) a Reliability Transmission Upgrade (including a NEMA Upgrade, as appropriate); (iii) an Market Efficiency Transmission Upgrade (including a NEMA Upgrade, as appropriate); or (iv) initially proposed in an Elective Transmission Upgrade Application filed with the ISO in accordance with Section II.47.5 on a date after the addition or modification already has been otherwise identified in the current Regional System Plan (other than as an Elective Transmission Upgrade) in publication as of the date of that application.

Elective Transmission Upgrade Applicant is defined in Section II.47.5 of the OATT.

Electric Reliability Organization (ERO) is defined in 18 C.F.R. § 39.1.

Electronic Dispatch Capability is the ability to provide for the electronic transmission, receipt, and acknowledgment of data relative to the dispatch of generating units and Dispatchable Asset Related

Demands and the ability to carry out the real-time dispatch processes from ISO issuance of Dispatch Instructions to the actual increase or decrease in output of dispatchable Resources.

Eligible Customer is: (i) Any entity that is engaged, or proposes to engage, in the wholesale or retail electric power business is an Eligible Customer under the OATT. (ii) Any electric utility (including any power marketer), Federal power marketing agency, or any other entity generating electric energy for sale or for resale is an Eligible Customer under the OATT. Electric energy sold or produced by such entity may be electric energy produced in the United States, Canada or Mexico. However, with respect to transmission service that the Commission is prohibited from ordering by Section 212(h) of the Federal Power Act, such entity is eligible only if the service is provided pursuant to a state requirement that the Transmission Owner with which that entity is directly interconnected or the distribution company having the service territory in which that entity is located (if that entity is a retail customer) offer the unbundled transmission service or Local Delivery Service, or pursuant to a voluntary offer of such service by the Transmission Owner with which that entity is directly interconnected or the distribution company having the service territory in which that entity is located (if that entity is a retail customer). (iii) Any end user taking or eligible to take unbundled transmission service or Local Delivery Service pursuant to a state requirement that the Transmission Owner with which that end user is directly interconnected or the distribution company having the service territory in which that entity is located (if that entity is a retail customer) offer the transmission service or Local Delivery Service, or pursuant to a voluntary offer of such service by the Transmission Owner with which that end user is directly interconnected, or the distribution company having the service territory in which that entity is located (if that entity is a retail customer) is an Eligible Customer under the OATT.

Eligible FTR Bidder is an entity that has satisfied applicable financial assurance criteria, and shall not include the auctioneer, its Affiliates, and their officers, directors, employees, consultants and other representatives.

Emergency is an abnormal system condition on the bulk power systems of New England or neighboring Control Areas requiring manual or automatic action to maintain system frequency, or to prevent the involuntary loss of load, equipment damage, or tripping of system elements that could adversely affect the reliability of an electric system or the safety of persons or property; or a fuel shortage requiring departure from normal operating procedures in order to minimize the use of such scarce fuel; or a condition that requires implementation of Emergency procedures as defined in the ISO New England Manuals.

Emergency Condition means an Emergency has been declared by the ISO in accordance with the procedures set forth in the ISO New England Manuals and ISO New England Administrative Procedures.

Emergency Energy is energy transferred from one control area operator to another in an Emergency.

Emergency Minimum Limit or Emergency Min means the minimum generation amount, in MWs, that a generating unit can deliver for a limited period of time without exceeding specified limits of equipment stability and operating permits.

EMS is energy management system.

End-of-Round Price is the lowest price associated with a round of a Forward Capacity Auction, as described in Section III.13.2.3.1 of Market Rule 1.

End User Participant is defined in Section 1 of the Participants Agreement.

Energy is power produced in the form of electricity, measured in kilowatthours or megawatthours.

Energy Administration Service (EAS) is the service provided by the ISO, as described in Schedule 2 of Section IV.A of the Tariff, in order to facilitate: (1) bilateral Energy transactions; (2) self-scheduling of Energy; (3) Interchange Transactions in the Energy Market; and (4) Energy Imbalance Service under Section II of the Tariff.

Energy Component means the Locational Marginal Price at the reference point.

Energy Efficiency is installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that reduce the total amount of electrical energy needed, while delivering a comparable or improved level of end-use service. Such measures include, but are not limited to, the installation of more energy efficient lighting, motors, refrigeration, HVAC equipment and control systems, envelope measures, operations and maintenance procedures, and industrial process equipment.

Energy Imbalance Service is the form of Ancillary Service described in Schedule 4 of the OATT.

Energy Market is, collectively, the Day-Ahead Energy Market and the Real-Time Energy Market.

Energy Non-Zero Spot Market Settlement Hours are hours for which the Customer has a positive or negative Real-Time System Adjusted Net Interchange as determined by the ISO settlement process for the Energy Market.

Energy Transaction Units (Energy TUs) are the sum for the month for a Customer of Bilateral Contract Block-Hours, Demand Bid Block-Hours, Asset Related Demand Bid Block-Hours, Supply Offer Block-Hours and Energy Non-Zero Spot Market Settlement Hours.

Enrolling Participant is the Market Participant that registers Customers for the Load Response Program.

Equipment Damage Reimbursement is the compensation paid to the owner of a Designated Blackstart Resource as specified in Section 5.5 of Schedule 16 to the OATT.

Equivalent Demand Forced Outage Rate (EFORD) means the portion of time a unit is in demand, but is unavailable due to forced outages.

Estimated Capacity Load Obligation is, for the purposes of the ISO New England Financial Assurance Policy, the Capacity Requirement from the latest available month, adjusted as appropriate to account for any relevant Capacity Load Obligation Bilaterals, HQICCs, and Self-Supplied FCA Resource designations for the applicable month.

Establish Claimed Capability Audit is the audit performed pursuant to Section III.1.5.1.2.

Estimated Net Regional Clearing Price (ENRCP) is calculated in accordance with Section VII.C of the ISO New England Financial Assurance Policy.

Excepted Transaction is a transaction specified in Section II.40 of the Tariff for the applicable period specified in that Section.

Exempt Real-Time Generation Obligation means that portion of a Market Participant's Real-Time Generation Obligation that is not included in the calculation of Minimum Generation Emergency Credits pursuant to Appendix F of Market Rule 1.

Existing Capacity Qualification Deadline is a deadline, specified in Section III.13.1.10 of Market Rule 1, for submission of certain qualification materials for the Forward Capacity Auction, as discussed in Section III.13.1 of Market Rule 1.

Existing Capacity Qualification Package is information submitted by certain existing resources prior to participation in the Forward Capacity Auction, as described in Section III.13.1 of Market Rule 1.

Existing Capacity Resource is any resource that does not meet any of the eligibility criteria to participate in the Forward Capacity Auction as a New Capacity Resource, and, subject to ISO evaluation, for the Forward Capacity Auction to be conducted beginning February 1, 2008, any resource that is under construction and within 12 months of its expected commercial operations date.

Existing Demand Resource is a type of Demand Resource participating in the Forward Capacity Market, as defined in Section III.13.1.4.1.1 of Market Rule 1.

Existing Generating Capacity Resource is a type of resource participating in the Forward Capacity Market, as defined in Section III.13.1.2.1 of Market Rule 1.

Existing Import Capacity Resource is a type of resource participating in the Forward Capacity Market, as defined in Section III.13.1.3.1 of Market Rule 1.

Expedited Study Request is defined in Section II.34.7 of the OATT.

Export-Adjusted LSR is as defined in Section III.12.4(b)(ii).

Export Bid is a bid that may be submitted by certain resources in the Forward Capacity Auction to export capacity to an external Control Area, as described in Section III.13.1.2.3.1.3 of Market Rule 1.

Exports are Real-Time External Transactions, which are limited to sales from the New England Control Area, for exporting energy out of the New England Control Area.

External Market Monitor means the person or entity appointed by the ISO Board of Directors pursuant to Section III.A.1.2 of Appendix A of Market Rule 1 to carry out the market monitoring and mitigation functions specified in Appendix A and elsewhere in Market Rule 1.

External Node is a proxy bus or buses used for establishing a Locational Marginal Price for energy received by Market Participants from, or delivered by Market Participants to, a neighboring Control Area or for establishing Locational Marginal Prices associated with energy delivered through the New England Control Area by Non-Market Participants for use in calculating Non-Market Participant Congestion Costs and loss costs.

External Resource means a generation resource located outside the metered boundaries of the New England Control Area.

External Transaction is the import of external energy into the New England Control Area by a Market Participant or the export of internal energy out of the New England Control Area by a Market Participant in the Day-Ahead Energy Market and/or Real-Time Energy Market, or the wheeling of external energy through the New England Control Area by a Market Participant or a Non-Market Participant in the Real-Time Energy Market.

External Transmission Project is a transmission project comprising facilities located wholly outside the New England Control Area and regarding which an agreement has been reached whereby New England ratepayers will support all or a portion of the cost of the facilities.

Facilities Study is an engineering study conducted pursuant to the OATT by the ISO (or, in the case of Local Service or interconnections to Local Area Facilities as defined in the TOA, by one or more affected PTOs) or some other entity designated by the ISO in consultation with any affected Transmission Owner(s), to determine the required modifications to the PTF and Non-PTF, including the cost and scheduled completion date for such modifications, that will be required to provide a requested transmission service or interconnection on the PTF and Non-PTF.

Failure to Maintain Blackstart Capability is a failure of a Blackstart Owner or Designated Blackstart Resource to meet the Blackstart Service Minimum Criteria or Blackstart Service obligations, but does not include a Failure to Perform During a System Restoration event.

Failure to Perform During a System Restoration is a failure of a Blackstart Owner or Designated Blackstart Resource to follow ISO or Local Control Center dispatch instructions or perform in accordance with the dispatch instructions or the Blackstart Service Minimum Criteria and Blackstart Service

obligations, described within the ISO New England Operating Documents, during a restoration of the New England Transmission System.

Fast Start Generator means a generating unit that the ISO may dispatch within the hour through electronic dispatch and that meets the following criteria: (i) minimum run time does not exceed one hour; (ii) minimum down time does not exceed one hour; (iii) time to start does not exceed 30 minutes; (iv) available for dispatch and manned or has automatic remote dispatch capability; (v) capable of receiving and acknowledging a start-up or shut-down dispatch instruction electronically; and (vi) has satisfied its minimum down time.

FCA Cleared Export Transaction is defined in Section III.1.10.7(f)(ii) of Market Rule 1.

FCA Payment is the monthly capacity payment for a resource whose offer has cleared in a Forward Capacity Auction as described in Section III.13.7.2.1.1(a) of Market Rule 1.

FCA Qualified Capacity is the Qualified Capacity that is used in a Forward Capacity Auction.

FCM Capacity Charge Requirements are calculated in accordance with Section VII.C of the ISO New England Financial Assurance Policy.

FCM Deposit is calculated in accordance with Section VII.B.1 of the ISO New England Financial Assurance Policy.

FCM Financial Assurance Requirements are described in Section VII of the ISO New England Financial Assurance Policy.

Final Forward Reserve Obligation is calculated in accordance with Section III.9.8(a) of Market Rule 1.

Financial Assurance Default results from a Market Participant or Non-Market Participant Transmission Customer's failure to comply with the ISO New England Financial Assurance Policy.

Financial Assurance Obligations relative to the ISO New England Financial Assurance Policy are determined in accordance with Section III.A(v) of the ISO New England Financial Assurance Policy.

Financial Transmission Right (FTR) is a financial instrument that evidences the rights and obligations specified in Sections III.5.2.2 and III.7 of the Tariff.

Firm Point-To-Point Service is service which is arranged for and administered between specified Points of Receipt and Delivery in accordance with Part II.C of the OATT.

Firm Transmission Service is Regional Network Service, Through or Out Service, service for Excepted Transactions, firm MTF Service, firm OTF Service, and firm Local Service.

Force Majeure - An event of Force Majeure means any act of God, labor disturbance, act of the public enemy or terrorists, war, invasion, insurrection, riot, fire, storm or flood, ice, explosion, breakage or accident to machinery or equipment, any curtailment, order, regulation or restriction imposed by governmental military or lawfully established civilian authorities, or any other cause beyond the control of the ISO, a Transmission Owner, a Schedule 20A Service Provider, or a Customer, including without limitation, in the case of the ISO, any action or inaction by a Customer, a Schedule 20A Service Provider, or a Transmission Owner, in the case of a Transmission Owner, any action or inaction by the ISO, any Customer, a Schedule 20A Service Provider, or any other Transmission Owner, in the case of a Schedule 20A Service Provider, any action or inaction by the ISO, any Customer, a Transmission Owner, or any other Schedule 20A Service Provider, and, in the case of a Transmission Customer, any action or inaction by the ISO, a Schedule 20A Service Provider, or any Transmission Owner.

Forecast Hourly Demand Reduction means the estimated maximum quantity of energy reduction (MWh), measured at the end-use customer meter that can be produced by a Real-Time Demand Response Resource, or Real-Time Emergency Generation Resource, in each hour of an Operating Day. For a Real-Time Emergency Generation Asset that is metered at the generator and associated with a Real-Time Emergency Generation Resource, the Forecast Hourly Demand Reduction means the estimated maximum generator output (MWh) in each hour of an Operating Day.

Formal Warning is defined in Section III.B.4.1.1 of Appendix B of Market Rule 1.

Formula-Based Sanctions are defined in Section III.B.4.1.3 of Appendix B of Market Rule 1.

Forward Capacity Auction (FCA) is the annual descending clock auction in the Forward Capacity Market, as described in Section III.13.2 of Market Rule 1.

Forward Capacity Auction Starting Price is calculated in accordance with Section III.13.2.4 of Market Rule 1.

Forward Capacity Market (FCM) is the forward market for procuring capacity in the New England Control Area, as described in Section III.13 of Market Rule 1.

Forward Reserve means TMNSR and TMOR purchased by the ISO on a forward basis on behalf of Market Participants as provided for in Section III.9 of Market Rule 1.

Forward Reserve Assigned Megawatts is the amount of Forward Reserve, in megawatts, that a Market Participant assigns to eligible Forward Reserve Resources to meet its Forward Reserve Obligation as defined in Section III.9.4.1 of Market Rule 1.

Forward Reserve Auction is the periodic auction conducted by the ISO in accordance with Section III.9 of Market Rule 1 to procure Forward Reserve.

Forward Reserve Auction Offers are offers to provide Forward Reserve to meet system and Reserve Zone requirements as submitted by a Market Participant in accordance with Section III.9.3 of Market Rule 1.

Forward Reserve Charge is a Market Participant's share of applicable system and Reserve Zone Forward Reserve costs attributable to meeting the Forward Reserve requirement as calculated in accordance with Section III.9.9 of Market Rule 1.

Forward Reserve Clearing Price is the clearing price for TMNSR or TMOR, as applicable, for the system and each Reserve Zone resulting from the Forward Reserve Auction as defined in Section III.9.4 of Market Rule 1.

Forward Reserve Credit is the credit received by a Market Participant that is associated with that Market Participant's Final Forward Reserve Obligation as calculated in accordance with Section III.9.8 of Market Rule 1.

Forward Reserve Delivered Megawatts are calculated in accordance with Section III.9.6.5 of Market Rule 1.

Forward Reserve Delivery Period is defined in Section III.9.1 of Market Rule 1.

Forward Reserve Failure-to-Activate Megawatts are calculated in accordance with Section III.9.7.2(a) of Market Rule 1.

Forward Reserve Failure-to-Activate Penalty is the penalty associated with a Market Participant's failure to activate Forward Reserve when requested to do so by the ISO and is defined in Section III.9.7.2 of Market Rule 1.

Forward Reserve Failure-to-Activate Penalty Rate is specified in Section III.9.7.2 of Market Rule 1.

Forward Reserve Failure-to-Reserve, as specified in Section III.9.7.1 of Market Rule 1, occurs when a Market Participant's Forward Reserve Delivered Megawatts for a Reserve Zone in an hour is less than that Market Participant's Forward Reserve Obligation for that Reserve Zone in that hour. Under these circumstances the Market Participant pays a penalty based upon the Forward Reserve Failure-to-Reserve Penalty Rate and that Market Participant's Forward Reserve Failure-to-Reserve Megawatts.

Forward Reserve Failure-to-Reserve Megawatts are calculated in accordance with Section III.9.7.1(a) of Market Rule 1.

Forward Reserve Failure-to-Reserve Penalty is the penalty associated with a Market Participant's failure to reserve Forward Reserve and is defined in Section III.9.7.1 of Market Rule 1.

Forward Reserve Failure-to-Reserve Penalty Rate is specified in Section III.9.7.1(b)(ii) of Market Rule 1.

Forward Reserve Fuel Index is the index or set of indices used to calculate the Forward Reserve Threshold Price as defined in Section III.9.6.2 of Market Rule 1.

Forward Reserve Heat Rate is the heat rate as defined in Section III.9.6.2 of Market Rule 1 that is used to calculate the Forward Reserve Threshold Price.

Forward Reserve Market is a market for forward procurement of two reserve products, Ten-Minute Non-Spinning Reserve (TMNSR) and Thirty-Minute Operating Reserve (TMOR).

Forward Reserve MWs are those megawatts assigned to specific eligible Forward Reserve Resources which convert a Forward Reserve Obligation into a Resource-specific obligation.

Forward Reserve Obligation is a Market Participant's amount, in megawatts, of Forward Reserve that cleared in the Forward Reserve Auction and adjusted, as applicable, to account for bilateral transactions that transfer Forward Reserve Obligations.

Forward Reserve Obligation Charge is defined in Section III.10.4 of Market Rule 1.

Forward Reserve Offer Cap is \$14,000/megawatt-month.

Forward Reserve Payment Rate is defined in Section III.9.8 of Market Rule 1.

Forward Reserve Procurement Period is defined in Section III.9.1 of Market Rule 1.

Forward Reserve Qualifying Megawatts refer to all or a portion of a Forward Reserve Resource's capability offered into the Real-Time Energy Market at energy offer prices above the applicable Forward Reserve Threshold Price that are calculated in accordance with Section III.9.6.4 of Market Rule 1.

Forward Reserve Resource is a Resource that meets the eligibility requirements defined in Section III.9.5.2 of Market Rule 1 that has been assigned Forward Reserve Obligation by a Market Participant.

Forward Reserve Threshold Price is the minimum price at which assigned Forward Reserve Megawatts are required to be offered into the Real-Time Energy Market as calculated in Section III.9.6.2 of Market Rule 1.

FTR Auction is the periodic auction of FTRs conducted by the ISO in accordance with Section III.7 of Market Rule 1.

FTR Auction Revenue is the revenue collected from the sale of FTRs in FTR Auctions. FTR Auction Revenue is payable to FTR Holders who submit their FTRs for sale in the FTR Auction in accordance with Section III.7 of Market Rule 1 and to ARR Holders and Incremental ARR Holders in accordance with Appendix C of Market Rule 1.

FTR Award Financial Assurance is a required amount of financial assurance that must be maintained at all times from a Designated FTR Participant for each FTR awarded to the participant in any FTR Auctions. This amount is calculated pursuant to Section VI.C of the ISO New England Financial Assurance Policy.

FTR Bid Financial Assurance is an amount of financial assurance required from a Designated FTR Participant for each bid submission into an FTR auction. This amount is calculated pursuant to Section VI.B of the ISO New England Financial Assurance Policy.

FTR Credit Test Percentage is calculated in accordance with Section III.B.1(b) of the ISO New England Financial Assurance Policy.

FTR Financial Assurance Requirements are described in Section VI of the ISO New England Financial Assurance Policy.

FTR Holder is an entity that acquires an FTR through the FTR Auction to Section III.7 of Market Rule 1 and registers with the ISO as the holder of the FTR in accordance with Section III.7 of Market Rule 1 and applicable ISO New England Manuals.

FTR-Only Customer is a Market Participant that transacts in the FTR Auction and that does not participate in other markets or programs of the New England Markets. References in this Tariff to a “Non-Market Participant FTR Customers” and similar phrases shall be deemed references to an FTR-Only Customer.

FTR Settlement Risk Financial Assurance is an amount of financial assurance required by a Designated FTR Participant for each bid submission into an FTR Auction and for each bid awarded to the individual participant in an FTR Auction. This amount is calculated pursuant to Section VI.A of the ISO New England Financial Assurance Policy.

GADS Data means data submitted to the NERC for collection into the NERC's Generating Availability Data System (GADS).

Gap Request for Proposals (Gap RFP) is defined in Section III.11 of Market Rule 1.

Gas Day means a period of 24 consecutive hours beginning at 0900 hrs Central Time.

Generating Capacity Resource means a New Generating Capacity Resource or an Existing Generating Capacity Resource.

Generator Asset is a generator that has been registered in accordance with the Asset Registration Process.

Generator Imbalance Service is the form of Ancillary Service described in Schedule 10 of the OATT.

Generator Interconnection Related Upgrade is an addition to or modification of the New England Transmission System (pursuant to Section II.47.1, Schedule 22 or Schedule 23 of the OATT) to effect the interconnection of a new generating unit or an existing generating unit whose energy capability or capacity capability is being materially changed and increased whether or not the interconnection is being effected to meet the Capacity Capability Interconnection Standard or the Network Capability Interconnection Standard. As to Category A Projects (as defined in Schedule 11 of the OATT), a Generator Interconnection Related Upgrade also includes an upgrade beyond that required to satisfy the Network Capability Interconnection Standard (or its predecessor) for which the Generator Owner has committed to pay prior to October 29, 1998.

Generator Owner is the owner, in whole or part, of a generating unit whether located within or outside the New England Control Area.

Good Utility Practice means any of the practices, methods and acts engaged in or approved by a significant portion of the electric utility industry during the relevant time period, or any of the practices, methods and acts which, in the exercise of reasonable judgment in light of the facts known at the time the decision was made, could have been expected to accomplish the desired result at a reasonable cost consistent with good business practices, reliability, safety and expedition. Good Utility Practice is not intended to be limited to the optimum practice, method, or act to the exclusion of all others, but rather

includes all acceptable practices, methods, or acts generally accepted in the region, including those practices required by Federal Power Act Section 215(a)(4).

Governance Only Member is defined in Section 1 of the Participants Agreement.

Governance Participant is defined in the Participants Agreement.

Governing Documents, for the purposes of the ISO New England Billing Policy, are the Transmission, Markets and Services Tariff and ISO Participants Agreement.

Governing Rating is the lowest corporate rating from any Rating Agency for that Market Participant, or, if the Market Participant has no corporate rating, then the lowest rating from any Rating Agency for that Market Participant's senior unsecured debt.

Grandfathered Agreements (GAs) is a transaction specified in Section II.45 for the applicable period specified in that Section.

Grandfathered Intertie Agreement (GIA) is defined pursuant to the TOA.

Handy-Whitman Index of Public Utility Construction Costs is the Total Other Production Plant index shown in the Cost Trends of Electric Utility Construction for the North Atlantic Region as published in the Handy-Whitman Index of Public Utility Construction Costs.

Highgate Transmission Facilities (HTF) are existing U. S.-based transmission facilities covered under the Agreement for Joint Ownership, Construction and Operation of the Highgate Transmission Interconnection dated as of August 1, 1984 including (1) the whole of a 200 megawatt high-voltage, back-to-back, direct-current converter facility located in Highgate, Vermont and (2) a 345 kilovolt transmission line within Highgate and Franklin, Vermont (which connects the converter facility at the U.S.-Canadian border to a Hydro-Quebec 120 kilovolt line in Bedford, Quebec). The HTF include any upgrades associated with increasing the capacity or changing the physical characteristics of these facilities as defined in the above stated agreement dated August 1, 1984 until the Operations Date, as defined in the TOA. The current HTF rating is a nominal 225 MW. The HTF are not defined as PTF. Coincident with the Operations Date and except as stipulated in Schedules, 9, 12, and Attachment F to the OATT, HTF shall be treated in the same manner as PTF for purposes of the OATT and all references to PTF in the

OATT shall be deemed to apply to HTF as well. The treatment of the HTF is not intended to establish any binding precedent or presumption with regard to the treatment for other transmission facilities within the New England Transmission System (including HVDC, MTF, or Control Area Interties) for purposes of the OATT.

Host Participant or Host Utility is a Market Participant or a Governance Participant transmission or distribution provider that reconciles the loads within the metering domain with OP-18 compliant metering.

Hourly Adjusted Audited Demand Reduction is calculated in accordance with Section III.13.7.1.5.10.1.2.

Hourly Calculated Demand Resource Performance Value means the performance of a Demand Resource during Real-Time Demand Response Event Hours and Real-Time Emergency Generation Event Hours for purposes of calculating a Demand Reduction Value pursuant to Sections III.13.7.1.5.7.3 and III.13.7.1.5.8.3.

Hourly Charges are defined in Section 1.3 of the ISO New England Billing Policy.

Hourly PER is calculated in accordance with Section III.13.7.2.7.1.1.1(a) of Market Rule 1.

Hourly Real-Time Demand Response Resource Deviation means the difference between the Average Hourly Load Reduction or Average Hourly Output of the Real-Time Demand Response Resource and the amount of load reduction or output that the Market Participant was instructed to produce pursuant to a Dispatch Instruction calculated pursuant to Section III.13.7.1.5.7.3.1.

Hourly Real-Time Emergency Generation Resource Deviation is calculated pursuant to Section III.13.7.1.5.8.3.1.

Hourly Requirements are determined in accordance with Section III.A(i) of the ISO New England Financial Assurance Policy.

Hub is a specific set of pre-defined Nodes for which a Locational Marginal Price will be calculated for the Day-Ahead Energy Market and Real-Time Energy Market and which can be used to establish a

reference price for energy purchases and the transfer of Day-Ahead Adjusted Load Obligations and Real-Time Adjusted Load Obligations and for the designation of FTRs.

Hub Price is calculated in accordance with Section III.2.8 of Market Rule 1.

HQ Interconnection Capability Credit (HQICC) is a monthly value reflective of the annual installed capacity benefits of the Phase I/II HVDC-TF, as determined by the ISO, using a standard methodology on file with the Commission, in conjunction with the setting of the Installed Capacity Requirement. An appropriate share of the HQICC shall be assigned to an IRH if the Phase I/II HVDC-TF support costs are paid by that IRH and such costs are not included in the calculation of the Regional Network Service rate. The share of HQICC allocated to such an eligible IRH for a month is the sum in kilowatts of (1)(a) the IRH's percentage share, if any, of the Phase I Transfer Capability times (b) the Phase I Transfer Credit, plus (2)(a) the IRH's percentage share, if any, of the Phase II Transfer Capability, times (b) the Phase II Transfer Credit. The ISO shall establish appropriate HQICCs to apply for an IRH which has such a percentage share.

Import Capacity Resource means an Existing Import Capacity Resource or a New Import Capacity Resource offered to provide capacity in the New England Control Area from an external Control Area.

Inadequate Supply is defined in Section III.13.2.8.1 of Market Rule 1.

Inadvertent Energy Revenue is defined in Section III.3.2.1(k) of Market Rule 1.

Inadvertent Energy Revenue Charges or Credits is defined in Section III.3.2.1(l) of Market Rule 1.

Inadvertent Interchange means the difference between net actual energy flow and net scheduled energy flow into or out of the New England Control Area.

Increment Offer means an offer to sell energy at a specified Location in the Day-Ahead Energy Market which is not associated with a physical supply. An accepted Increment Offer results in scheduled generation at the specified Location in the Day-Ahead Energy Market.

Incremental ARR is an ARR provided in recognition of a participant-funded transmission system upgrade pursuant to Appendix C of this Market Rule.

Incremental ARR Holder is an entity which is the record holder of an Incremental Auction Revenue Right in the register maintained by the ISO.

Incremental Cost of Reliability Service is described in Section III.13.2.5.2.5.2 of Market Rule 1.

Independent Transmission Company (ITC) is a transmission entity that assumes certain responsibilities in accordance with Section 10.05 of the Transmission Operating Agreement and Attachment M to the OATT, subject to the acceptance or approval of the Commission and a finding of the Commission that the transmission entity satisfies applicable independence requirements.

Information Request is a request from a potential Disputing Party submitted in writing to the ISO for access to Confidential Information.

Initial Market Participant Financial Assurance Requirement is calculated for new Market Participants and Returning Market Participants, other than an FTR-Only Customer or a Governance Only Member, according to Section IV of the ISO New England Financial Assurance Policy.

Installed Capacity Requirement means the level of capacity required to meet the reliability requirements defined for the New England Control Area, as described in Section III.12 of Market Rule 1.

Insufficient Competition is defined in Section III.13.2.8.2 of Market Rule 1.

Interchange Transactions are transactions deemed to be effected under Market Rule 1.

Interconnecting Transmission Owner has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Interconnection Agreement is the “Large Generator Interconnection Agreement” or the “Small Generator Interconnection Agreement” pursuant to Schedules 22 and 23 of the ISO OATT or an interconnection agreement approved by the Commission prior to the adoption of the Interconnection Procedures.

Interconnection Customer has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Interconnection Feasibility Study Agreement has the meaning specified in Section I of Schedule 22 or Attachment 1 to Schedule 23 of the OATT.

Interconnection Procedure is the “Large Generator Interconnection Procedures” or the “Small Generator Interconnection Procedures” pursuant to Schedules 22 and 23 of the ISO OATT.

Interconnection Request has the meaning specified in Section I of Schedule 22 or Attachment 1 to Schedule 23 of the OATT.

Interconnection Rights Holder(s) (IRH) has the meaning given to it in Schedule 20A to Section II of this Tariff.

Interconnection System Impact Study Agreement has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Interest is interest calculated in the manner specified in Section II.8.3.

Intermittent Power Resource is defined in Section III.13.1.2.2.2 of Market Rule 1.

Intermittent Settlement Only Resource is a Settlement Only Resource that is also an Intermittent Power Resource.

Internal Bilateral for Load is an internal bilateral transaction under which the buyer receives a reduction in Real-Time Load Obligation and the seller receives a corresponding increase in Real-Time Load Obligation in the amount of the sale, in MWs. An Internal Bilateral for Load transaction is only applicable in the Real-Time Energy Market.

Internal Bilateral for Market for Energy is an internal bilateral transaction for Energy which applies in the Day-Ahead Energy Market and Real-Time Energy Market or just the Real-Time Energy Market under which the buyer receives a reduction in Day-Ahead Adjusted Load Obligation and Real-Time Adjusted

Load Obligation and the seller receives a corresponding increase in Day-Ahead Adjusted Load Obligation and Real-Time Adjusted Load Obligation in the amount of the sale, in MWs.

Internal Market Monitor means the department of the ISO responsible for carrying out the market monitoring and mitigation functions specified in Appendix A and elsewhere in Market Rule 1.

Interregional Planning Stakeholder Advisory Committee (IPSAC) is the committee described as such in the Northeast Planning Protocol.

Interregional Transmission Project is a transmission project located within the New England Control Area and one or more of the neighboring transmission planning regions.

Interruption Cost is the amount, in dollars, that must be paid to a Market Participant each time the Market Participant's Demand Response Resource is scheduled or dispatched in the New England Markets to reduce demand.

Investment Grade Rating, for a Market (other than an FTR-Only Customer) or Non-Market Participant Transmission Customer, is either (a) a corporate investment grade rating from one or more of the Rating Agencies, or (b) if the Market Participant or Non-Market Participant Transmission Customer does not have a corporate rating from one of the Rating Agencies, then an investment grade rating for the Market Participant's or Non-Market Participant Transmission Customer's senior unsecured debt from one or more of the Rating Agencies.

Invoice is a statement issued by the ISO for the net Charge owed by a Covered Entity pursuant to the ISO New England Billing Policy.

Invoice Date is the day on which the ISO issues an Invoice.

ISO means ISO New England Inc.

ISO Charges, for the purposes of the ISO New England Billing Policy, are both Non-Hourly Charges and Hourly Charges.

ISO Control Center is the primary control center established by the ISO for the exercise of its Operating Authority and the performance of functions as an RTO.

ISO-Initiated Claimed Capability Audit is the audit performed pursuant to Section III.1.5.1.4.

ISO New England Administrative Procedures means procedures adopted by the ISO to fulfill its responsibilities to apply and implement ISO New England System Rules.

ISO New England Billing Policy is Exhibit ID to Section I of the Transmission, Markets and Services Tariff.

ISO New England Filed Documents means the Transmission, Markets and Services Tariff, including but not limited to Market Rule 1, the Participants Agreement, the Transmission Operating Agreement or other documents that affect the rates, terms and conditions of service.

ISO New England Financial Assurance Policy is Exhibit IA to Section I of the Transmission, Markets and Services Tariff.

ISO New England Information Policy is the policy establishing guidelines regarding the information received, created and distributed by Market Participants and the ISO in connection with the settlement, operation and planning of the System, as the same may be amended from time to time in accordance with the provisions of this Tariff. The ISO New England Information Policy is Attachment D to the Transmission, Markets and Services Tariff.

ISO New England Manuals are the manuals implementing Market Rule 1, as amended from time to time in accordance with the Participants Agreement. Any elements of the ISO New England Manuals that substantially affect rates, terms, and/or conditions of service shall be filed with the Commission under Section 205 of the Federal Power Act.

ISO New England Operating Documents are the Tariff and the ISO New England Operating Procedures.

ISO New England Operating Procedures are the ISO New England Planning Procedures and the operating guides, manuals, procedures and protocols developed and utilized by the ISO for operating the ISO bulk power system and the New England Markets.

ISO New England Planning Procedures are the procedures developed and utilized by the ISO for planning the ISO bulk power system.

ISO New England System Rules are Market Rule 1, the ISO New England Information Policy, the ISO New England Administrative Procedures, the ISO New England Manuals and any other system rules, procedures or criteria for the operation of the New England Transmission System and administration of the New England Markets and the Transmission, Markets and Services Tariff.

ITC Agreement is defined in Attachment M to the OATT.

ITC Rate Schedule is defined in Section 3.1 of Attachment M to the OATT.

ITC System is defined in Section 2.2 of Attachment M to the OATT.

ITC System Planning Procedures is defined in Section 15.4 of Attachment M to the OATT.

Joint ISO/RTO Planning Committee (JIPC) is the committee described as such in the Northeastern Planning Protocol.

Late Payment Account is a segregated interest-bearing account into which the ISO deposits Late Payment Charges due from ISO Charges and interest owed from participants for late payments that are collected and not distributed to the Covered Entities, until the Late Payment Account Limit is reached, under the ISO New England Billing Policy and penalties collected under the ISO New England Financial Assurance Policy.

Late Payment Account Limit is defined in Section 4.2 of the ISO New England Billing Policy.

Late Payment Charge is defined in Section 4.1 of the ISO New England Billing Policy.

Lead Market Participant, for purposes other than the Forward Capacity Market, is the entity authorized to submit Supply Offers or Demand Bids for a Resource and to whom certain Energy TUs are assessed under Schedule 2 of Section IV.A of the Tariff. For purposes of the Forward Capacity Market, the Lead Market Participant is the entity designated to participate in that market on behalf of an Existing Capacity Resource or a New Capacity Resource.

Limited Energy Resource means generating resources that, due to design considerations, environmental restriction on operations, cyclical requirements, such as the need to recharge or refill or manage water flow, or fuel limitations, are unable to operate continuously at full output on a daily basis.

Load Asset means a physical load that has been registered in accordance with the Asset Registration Process.

Load Management means installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that curtail electrical usage or shift electrical usage from Demand Resource On-Peak Hours, Demand Resource Seasonal Peak Hours, or Real-Time Demand Response Event Hours to other hours and reduce the amount of capacity needed, while delivering a comparable or acceptable level of end-use service. Such measures include, but are not limited to, energy management systems, load control end-use cycling, load curtailment strategies, chilled water storage, and other forms of electricity storage.

Load Response Program means the program implemented and administered by the ISO to promote demand side response as described in Appendix E to Market Rule 1.

Load Response Program Asset means one or more individual end-use metered customers that report load reduction and consumption, or generator output as a single set of values, are assigned an identification number, that participate in the Load Response Program and which encompass assets registered in the Real-Time Price Response Program or Real-Time Demand Response Assets, and are further described in Appendix E of Market Rule 1.

Load Shedding is the systematic reduction of system demand by temporarily decreasing load.

Load Zone is a Reliability Region, except as otherwise provided for in Section III.2.7 of Market Rule 1.

Local Area Facilities are defined in the TOA.

Local Benefit Upgrade(s) (LBU) is an upgrade, modification or addition to the transmission system that is: (i) rated below 115kV or (ii) rated 115kV or above and does not meet all of the non-voltage criteria for PTF classification specified in the OATT.

Local Control Centers are those control centers in existence as of the effective date of the OATT (including the CONVEX, REMVEC, Maine and New Hampshire control centers) or established by the PTOs in accordance with the TOA that are separate from the ISO Control Center and perform certain functions in accordance with the OATT and the TOA.

Local Delivery Service is the service of delivering electric energy to end users. This service is subject to state jurisdiction regardless of whether such service is provided over local distribution or transmission facilities. An entity that is an Eligible Customer under the OATT is not excused from any requirements of state law, or any order or regulation issued pursuant to state law, to arrange for Local Delivery Service with the Participating Transmission Owner and/or distribution company providing such service and to pay all applicable charges associated with such service, including charges for stranded costs and benefits.

Local Network is defined as the transmission facilities constituting a local network as identified in Attachment E, as such Attachment may be modified from time to time in accordance with the Transmission Operating Agreement.

Local Network Load is the load that a Network Customer designates for Local Network Service under Schedule 21 to the OATT.

Local Network RNS Rate is the rate applicable to Regional Network Service to effect a delivery to load in a particular Local Network, as determined in accordance with Schedule 9 to the OATT.

Local Network Service (LNS) is the network service provided under Schedule 21 and the Local Service Schedules to permit the Transmission Customer to efficiently and economically utilize its resources to serve its load.

Local Point-To-Point Service (LPTP) is Point-to-Point Service provided under Schedule 21 of the OATT and the Local Service Schedules to permit deliveries to or from an interconnection point on the PTF.

Local Resource Adequacy Requirement is calculated pursuant to Section III.12.2.1.1.

Local Second Contingency Protection Resources are those Resources identified by the ISO on a daily basis as necessary for the provision of Operating Reserve requirements and adherence to NERC, NPCC and ISO reliability criteria over and above those Resources required to meet first contingency reliability criteria within a Reliability Region.

Local Service is transmission service provided under Schedule 21 and the Local Service Schedules thereto.

Local Service Schedule is a PTO-specific schedule to the OATT setting forth the rates, charges, terms and conditions applicable to Local Service.

Local Sourcing Requirement (LSR) is the minimum amount of capacity that must be located within an import-constrained Load Zone, calculated as described in Section III.12.2 of Market Rule 1.

Local System Planning (LSP) is the process defined in Appendix 1 of Attachment K to the OATT.

Localized Costs are the incremental costs resulting from a RTEP02 Upgrade or a Regional Benefit Upgrade that exceeds those requirements that the ISO deems reasonable and consistent with Good Utility Practice and the current engineering design and construction practices in the area in which the Transmission Upgrade is built. In making its determination of whether Localized Costs exist, the ISO will consider, in accordance with Schedule 12C of the OATT, the reasonableness of the proposed engineering design and construction method with respect to alternate feasible Transmission Upgrades and the relative costs, operation, timing of implementation, efficiency and reliability of the proposed Transmission Upgrade. The ISO, with advisory input from the Reliability Committee, as appropriate, shall review such Transmission Upgrade, and determine whether there are any Localized Costs resulting from such Transmission Upgrade. If there are any such costs, the ISO shall identify them in the Regional System Plan.

Location is a Node, External Node, Load Zone or Hub. For Capacity Commitment Periods commencing on or after June 1, 2017, the Location also is a Dispatch Zone.

Locational Marginal Price (LMP) is defined in Section III.2 of Market Rule 1. The Locational Marginal Price for a Node is the nodal price at that Node; the Locational Marginal Price for an External Node is the nodal price at that External Node; the Locational Marginal Price for a Load Zone or Reliability Region is the Zonal Price for that Load Zone or Reliability Region, respectively; and the Locational Marginal Price for a Hub is the Hub Price for that Hub. For Capacity Commitment Periods commencing on or after June 1, 2017, the Location Marginal Price for a Dispatch Zone is the Zonal Price for that Dispatch Zone.

Long Lead Time Generating Facility (Long Lead Facility) has the meaning specified in Section I of Schedule 22 of the OATT.

Long-Term is a term of one year or more.

Long-Term Transmission Outage is a long-term transmission outage scheduled in accordance with ISO New England Operating Procedure No. 3.

Loss Component is the component of the nodal LMP at a given Node or External Node on the PTF that reflects the cost of losses at that Node or External Node relative to the reference point. The Loss Component of the nodal LMP at a given Node on the non-PTF system reflects the relative cost of losses at that Node adjusted as required to account for losses on the non-PTF system already accounted for through tariffs associated with the non-PTF. When used in connection with Hub Price or Zonal Price, the term Loss Component refers to the Loss Components of the nodal LMPs that comprise the Hub Price or Zonal Price, which Loss Components are averaged or weighted in the same way that nodal LMPs are averaged to determine Hub Price or weighted to determine Zonal Price.

Loss of Load Expectation (LOLE) is the probability of disconnecting non-interruptible customers due to a resource deficiency.

Lost Opportunity Cost (LOC) is one of four forms of compensation that may be paid to resources providing VAR Service under Schedule 2 of the OATT.

LSE means load serving entity.

Lump Sum Blackstart Payment is defined and calculated as specified in Section 5.4 of Schedule 16 to the OATT.

Lump Sum Blackstart Capital Payment is defined and calculated as specified in Section 5.4 of Schedule 16 to the OATT.

Lump Sum Blackstart CIP Capital Payment is defined and calculated as specified in Section 5.4 of Schedule 16 to the OATT.

Major Transmission Outage is a major transmission outage scheduled in accordance with ISO New England Operating Procedure No. 3.

Manual Response Rate is the rate, in MW/Minute, at which the output of a Generator Asset is capable of changing.

Marginal Loss Revenue Load Obligation is defined in Section III.3.2.1(b)(v) of Market Rule 1.

Market Credit Limit is a credit limit for a Market Participant's Financial Assurance Obligations (except FTR Financial Assurance Requirements) established for each Market Participant in accordance with Section II.C of the ISO New England Financial Assurance Policy.

Market Credit Test Percentage is calculated in accordance with Section III.B.1(a) of the ISO New England Financial Assurance Policy.

Market Efficiency Transmission Upgrade is defined as those additions and upgrades that are not related to the interconnection of a generator, and, in the ISO's determination, are designed to reduce bulk power system costs to load system-wide, where the net present value of the reduction in bulk power system costs to load system-wide exceeds the net present value of the cost of the transmission addition or upgrade. For purposes of this definition, the term "bulk power system costs to load system-wide" includes, but is not limited to, the costs of energy, capacity, reserves, losses and impacts on bilateral prices for electricity.

Market Participant is a participant in the New England Markets (including a FTR-Only Customer) that has executed a Market Participant Service Agreement, or on whose behalf an unexecuted Market Participant Service Agreement has been filed with the Commission.

Market Participant Financial Assurance Requirement is defined in Section III of the ISO New England Financial Assurance Policy.

Market Participant Obligations is defined in Section III.B.1.1 of Appendix B of Market Rule 1.

Market Participant Service Agreement (MPSA) is an agreement between the ISO and a Market Participant, in the form specified in Attachment A or Attachment A-1 to the Tariff, as applicable.

Market Rule 1 is ISO Market Rule 1 and appendices set forth in Section III of this ISO New England Inc. Transmission, Markets and Services Tariff, as it may be amended from time to time.

Market Violation is a tariff violation, violation of a Commission-approved order, rule or regulation, market manipulation, or inappropriate dispatch that creates substantial concerns regarding unnecessary market inefficiencies.

Material Adverse Change is any change in financial status including, but not limited to a downgrade to below an Investment Grade Rating by any Rating Agency, being placed on credit watch with negative implication by any Rating Agency if the Market Participant or Non-Market Participant Transmission Customer does not have an Investment Grade Rating, a bankruptcy filing or other insolvency, a report of a significant quarterly loss or decline of earnings, the resignation of key officer(s), the sanctioning of the Market Participant or Non-Market Participant Transmission Customer or any of its Principles imposed by the Federal Energy Regulatory Commission, the Securities Exchange Commission, any exchange monitored by the National Futures Association, or any state entity responsible for regulating activity in energy markets; the filing of a material lawsuit that could materially adversely impact current or future financial results; a significant change in the Market Participant's or Non-Market Participant Transmission Customer's credit default spreads; or a significant change in market capitalization.

Material Adverse Impact is defined, for purposes of review of ITC-proposed plans, as a proposed facility or project will be deemed to cause a "material adverse impact" on facilities outside of the ITC System if: (i) the proposed facility or project causes non-ITC facilities to exceed their capabilities or

exceed their thermal, voltage or stability limits, consistent with all applicable reliability criteria, or (ii) the proposed facility or project would not satisfy the standards set forth in Section I.3.9 of the Transmission, Markets and Services Tariff. This standard is intended to assure the continued service of all non-ITC firm load customers and the ability of the non-ITC systems to meet outstanding transmission service obligations.

Maximum Capacity Limit is the maximum amount of capacity that can be procured in an export-constrained Load Zone, calculated as described in Section III.12.2 of Market Rule 1, to meet the Installed Capacity Requirement.

Maximum Consumption Limit is the maximum amount, in MW, available from the Dispatchable Asset Related Demand for economic dispatch and is based on the physical characteristics as submitted as part of a Resource's Offer Data except that a Self-Scheduled Dispatchable Asset Related Demand may modify its Minimum Consumption Limit on an hourly basis, as part of its Demand Bid, in order to indicate the desired level of Self-Scheduled MW.

Maximum Facility Load is the most recent annual non-coincident peak demand or, if unavailable, an estimate of the annual non-coincident peak demand of a Real-Time Demand Response Asset or a Real-Time Emergency Generation Asset, where the demand evaluated is established by adding actual metered demand and the output of all generators located behind the asset's end-use customer meter in the same time intervals.

Maximum Generation is the maximum generation output of a Real-Time Demand Response Asset comprised of Distributed Generation or the maximum generation output of a Demand Response Asset comprised of Distributed Generation.

Maximum Interruptible Capacity is an estimate of the maximum hourly demand reduction amount that a Real-Time Demand Response Asset, Real-Time Emergency Generation Asset or a Demand Response Asset can deliver. For assets that deliver demand reduction, the Maximum Interruptible Capacity is the asset's peak load less its uninterruptible load. For assets that deliver reductions through the use of generation, the Maximum Interruptible Capacity is the difference between the generator's maximum possible output and its expected output when not providing demand reduction.

Maximum Load is the most recent annual non-coincident peak demand or, if unavailable, an estimate of the annual non-coincident peak demand, of a Demand Response Asset, Real-Time Demand Response Asset or Real-Time Emergency Generation Asset.

Maximum Net Supply is an estimate of the maximum hourly Net Supply for a Demand Response Asset as measured from the Demand Response Asset's Retail Delivery Point.

Maximum Reduction is the maximum available demand reduction, in MW, of a Demand Response Resource that a Market Participant offers to deliver in the Day-Ahead Energy Market or Real-Time Energy Market, as reflected in the Demand Response Resource's Demand Reduction Offer.

Measure Life is the estimated time a Demand Resource measure will remain in place, or the estimated time period over which the facility, structure, equipment or system in which a measure is installed continues to exist, whichever is shorter. Suppliers of Demand Resources comprised of an aggregation of measures with varied Measures Lives shall determine and document the Measure Life either: (i) for each type of measure with a different Measure Life and adjust the aggregate performance based on the individual measure life calculation in the portfolio; or (ii) as the average Measure Life for the aggregated measures as long as the Demand Reduction Value of the Demand Resource is greater than or equal to the amount that cleared in the Forward Capacity Auction or reconfiguration auction for the entire Capacity Commitment Period, and the Demand Reduction Value for an Existing Demand Resource is not overstated in a subsequent Capacity Commitment Period. Measure Life shall be determined consistent with the Demand Resource's Measurement and Verification Plan, which shall be reviewed by the ISO to ensure consistency with the measurement and verification requirements of Market Rule 1 and the ISO New England Manuals.

Measurement and Verification Documents mean the measurement and verification documents described in Section 13.1.4.3.1 of Market Rule 1, which includes Measurement and Verification Plans, Updated Measurement and Verification Plans, Measurement and Verification Summary Reports, and Measurement and Verification Reference Reports.

Measurement and Verification Plan means the measurement and verification plan submitted by a Demand Resource supplier as part of the qualification process for the Forward Capacity Auction pursuant to the requirements of Section III.13.1.4.3 of Market Rule 1 and the ISO New England Manuals.

Measurement and Verification Reference Reports are optional reports submitted by Demand Resource suppliers during the Capacity Commitment Period subject to the schedule in the Measurement and Verification Plan and consistent with the schedule and reporting standards set forth in the ISO New England Manuals. Measurement and Verification Reference Reports update the prospective Demand Reduction Value of the Demand Resource project based on measurement and verification studies performed during the Capacity Commitment Period.

Measurement and Verification Summary Report is the monthly report submitted by a Demand Resource supplier with the monthly settlement report for the Forward Capacity Market, which documents the total Demand Reduction Values for all Demand Resources in operation as of the end of the previous month.

MEPCO Grandfathered Transmission Service Agreement (MGTSA) is a MEPCO long-term firm point-to-point transmission service agreement with a POR or POD at the New Brunswick border and a start date prior to June 1, 2007 where the holder has elected, by written notice delivered to MEPCO within five (5) days following the filing of the settlement agreement in Docket Nos. ER07-1289 and EL08-56 or by September 1, 2008 (whichever is later), MGTSA treatment as further described in Section II.45.1.

Merchant Transmission Facilities (MTF) are the transmission facilities owned by MTOs, defined and classified as MTF pursuant to Schedule 18 of the OATT, over which the ISO shall exercise Operating Authority in accordance with the terms set forth in a MTOA or Attachment K to the OATT, rated 69 kV or above and required to allow energy from significant power sources to move freely on the New England Transmission System.

Merchant Transmission Facilities Provider (MTF Provider) is an entity as defined in Schedule 18 of the OATT.

Merchant Transmission Facilities Service (MTF Service) is transmission service over MTF as provided for in Schedule 18 of the OATT.

Merchant Transmission Operating Agreement (MTOA) is an agreement between the ISO and an MTO with respect to its MTF.

Merchant Transmission Owner (MTO) is an owner of MTF.

Meter Data Error means an error in meter data, including an error in Coincident Peak Contribution values, on an Invoice issued by the ISO after the completion of the data reconciliation process as described in the ISO New England Manuals and in Section III.3.8 of Market Rule 1.

Meter Data Error RBA Submission Limit means the date thirty 30 calendar days after the issuance of the Invoice containing the results of the data reconciliation process as described in the ISO New England Manuals and in Section III.3.6 of Market Rule 1.

Minimum Consumption Limit is the minimum amount, in MW, available from a Dispatchable Asset Related Demand that is not available for economic dispatch and is based on the physical characteristics as submitted as part of a Resource's Offer Data.

Minimum Generation Emergency means an Emergency declared by the ISO in which the ISO anticipates requesting one or more generating Resources to operate at or below Economic Minimum Limit, in order to manage, alleviate, or end the Emergency.

Minimum Generation Emergency Charge means the charge used to allocate the cost of Minimum Generation Emergency Credits. Minimum Generation Emergency Charges are discussed in Appendix F of Market Rule 1.

Minimum Generation Emergency Credits are credits calculated pursuant to Appendix F of Market Rule 1 to compensate certain generating Resources for operation in excess of their Economic Minimum Limits during a Minimum Generation Emergency.

Minimum Reduction is the minimum available demand reduction, in MW, of a Demand Response Resource that a Market Participant offers to deliver in the Day-Ahead Energy Market or Real-Time Energy Market, as reflected in the Demand Response Resource's Demand Reduction Offer.

Minimum Reduction Time is the minimum number of hours of demand reduction at or above the Minimum Reduction for which the ISO must dispatch a Demand Response Resource to reduce demand.

Minimum Time Between Reductions is the minimum number of hours that a Market Participant requires between the time the Demand Response Resource receives a Dispatch Instruction from the ISO to not reduce demand and the time the Demand Response Resource receives a Dispatch Instruction from the ISO to reduce demand.

Monthly Blackstart Service Charge is the charge made to Transmission Customers pursuant to Section 6 of Schedule 16 to the OATT.

Monthly Capacity Variance means a Demand Resource's actual monthly Capacity Value established pursuant to Section III.13.7.1.5.1 of Market Rule 1, minus the Demand Resource's final Capacity Supply Obligation for the month.

Monthly Peak is defined in Section II.21.2 of the OATT.

Monthly PER is calculated in accordance with Section III.13.7.2.7.1.1.2(a) of Market Rule 1.

Monthly Real-Time Generation Obligation is the sum, for all hours in a month, at all Locations, of a Customer's Real-Time Generation Obligation, in MWs.

Monthly Real-Time Load Obligation is the absolute value of a Customer's hourly Real-Time Load Obligation summed for all hours in a month, in MWs.

Monthly Regional Network Load is defined in Section II.21.2 of the OATT.

Monthly Statement is the first weekly Statement issued on a Monday after the tenth of a calendar month that includes both the Hourly Charges for the relevant billing period and Non-Hourly Charges for the immediately preceding calendar month.

MUI is the market user interface.

Municipal Market Participant is defined in Section II of the ISO New England Financial Assurance Policy.

MW is megawatt.

MWh is megawatt-hour.

Native Load Customers are the wholesale and retail power customers of a Transmission Owner on whose behalf the Transmission Owner, by statute, franchise, regulatory requirement, or contract, has undertaken an obligation to construct and operate its system to meet the reliable electric needs of such customers.

NCPC Charge means the charges to Market Participants as provided in Section III.3.2.3, Section III.6.4 and Appendix F.

NCPC Credit means the payment made to a Resource as provided in Section III.3.2.3, Section III.6.4 and Appendix F.

Needs Assessment is defined in Section 4.1 of Attachment K to the OATT.

NEMA, for purposes of Section III of the Tariff, is the Northeast Massachusetts Reliability Region.

NEMA Contract is a contract described in Appendix C of Market Rule 1 and listed in Exhibit 1 of Appendix C of Market Rule 1.

NEMA Load Serving Entity (NEMA LSE) is a Transmission Customer or Congestion Paying LSE Entity that serves load within NEMA.

NEMA or Northeast Massachusetts Upgrade, for purposes of Section II of the Tariff, is an addition to or modification of the PTF into or within the Northeast Massachusetts Reliability Region that was not, as of December 31, 1999, the subject of a System Impact Study or application filed pursuant to Section I.3.9 of the Transmission, Markets and Services Tariff; that is not related to generation interconnections; and that will be completed and placed in service by June 30, 2004. Such upgrades include, but are not limited to, new transmission facilities and related equipment and/or modifications to existing transmission facilities and related equipment. The list of NEMA Upgrades is contained in Schedule 12A of the OATT.

NEPOOL is the New England Power Pool, and the entities that collectively participated in the New England Power Pool.

NEPOOL Agreement is the agreement among the participants in NEPOOL.

NEPOOL GIS is the generation information system.

NEPOOL GIS Administrator is the entity or entities that develop, administer, operate and maintain the NEPOOL GIS.

NERC is the North American Electric Reliability Corporation or its successor organization.

Net Commitment Period Compensation (NCPC) is the compensation methodology for Resources that is described in Appendix F to Market Rule 1.

Net CONE is an estimate of the Cost of New Entry, net of the first-year non-capacity market revenues, for a reference technology resource type and is intended to equal the amount of capacity revenue the reference technology resource would require, in its first year of operation, to be economically viable given reasonable expectations of the first year energy and ancillary services revenues, and projected revenue for subsequent years.

Net Regional Clearing Price is described in Section III.13.7.3 of Market Rule 1.

Net Supply is energy injected at the Retail Delivery Point by a Demand Response Asset with Distributed Generation.

Net Supply Generator Asset is the Generator Asset registered in the energy market at the same Retail Delivery Point as a Demand Response Asset with Distributed Generation capable of delivering Net Supply.

Network Capability Interconnection Standard has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Network Customer is a Transmission Customer receiving RNS or LNS.

Network Resource is defined as follows: (1) With respect to Market Participants, (a) any generating resource located in the New England Control Area which has been placed in service prior to the Compliance Effective Date (including a unit that has lost its capacity value when its capacity value is restored and a deactivated unit which may be reactivated without satisfying the requirements of Section II.46 of the OATT in accordance with the provisions thereof) until retired; (b) any generating resource located in the New England Control Area which is placed in service after the Compliance Effective Date until retired, provided that (i) the Generator Owner has complied with the requirements of Sections II.46 and II.47 and Schedules 22 and 23 of the OATT, and (ii) the output of the unit shall be limited in accordance with Sections II.46 and II.47 and Schedules 22 and 23, if required; and (c) any generating resource or combination of resources (including bilateral purchases) located outside the New England Control Area for so long as any Market Participant has an Ownership Share in the resource or resources which is being delivered to it in the New England Control Area to serve Regional Network Load located in the New England Control Area or other designated Regional Network Loads contemplated by Section II.18.3 of the OATT taking Regional Network Service. (2) With respect to Non-Market Participant Transmission Customers, any generating resource owned, purchased or leased by the Non-Market Participant Transmission Customer which it designates to serve Regional Network Load.

New Brunswick Security Energy is defined in Section III.3.2.6A of Market Rule 1.

New Capacity Offer is an offer in the Forward Capacity Auction to provide capacity from a New Generating Capacity Resource, New Import Capacity Resource, or New Demand Resource, as described in Section III.13.2.3.2 of Market Rule 1.

New Capacity Qualification Deadline is a deadline, specified in Section III.13.1.10 of Market Rule 1, for submission of certain qualification materials for the Forward Capacity Auction, as discussed in Section III.13.1 of Market Rule 1.

New Capacity Qualification Package is information submitted by certain new resources prior to participation in the Forward Capacity Auction, as described in Section III.13.1 of Market Rule 1.

New Capacity Required is the amount of additional capacity required to meet the Installed Capacity Requirement or a Capacity Zone's Local Sourcing Requirement, as described in Section III.13.2.8.1.1 of Market Rule 1.

New Capacity Resource is a resource (i) that never previously received any payment as a capacity resource including any capacity payment pursuant to the market rules in effect prior to June 1, 2010 and that has not cleared in any previous Forward Capacity Auction; or (ii) that is otherwise eligible to participate in the Forward Capacity Auction as a New Capacity Resource.

New Capacity Show of Interest Form is described in Section III.13.1.1.2.1 of Market Rule 1.

New Capacity Show of Interest Submission Window is the period of time during which a Project Sponsor may submit a New Capacity Show of Interest Form or a New Demand Resource Show of Interest Form, as described in Section III.13.1.10 of Market Rule 1.

New Demand Resource is a type of Demand Resource participating in the Forward Capacity Market, as defined in Section III.13.1.4.1.2 of Market Rule 1.

New Demand Resource Qualification Package is the information that a Project Sponsor must submit, in accordance with Section III 13.1.4.2.3 of Market Rule 1, for each resource that it seeks to offer in the Forward Capacity Auction as a New Demand Resource.

New Demand Resource Show of Interest Form is described in Section III.13.1.4.2 of Market Rule 1.

New Demand Response Asset is a Real-Time Demand Response Asset, Real-Time Emergency Generation Asset or Demand Response Asset that is registered with the ISO, has been mapped to a resource, is ready to respond, and has been included in the dispatch model of the remote terminal unit but does not have a winter audit value and a summer audit value.

New Demand Response Asset Audit is an audit of a New Demand Response Asset performed pursuant to Section III.13.6.1.5.4.8.

New England Control Area is the Control Area for New England, which includes PTF, Non-PTF, MTF and OTF. The New England Control Area covers Connecticut, Rhode Island, Massachusetts, New Hampshire, Vermont, and part of Maine (i.e., excluding the portions of Northern Maine and the northern portion of Eastern Maine which are in the Maritimes Control Area).

New England Markets are markets or programs for the purchase of energy, capacity, ancillary services, demand response services or other related products or services (including Financial Transmission Rights) that are delivered through or useful to the operation of the New England Transmission System and that are administered by the ISO pursuant to rules, rates, or agreements on file from time to time with the Federal Energy Regulatory Commission.

New England System Restoration Plan is the plan that is developed by ISO, in accordance with NERC Reliability Standards, NPCC regional criteria and standards, ISO New England Operating Documents and ISO operating agreements, to facilitate the restoration of the New England Transmission System following a partial or complete shutdown of the New England Transmission System.

New England Transmission System is the system of transmission facilities, including PTF, Non-PTF, OTF and MTF, within the New England Control Area under the ISO's operational jurisdiction.

New Generating Capacity Resource is a type of resource participating in the Forward Capacity Market, as described in Section III.13.1.1.1 of Market Rule 1.

New Import Capacity Resource is a type of resource participating in the Forward Capacity Market, as defined in Section III.13.1.3.4 of Market Rule 1.

NMPTC means Non-Market Participant Transmission Customer.

NMPTC Credit Threshold is described in Section V.A.2 of the ISO New England Financial Assurance Policy.

NMPTC Financial Assurance Requirement is an amount of additional financial assurance for Non-Market Participant Transmission Customers described in Section V.D of the ISO New England Financial Assurance Policy.

Nodal Amount is node(s)-specific on-peak and off-peak proxy value to which an FTR bid or awarded FTR bid relates.

Node is a point on the New England Transmission System at which LMPs are calculated.

No-Load Fee is the amount, in dollars per hour, for a generating unit that must be paid to Market Participants with an Ownership Share in the unit for being scheduled in the New England Markets, in addition to the Start-Up Fee and price offered to supply energy, for each hour that the generating unit is scheduled in the New England Markets.

Nominated Consumption Limit is the consumption level specified by the Market Participant for a Dispatchable Asset Related Demand as adjusted in accordance with the provisions of Section III.13.7.3.1.3.

Non-Commercial Capacity is the capacity of a New Capacity Resource or an increment of an Existing Capacity Resource that is treated as a New Capacity Resource in the Forward Capacity Auction and that has not been declared commercial and has not had its capacity rating verified by the ISO.

Non-Commercial Capacity Cure Period is the time period described in Section VII.D of the ISO New England Financial Assurance Policy.

Non-Commercial Capacity Financial Assurance Amount (Non-Commercial Capacity FA Amount) is the financial assurance amount held on Non-Commercial Capacity cleared in a Forward Capacity Auction as calculated in accordance with Section VII.B.2 of the ISO New England Financial Assurance Policy.

Non-Designated Blackstart Resource Study Cost Payments are the study costs reimbursed under Section 5.3 of Schedule 16 of the OATT.

Non-Hourly Charges are defined in Section 1.3 of the ISO New England Billing Policy.

Non-Hourly Requirements are determined in accordance with Section III.A(ii) of the ISO New England Financial Assurance Policy, which is Exhibit 1A of Section I of the Tariff.

Non-Intermittent Settlement Only Resource is a Settlement Only Resource that is not an Intermittent Power Resource.

Non-Market Participant is any entity that is not a Market Participant.

Non-Market Participant Transmission Customer is any entity which is not a Market Participant but is a Transmission Customer.

Non-Municipal Market Participant is defined in Section II of the ISO New England Financial Assurance Policy.

Non-Price Retirement Request is a binding request to retire the entire capacity of a Generating Capacity Resource as described in Section III.13.1.2.3.1.5.

Non-PTF Transmission Facilities (Non-PTF) are the transmission facilities owned by the PTOs that do not constitute PTF, OTF or MTF.

Non-Qualifying means a Market Participant that is not a Credit Qualifying Market Participant.

Notice of RBA is defined in Section 6.3.2 of the ISO New England Billing Policy.

Notification Time is the time required for a Generator Asset to synchronize to the system from the time a startup Dispatch Instruction is received from the ISO.

Northeastern Planning Protocol is the Amended and Restated Northeastern ISO/RTO Planning Coordination Protocol on file with the Commission.

NPCC is the Northeast Power Coordinating Council.

Obligation Month means a time period of one calendar month for which capacity payments are issued and the costs associated with capacity payments are allocated.

Offer Data means the scheduling, operations planning, dispatch, new Resource, and other data, including generating unit and Dispatchable Asset Related Demand, and for Capacity Commitment Periods commencing on or after June 1, 2017, Demand Response Resource operating limits based on physical characteristics, and information necessary to schedule and dispatch generating and Dispatchable Asset Related Demand Resources, and for Capacity Commitment Periods commencing on or after June 1, 2017.

Demand Response Resources for the provision of energy and other services and the maintenance of the reliability and security of the transmission system in the New England Control Area, and specified for submission to the New England Markets for such purposes by the ISO.

Offered CLAIM10 is a Supply Offer value between 0 and the CLAIM10 of a Resource that represents the amount of TMNSR available from the Resource.

Offered CLAIM30 is a Supply Offer value between 0 and the CLAIM30 of a Resource that represents the amount of offline TMOR available from the Resource.

Offered Full Reduction Time is the value calculated pursuant to Section III.13.6.1.5.4.6.

On-Peak Demand Resource is a type of Demand Resource and means installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that reduce the total amount of electrical energy consumed during Demand Resource On-Peak Hours, while delivering a comparable or acceptable level of end-use service. Such measures include Energy Efficiency, Load Management, and Distributed Generation.

Open Access Same-Time Information System (OASIS) is the ISO information system and standards of conduct responding to requirements of 18 C.F.R. §37 of the Commission's regulations and all additional requirements implemented by subsequent Commission orders dealing with OASIS.

Open Access Transmission Tariff (OATT) is Section II of the ISO New England Inc. Transmission, Markets and Services Tariff.

Operating Authority is defined pursuant to a MTOA, an OTOA, the TOA or the OATT, as applicable.

Operating Data means GADS Data, data equivalent to GADS Data, CARL Data, metered load data, or actual system failure occurrences data, all as described in the ISO New England Operating Procedures.

Operating Day means the calendar day period beginning at midnight for which transactions on the New England Markets are scheduled.

Operating Reserve means Ten-Minute Spinning Reserve (TMSR), Ten-Minute Non-Spinning Reserve (TMNSR) and Thirty-Minute Operating Reserve (TMOR).

Operations Date is February 1, 2005.

OTF Service is transmission service over OTF as provided for in Schedule 20.

Other Transmission Facility (OTF) are the transmission facilities owned by Transmission Owners, defined and classified as OTF pursuant to Schedule 20, over which the ISO shall exercise Operating Authority in accordance with the terms set forth in the OTOA, rated 69 kV or above, and required to allow energy from significant power sources to move freely on the New England Transmission System. OTF classification shall be limited to the Phase I/II HVDC-TF.

Other Transmission Operating Agreements (OTOA) is the agreement(s) between the ISO, an OTO and/or the associated service provider(s) with respect to an OTF, which includes the HVDC Transmission Operating Agreement and the Phase I/II HVDC-TF Transmission Service Administration Agreement. With respect to the Phase I/II HVDC-TF, the HVDC Transmission Operating Agreement covers the rights and responsibilities for the operation of the facility and the Phase I/II HVDC-TF Transmission Service Administration Agreement covers the rights and responsibilities for the administration of transmission service.

Other Transmission Owner (OTO) is an owner of OTF.

Ownership Share is a right or obligation, for purposes of settlement, to a percentage share of all credits or charges associated with a generating unit asset or Load Asset, where such unit or load is interconnected to the New England Transmission System.

Participant Expenses are defined in Section 1 of the Participants Agreement.

Participant Required Balance is defined in Section 5.3 of the ISO New England Billing Policy.

Participant Vote is defined in Section 1 of the Participants Agreement.

Participants Agreement is the agreement among the ISO, the New England Power Pool and Individual Participants, as amended from time to time, on file with the Commission.

Participants Committee is the principal committee referred to in the Participants Agreement.

Participating Transmission Owner (PTO) is a transmission owner that is a party to the TOA.

Payment is a sum of money due to a Covered Entity from the ISO.

Payment Default Shortfall Fund is defined in Section 5.1 of the ISO New England Billing Policy.

Peak Energy Rent (PER) is described in Section III.13.7.2.7.1 of Market Rule 1.

PER Proxy Unit is described in Section III.13.7.2.7.1 of Market Rule 1.

Percent of Total Demand Reduction Value Complete means the delivery schedule as a percentage of a Demand Resource's total Demand Reduction Value that will be or has been achieved as of specific target dates, as described in Section III.13 of Market Rule 1.

Permanent De-list Bid is a bid that may be submitted by an Existing Generating Capacity Resource, Existing Import Capacity Resource, or Existing Demand Resource in the Forward Capacity Auction to permanently remove itself from the capacity market, as described in Section III.13.1.2.3.1.2 of Market Rule 1.

Phase I Transfer Credit is 40% of the HQICC, or such other fraction of the HQICC as the ISO may establish.

Phase I/II HVDC-TF is defined in Schedule 20A to Section II of this Tariff.

Phase I/II HVDC-TF Transfer Capability is the transfer capacity of the Phase I/II HVDC-TF under normal operating conditions, as determined in accordance with Good Utility Practice. The "Phase I Transfer Capability" is the transfer capacity under normal operating conditions, as determined in accordance with Good Utility Practice, of the Phase I terminal facilities as determined initially as of the time immediately prior to Phase II of the Phase I/II HVDC-TF first being placed in service, and as

adjusted thereafter only to take into account changes in the transfer capacity which are independent of any effect of Phase II on the operation of Phase I. The “Phase II Transfer Capability” is the difference between the Phase I/II HVDC-TF Transfer Capability and the Phase I Transfer Capability.

Determinations of, and any adjustment in, Phase I/II HVDC-TF Transfer Capability shall be made by the ISO, and the basis for any such adjustment shall be explained in writing and posted on the ISO website.

Phase II Transfer Credit is 60% of the HQICC, or such other fraction of the HQICC as the ISO may establish.

Planning Advisory Committee is the committee described in Attachment K of the OATT.

Planning and Reliability Criteria is defined in Section 3.3 of Attachment K to the OATT.

Planning Authority is an entity defined as such by the North American Electric Reliability Corporation.

Point(s) of Delivery (POD) is point(s) of interconnection where capacity and/or energy transmitted by a Transmission Customer will be made available to the Receiving Party under the OATT.

Point(s) of Receipt (POR) is point(s) of interconnection where capacity and/or energy transmitted by a Transmission Customer will be made available by the Delivering Party under the OATT.

Point-To-Point Service is the transmission of capacity and/or energy on either a firm or non-firm basis from the Point(s) of Receipt to the Point(s) of Delivery under the OATT pursuant to Local Point-To-Point Service or OTF Service or MTF Service; and the transmission of capacity and/or energy from the Point(s) of Receipt to the Point(s) of Delivery under the OATT pursuant to Through or Out Service.

Pool-Planned Unit is one of the following units: New Haven Harbor Unit 1 (Coke Works), Mystic Unit 7, Canal Unit 2, Potter Unit 2, Wyman Unit 4, Stony Brook Units 1, 1A, 1B, 1C, 2A and 2B, Millstone Unit 3, Seabrook Unit 1 and Waters River Unit 2 (to the extent of 7 megawatts of its Summer capability and 12 megawatts of its Winter capability).

Pool PTF Rate is the transmission rate determined in accordance with Schedule 8 to the OATT.

Pool RNS Rate is the transmission rate determined in accordance with paragraph (2) of Schedule 9 of Section II of the Tariff.

Pool-Scheduled Resources are described in Section III.1.10.2 of Market Rule 1.

Pool Supported PTF is defined as: (i) PTF first placed in service prior to January 1, 2000; (ii) Generator Interconnection Related Upgrades with respect to Category A and B projects (as defined in Schedule 11), but only to the extent not paid for by the interconnecting Generator Owner; and (iii) other PTF upgrades, but only to the extent the costs therefore are determined to be Pool Supported PTF in accordance with Schedule 12.

Pool Transmission Facility (PTF) means the transmission facilities owned by PTOs which meet the criteria specified in Section II.49 of the OATT.

Poorly Performing Resource is described in Section III.13.7.1.1.5 of Market Rule 1.

Posting Entity is any Market Participant or Non-Market Participant Transmission Customer providing financial security under the provisions of the ISO New England Financial Assurance Policy.

Posture means an action of the ISO to deviate from the jointly optimized security constrained economic dispatch for Energy and Operating Reserves solution for a Resource produced by the ISO's technical software for the purpose of maintaining sufficient Operating Reserve (both online and off-line) or for the provision of voltage or VAR support.

Posturing Credit is calculated pursuant to Section III.F.2.6.2 of Appendix F to Market Rule 1.

Power Purchaser is the entity that is purchasing the capacity and/or energy to be transmitted under the OATT.

Principal is (i) the sole proprietor of a sole proprietorship; (ii) a general partner of a partnership; (iii) a president, chief executive officer, chief operating officer or chief financial officer (or equivalent position) of an organization; (iv) a manager, managing member or a member vested with the management authority for a limited liability company or limited liability partnership; (v) any person or entity that has the power to exercise a controlling influence over an organization's activities that are subject to regulation by the

Federal Energy Regulatory Commission, the Securities and Exchange Commission, the Commodity Futures Trading Commission, any exchange monitored by the National Futures Association, or any state entity responsible for regulating activity in energy markets; or (vi) any person or entity that: (a) is the direct owner of 10% or more of any class of an organization's equity securities; or (b) has directly contributed 10% or more of an organization's capital.

Profiled Load Assets include all Load Assets that are not directly metered by OP-18 compliant metering as currently described in Section IV (Metering and Recording for Settlements) of OP18, and some Load Assets that are measured by OP-18 compliant metering (as currently described in Section IV of OP-18) to which the Host Participant Assigned Meter Reader allocates non-PTF losses.

Project Sponsor is an entity seeking to have a New Generating Capacity Resource or New Demand Resource participate in the Forward Capacity Market, as described in Section III.13.

Provisional Member is defined in Section I.68A of the Restated NEPOOL Agreement.

PTO Administrative Committee is the committee referred to in Section 11.04 of the TOA.

Publicly Owned Entity is defined in Section I of the Restated NEPOOL Agreement.

Qualification Process Cost Reimbursement Deposit is described in Section III.13.1.9.3 of Market Rule 1.

Qualified Capacity is the amount of capacity a resource may provide in the summer or winter in a Capacity Commitment Period, as determined in the Forward Capacity Market qualification processes.

Qualified Generator Reactive Resource(s) is any generator source of dynamic reactive power that meets the criteria specified in Schedule 2 of the OATT.

Qualified Non-Generator Reactive Resource(s) is any non-generator source of dynamic reactive power that meets the criteria specified in Schedule 2 of the OATT.

Qualified Reactive Resource(s) is any Qualified Generator Reactive Resource and/or Qualified Non-Generator Reactive Resource that meets the criteria specified in Schedule 2 of the OATT.

Queue Position has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Rated means a Market Participant that receives a credit rating from one or more of the Rating Agencies, or, if such Market Participant is not rated by one of the Rating Agencies, then a Market Participant that has outstanding unsecured debt rated by one or more of the Rating Agencies.

Rating Agencies are Standard and Poor's (S&P), Moody's, and Fitch.

RBA Decision is a written decision provided by the ISO to a Disputing Party and to the Chair of the NEPOOL Budget and Finance Subcommittee accepting or denying a Requested Billing Adjustment within twenty Business Days of the date the ISO distributes a Notice of RBA, unless some later date is agreed upon by the Disputing Party and the ISO.

Reactive Supply and Voltage Control Service is the form of Ancillary Service described in Schedule 2 of the OATT.

Real-Time is a period in the current Operating Day for which the ISO dispatches Resources for energy and Regulation, designates Resources for Regulation and Operating Reserve and, if necessary, commits additional Resources.

Real-Time Adjusted Load Obligation is defined in Section III.3.2.1(b)(iii) of Market Rule 1.

Real-Time Adjusted Load Obligation Deviation is defined in Section III.3.2.1(c)(iii) of Market Rule 1.

Real-Time Commitment Periods are periods of continuous operation bounded by a start up and the earlier to occur of a shut-down or a unit trip used to determine eligibility for Real Time NCPC Credit.

Real-Time Congestion Revenue is defined in Section III.3.2.1(f) of Market Rule 1.

Real-Time Demand Reduction Obligation is a Real-Time demand reduction amount determined pursuant to Section III.E1.8 for Capacity Commitment Periods commencing prior to June 1, 2017, and Section III.E2.7 for Capacity Commitment Periods commencing on or after June 1, 2017.

Real-Time Demand Resource Dispatch Hours means those hours, or portions thereof, in which ISO New England Operating Procedure No. 4 is implemented and the ISO has begun to allow the depletion of Thirty-Minute Operating Reserve on a Dispatch Zone, Load Zone, or system-wide basis, and the ISO notifies the Market Participants with Real-Time Demand Response Resources of such hours.

Real-Time Demand Response Asset means one or more individual end-use metered customers that are located at a single Node, report load reduction and consumption, or generator output as a single set of values, are assigned a unique asset identification number by the ISO, and that participate in the Forward Capacity Market as part of a Market Participant's Real-Time Demand Response Resource.

Real-Time Demand Response Event Hours means hours when the ISO dispatches Real-Time Demand Response Resources in response to Real-Time Demand Resource Dispatch Hours, which may include Dispatch Zone, Load Zone, or system-wide dispatch of such resources.

Real-Time Demand Response Resource is a type of Demand Resource that is comprised of installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that: (i) curtail electrical usage in response to a Dispatch Instruction; and (ii) continue curtailing electrical usage until receiving Dispatch Instructions to restore electrical usage. Such measures include Load Management and Distributed Generation. The period of curtailment shall be consistent with Real-Time Demand Response Event Hours.

Real-Time Emergency Generation Asset means one or more individual end-use metered customers that are located at a single Node, report load reduction and consumption, or generator output as a single set of values, are assigned a unique asset identification number by the ISO, and that participate in the Forward Capacity Market as part of a Market Participant's Real-Time Emergency Generation Resource.

Real-Time Emergency Generation Event Hours means those hours, or portions thereof, between 7 a.m. and 7 p.m. Monday through Friday, non-Demand Response Holidays in which the ISO dispatches Real-Time Emergency Generation Resources on a Dispatch Zone, Load Zone, or system-wide basis when deficient in Thirty-Minute Operating Reserve and when the ISO implements voltage reductions of five percent of normal operating voltage that require more than 10 minutes to implement.

Real-Time Emergency Generation Resource is Distributed Generation whose federal, state and/or local air quality permits, rules or regulations limit operation in response to requests from the ISO to the times when the ISO implements voltage reductions of five percent of normal operating voltage that require more than 10 minutes to implement. A Real-Time Emergency Generation Resource must be capable of: (i) curtailing its end-use electric consumption from the New England grid within 30 minutes of receiving a Dispatch Instruction; and (ii) continuing that curtailment until receiving a Dispatch Instruction to restore consumption.

Real-Time Energy Market means the purchase or sale of energy, purchase of demand reductions pursuant to Appendix III.E2 of Market Rule 1, payment of Congestion Costs, and payment for losses for quantity deviations from the Day-Ahead Energy Market in the Operating Day and designation of and payment for provision of Operating Reserve in Real-Time.

Real-Time Energy Market Deviation Congestion Charge/Credit is defined in Section III.3.2.1(e) of Market Rule 1.

Real-Time Energy Market Deviation Energy Charge/Credit is defined in Section III.3.2.1(e) of Market Rule 1.

Real-Time Energy Market Deviation Loss Charge/Credit is defined in Section III.3.2.1(e) of Market Rule 1.

Real-Time Generation Obligation is defined in Section III.3.2.1(b)(ii) of Market Rule 1.

Real-Time Generation Obligation Deviation is defined in Section III.3.2.1(c)(ii) of Market Rule 1.

Real-Time High Operating Limit is the maximum output, in MW, of a resource that could be achieved, consistent with Good Utility Practice, in response to an ISO request for Energy under Section III.13.6.4 of Market Rule 1, for each hour of the Operating Day, as reflected in the resource's Offer Data. This value is based on real-time operating conditions and the physical operating characteristics and operating permits of the unit.

Real-Time Load Obligation is defined in Section III.3.2.1(b)(i) of Market Rule 1.

Real-Time Load Obligation Deviation is defined in Section III.3.2.1(c)(i) of Market Rule 1.

Real-Time Locational Adjusted Net Interchange is defined in Section III.3.2.1(b)(iv) of Market Rule 1.

Real-Time Locational Adjusted Net Interchange Deviation is defined in Section III.3.2.1(c)(iv) of Market Rule 1.

Real-Time Loss Revenue is defined in Section III.3.2.1(i) of Market Rule 1.

Real-Time Loss Revenue Charges or Credits are defined in Section III.3.2.1(m) of Market Rule 1.

Real-Time NCP Load Obligation is the maximum hourly value, during a month, of a Market Participant's Real-Time Load Obligation summed over all Locations, excluding exports, in kilowatts.

Real-Time Price Response Program is the program described in Appendix E to Market Rule 1.

Real-Time Prices means the Locational Marginal Prices resulting from the ISO's dispatch of the New England Markets in the Operating Day.

Real-Time Reserve Charge is a Market Participant's share of applicable system and Reserve Zone Real-Time Operating Reserve costs attributable to meeting the Real-Time Operating Reserve requirement as calculated in accordance with Section III.10 of Market Rule 1.

Real-Time Reserve Clearing Price is the Real-Time TMSR, TMNSR or TMOR clearing price, as applicable, for the system and each Reserve Zone that is calculated in accordance with Section III.2.4 of Market Rule 1.

Real-Time Reserve Credit is a Market Participant's compensation associated with that Market Participant's Resources' Real-Time Reserve Designation as calculated in accordance with Section III.10 of Market Rule 1.

Real-Time Reserve Designation is the amount, in MW, of Operating Reserve designated to a Resource in Real-Time by the ISO as adjusted after-the-fact utilizing revenue quality meter data as described under Section III.10 of Market Rule 1.

Real-Time Reserve Opportunity Cost is defined in Section III.2.7A(b) of Market Rule 1.

Real-Time System Adjusted Net Interchange means, for each hour, the sum of Real-Time Locational Adjusted Net Interchange for a Market Participant over all Locations, in kilowatts.

Receiving Party is the entity receiving the capacity and/or energy transmitted to Point(s) of Delivery under the OATT.

Reference Level is defined in Section III.A.5.6.1 of Appendix A of Market Rule 1.

Regional Benefit Upgrade(s) (RBU) means a Transmission Upgrade that: (i) is rated 115kV or above; (ii) meets all of the non-voltage criteria for PTF classification specified in the OATT; and (iii) is included in the Regional System Plan as either a Reliability Transmission Upgrade or an Market Efficiency Transmission Upgrade identified as needed pursuant to Attachment K of the OATT. The category of RBU shall not include any Transmission Upgrade that has been categorized under any of the other categories specified in Schedule 12 of the OATT (e.g., an Elective Transmission Upgrade shall not also be categorized as an RBU). Any upgrades to transmission facilities rated below 115kV that were PTF prior to January 1, 2004 shall remain classified as PTF and be categorized as an RBU if, and for so long as, such upgrades meet the criteria for PTF specified in the OATT.

Regional Network Load is the load that a Network Customer designates for Regional Network Service under Part II.B of the OATT. The Network Customer's Regional Network Load shall include all load designated by the Network Customer (including losses) and shall not be credited or reduced for any behind-the-meter generation. A Network Customer may elect to designate less than its total load as Regional Network Load but may not designate only part of the load at a discrete Point of Delivery. Where a Transmission Customer has elected not to designate a particular load at discrete Points of Delivery as Regional Network Load, the Transmission Customer is responsible for making separate arrangements under Part II.C of the OATT for any Point-To-Point Service that may be necessary for such non-designated load.

Regional Network Service (RNS) is the transmission service over the PTF described in Part II.B of the OATT, including such service which is used with respect to Network Resources or Regional Network Load that is not physically interconnected with the PTF.

Regional Planning Dispute Resolution Process is described in Section 12 of Attachment K to the OATT.

Regional System Plan (RSP) is the plan developed under the process specified in Attachment K of the OATT.

Regional Transmission Service (RTS) is Regional Network Service and Through or Out Service as provided over the PTF in accordance with Section II.B, Section II.C, Schedule 8 and Schedule 9 of the OATT.

Regulation is the capability of a specific generating unit with appropriate telecommunications, control and response capability to increase or decrease its output in response to a regulating control signal, in accordance with the specifications in the ISO New England Manuals and ISO New England Administrative Procedures.

Regulation and Frequency Response Service is the form of Ancillary Service described in Schedule 3 of the OATT. The capability of performing Regulation and Frequency Response Service is referred to as automatic generation control (AGC).

Regulation Capability (REGCAP) means the amount of Regulation capability available on a Market Participant's Resource as calculated by the ISO based upon that Resource's Automatic Response Rate and the available regulating range as specified in ISO New England Manual 11 – Market Operations.

Regulation Clearing Price is defined in Section III.3.2.2(e) of Market Rule 1.

Regulation High Limit is the maximum amount of energy that a generating unit can reliably produce when that unit is providing Regulation. The Regulation High Limit may be less than or equal to the unit's Economic Maximum Limit.

Regulation Low Limit is the minimum amount of energy that a generating unit can reliably produce when that unit is providing Regulation. The Regulation Low Limit may be greater than or equal to the unit's Economic Minimum Limit.

Regulation Opportunity Cost is defined in Section III.3.2.2(i) of Market Rule 1.

Regulation Rank Price is calculated in accordance with Section III.1.11.5(b) of Market Rule 1.

Regulation Requirement is the hourly amount of Regulation MWs required by the ISO to maintain system control and reliability as calculated and posted on the ISO website.

Regulation Service Credit is the credit associated with provision of Regulation Service Megawatts and is calculated in accordance with Section III.3.2.2(c) of Market Rule 1.

Regulation Service Megawatts are calculated in accordance with Section III.3.2.2(f) of Market Rule 1.

Related Person is defined pursuant to Section 1.1 of the Participants Agreement.

Related Transaction is defined in Section III.1.4.3 of Market Rule 1.

Reliability Administration Service (RAS) is the service provided by the ISO, as described in Schedule 3 of Section IV.A of the Tariff, in order to administer the Reliability Markets and provide other reliability-related and informational functions.

Reliability Committee is the committee whose responsibilities are specified in Section 8.2.3 of the Participants Agreement.

Reliability Markets are, collectively, the ISO's administration of Regulation, the Forward Capacity Market, and Operating Reserve.

Reliability Region means any one of the regions identified on the ISO's website. Reliability Regions are intended to reflect the operating characteristics of, and the major transmission constraints on, the New England Transmission System.

Reliability Transmission Upgrade means those additions and upgrades not required by the interconnection of a generator that are nonetheless necessary to ensure the continued reliability of the New England Transmission System, taking into account load growth and known resource changes, and include those upgrades necessary to provide acceptable stability response, short circuit capability and system voltage levels, and those facilities required to provide adequate thermal capability and local

voltage levels that cannot otherwise be achieved with reasonable assumptions for certain amounts of generation being unavailable (due to maintenance or forced outages) for purposes of long-term planning studies. Good Utility Practice, applicable reliability principles, guidelines, criteria, rules, procedures and standards of ERO and NPCC and any of their successors, applicable publicly available local reliability criteria, and the ISO System Rules, as they may be amended from time to time, will be used to define the system facilities required to maintain reliability in evaluating proposed Reliability Transmission Upgrades. A Reliability Transmission Upgrade may provide market efficiency benefits as well as reliability benefits to the New England Transmission System.

Remittance Advice is an issuance from the ISO for the net Payment owed to a Covered Entity where a Covered Entity's total Payments exceed its total Charges in a billing period.

Remittance Advice Date is the day on which the ISO issues a Remittance Advice.

Renewable Technology Resource is a Generating Capacity Resource that satisfies the requirements specified in Section III.13.1.1.1.7.

Re-Offer Period is the period that normally occurs between the posting of the of the Day-Ahead Energy Market results and 2:00 p.m. on the day before the Operating Day during which a Market Participant may submit revised Supply Offers, revised External Transactions, or revised Demand Bids associated with Dispatchable Asset Related Demands or, for Capacity Commitment Periods commencing on or after June 1, 2017, revised Demand Reduction Offers associated with Demand Response Resources.

Replacement Reserve is described in Part III, Section VII of ISO New England Operating Procedure No. 8.

Request for Alternative Proposals (RFAP) is the request described in Attachment K of the OATT.

Requested Billing Adjustment (RBA) is defined in Section 6.1 of the ISO New England Billing Policy.

Required Balance is an amount as defined in Section 5.3 of the Billing Policy.

Reseller is a MGTSA holder that sells, assigns or transfers its rights under its MGTSA, as described in Section II.45.1(a) of the OATT.

Reserve Constraint Penalty Factors (RCPFs) are rates, in \$/MWh, that are used within the Real-Time dispatch and pricing algorithm to reflect the value of Operating Reserve shortages and are defined in Section III.2.7A(c) of Market Rule 1.

Reserve Zone is defined in Section III.2.7 of Market Rule 1.

Reserved Capacity is the maximum amount of capacity and energy that is committed to the Transmission Customer for transmission over the New England Transmission System between the Point(s) of Receipt and the Point(s) of Delivery under Part II.C or Schedule 18, 20 or 21 of the OATT, as applicable. Reserved Capacity shall be expressed in terms of whole kilowatts on a sixty-minute interval (commencing on the clock hour) basis, or, in the case of Reserved Capacity for Local Point-to-Point Service, in terms of whole megawatts on a sixty-minute interval basis.

Resource means a generating unit, a Dispatchable Asset Related Demand, an External Resource or an External Transaction or, for Capacity Commitment Periods commencing on or after June 1, 2017, a Demand Response Resource.

Restated New England Power Pool Agreement (RNA) is the Second Restated New England Power Pool Agreement, which restated for a second time by an amendment dated as of August 16, 2004 the New England Power Pool Agreement dated September 1, 1971, as the same may be amended and restated from time to time, governing the relationship among the NEPOOL members.

Rest-of-Pool Capacity Zone is a single Capacity Zone made up of the adjacent Load Zones that are neither export-constrained nor import-constrained.

Rest of System is an area established under Section III.2.7(d) of Market Rule 1.

Retail Delivery Point is the point on the transmission or distribution system at which the load of an end-use facility, which is metered and assigned a unique account number by the Host Participant, is measured to determine the amount of energy delivered to the facility from the transmission and distribution system. If an end-use facility is connected to the transmission or distribution system at more than one location, the Retail Delivery Point shall consist of the metered load at each connection point, summed to measure the net energy delivered to the facility in each interval.

Returning Market Participant is a Market Participant, other than an FTR-Only Customer or a Governance Only Member, whose previous membership as a Market Participant was involuntarily terminated due to a Financial Assurance Default or a payment default and, since returning, has been a Market Participant for less than six consecutive months.

Revenue Requirement is defined in Section IV.A.2.1 of the Tariff.

Reviewable Action is defined in Section III.D.1.1 of Appendix D of Market Rule 1.

Reviewable Determination is defined in Section 12.4(a) of Attachment K to the OATT.

RSP Project List is defined in Section 1 of Attachment K to the OATT.

RTEP02 Upgrade(s) means a Transmission Upgrade that was included in the annual NEPOOL Transmission Plan (also known as the “Regional Transmission Expansion Plan” or “RTEP”) for the year 2002, as approved by ISO New England Inc.’s Board of Directors, or the functional equivalent of such Transmission Upgrade, as determined by ISO New England Inc. The RTEP02 Upgrades are listed in Schedule 12B of the OATT.

RTO is a regional transmission organization or comparable independent transmission organization that complies with Order No. 2000 and the Commission’s corresponding regulation.

Same Reserve Zone Export Transaction is defined in Section III.1.10.7(f)(iii) of Market Rule 1.

Sanctionable Behavior is defined in Section III.B.3 of Appendix B of Market Rule 1.

Schedule, Schedules, Schedule 1, 2, 3, 4 and 5 are references to the individual or collective schedules to Section IV.A. of the Tariff.

Schedule 20A Service Provider (SSP) is defined in Schedule 20A to Section II of this Tariff.

Scheduling Service, for purposes of Section IV.A and Section IV.B of the Tariff, is the service described in Schedule 1 to Section IV.A of the Tariff.

Scheduling, System Control and Dispatch Service, for purposes of Section II of the Tariff, is the form of Ancillary Service described in Schedule 1 of the OATT.

Seasonal Claimed Capability is the summer or winter claimed capability of a generating unit or ISO-approved combination of units, and represent the maximum dependable load carrying ability of such unit or units, excluding capacity required for station use.

Seasonal Claimed Capability Audit is the audit performed pursuant to Section III.1.5.1.3.

Seasonal DR Audit is a seasonal audit of the demand response capability of a Demand Resource initiated pursuant to Section III.13.6.1.5.4.1.

Seasonal Peak Demand Resource is a type of Demand Resource and shall mean installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that reduce the total amount of electrical energy consumed during Demand Resource Seasonal Peak Hours, while delivering a comparable or acceptable level of end-use service. Such measures include Energy Efficiency, Load Management, and Distributed Generation.

Section III.1.4 Transactions are defined in Section III.1.4.2 of Market Rule 1.

Section III.1.4 Conforming Transactions are defined in Section III.1.4.2 of Market Rule 1.

Security Agreement is Attachment 1 to the ISO New England Financial Assurance Policy.

Self-Schedule is the action of a Market Participant in committing and/or scheduling its Resource, in accordance with applicable ISO New England Manuals, to provide service in an hour, whether or not in the absence of that action the Resource would have been scheduled or dispatched by the ISO to provide the service. Demand Response Resources are not permitted to Self-Schedule.

Self-Scheduled MW is an amount, in megawatts, that is Self-Scheduled and is equal to the greater of: (i) the Resource's Economic Minimum Limit; or (ii) the Resource's Minimum Consumption Limit; or (iii) for a generating Resource for which the Regulation Self-Schedule flag is set for the hour and the unit was

on Regulation for at least 20 minutes during the applicable hour of the Operating Day, the median value of all Regulation setpoints (Desired Dispatch Point) used by the Resource while regulating.

Self-Supplied FCA Resource is described in Section III.13.1.6 of Market Rule 1.

Senior Officer means an officer of the subject entity with the title of vice president (or similar office) or higher, or another officer designated in writing to the ISO by that office.

Service Agreement is a Transmission Service Agreement or an MPSA.

Service Commencement Date is the date service is to begin pursuant to the terms of an executed Service Agreement, or the date service begins in accordance with the sections of the OATT addressing the filing of unexecuted Service Agreements.

Services means, collectively, the Scheduling Service, EAS and RAS; individually, a Service.

Settlement Financial Assurance is an amount of financial assurance required from a Designated FTR Participant awarded a bid in an FTR Auction. This amount is calculated pursuant to Section VI.D of the ISO New England Financial Assurance Policy.

Settlement Only Resources are generators of less than 5 MW or otherwise eligible for Settlement Only Resource treatment as described in ISO New England Operating Procedure No. 14 and that have elected Settlement Only Resource treatment as described in the ISO New England Manual for Registration and Performance Auditing.

Seven-Day Forecast has the meaning specified in Section III.H.3.3(a).

Shortage Event is defined in Section III.13.7.1.1.1 of Market Rule 1.

Shortage Event Availability Score is the average of the hourly availability scores for each hour or portion of an hour during a Shortage Event, as described in Section III.13.7.1.1.1.A of Market Rule 1.

Shortfall Funding Arrangement, as specified in Section 5.1 of the ISO New England Billing Policy, is a separate financing arrangement that can be used to make up any non-congestion related differences between amounts received on Invoices and amounts due for ISO Charges in any bill issued.

Short-Term is a period of less than one year.

Significantly Reduced Congestion Costs are defined in Section III.G.2.2 of Appendix G to Market Rule 1.

SMD Effective Date is March 1, 2003.

Solutions Study is described in Section 4.2(b) of Attachment K to the OATT.

Special Constraint Resource (SCR) is a Resource that provides Special Constraint Resource Service under Schedule 19 of the OATT.

Special Constraint Resource Service is the form of Ancillary Service described in Schedule 19 of the OATT.

Specified-Term Blackstart Capital Payment is the annual compensation level, as calculated pursuant to Section 5.1 of Schedule 16 of the OATT, for a Designated Blackstart Resource's capital Blackstart Equipment costs associated with the provision of Blackstart Service (except for capital costs associated with adhering to NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Standard Blackstart Capital Payment is the annual compensation level, as calculated pursuant to Section 5.1 of Schedule 16 of the OATT, for a Designated Blackstart Resource's capital Blackstart Equipment costs associated with the provision of Blackstart Service (except for capital costs associated with adhering to NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Start-of-Round Price is the highest price associated with a round of a Forward Capacity Auction as described in Section III.13.2.3.1 of Market Rule 1.

Start-Up Fee is the amount, in dollars, that must be paid for a generating unit to Market Participants with an Ownership Share in the unit each time the unit is scheduled in the New England Markets to start-up.

Start-Up Time is the time it takes the Generator Asset, after synchronizing to the system, to reach its Economic Minimum Limit and, for dispatchable Generator Assets, be ready for further dispatch by the ISO.

State Estimator means the computer model of power flows specified in Section III.2.3 of Market Rule 1.

Statements, for the purpose of the ISO New England Billing Policy, refer to both Invoices and Remittance Advices.

Static De-List Bid is a bid that may be submitted by an Existing Generating Capacity Resource, Existing Import Capacity Resource, or Existing Demand Resource in the Forward Capacity Auction to remove itself from the capacity market for a one year period, as described in Section III.13.1.2.3.1.1 of Market Rule 1.

Station is one or more Existing Generating Capacity Resources consisting of one or more assets located within a common property boundary.

Station Going Forward Common Costs are the net risk-adjusted going forward costs associated with a Station that are avoided only by (1) the clearing of the Static De-List Bids or the Permanent De-List Bids of all the Existing Generating Capacity Resources comprising the Station; or (2) the acceptance of a Non-Price Retirement Request of the Station, calculated in the same manner as the net-risk adjusted going forward costs of Existing Generating Capacity Resources as described in Section III.13.1.2.3.2.1.2.

Station-level Blackstart O&M Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Station-level Specified-Term Blackstart Capital Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Station-level Standard Blackstart Capital Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Successful FCA is a Forward Capacity Auction in which a Capacity Zone has neither Inadequate Supply nor Insufficient Competition.

Summer ARA Qualified Capacity is described in Section III.13.4.2.1.2.1.1.1 of Market Rule 1.

Summer Capability Period means one of two time periods defined by the ISO for the purposes of rating and auditing resources. The time period associated with the Summer Capability Period is the period of June 1 through September 30.

Summer Intermittent Reliability Hours are defined in Section III.13.1.2.2.2.1(c) of Market Rule 1.

Supplemental Availability Bilateral is described in Section III.13.5.3.2 of Market Rule 1.

Supplemental Capacity Resources are described in Section III.13.5.3.1 of Market Rule 1.

Supplemented Capacity Resource is described in Section III.13.5.3.2 of Market Rule 1.

Supply Offer is a proposal to furnish energy at a Node or Regulation from a Resource that meets the applicable requirements set forth in the ISO New England Manuals submitted to the ISO by a Market Participant with authority to submit a Supply Offer for the Resource. The Supply Offer will be submitted pursuant to Market Rule 1 and applicable ISO New England Manuals, and include a price and information with respect to the quantity proposed to be furnished, technical parameters for the Resource, timing and other matters. A Supply Offer is a subset of the information required in a Market Participant's Offer Data.

Supply Offer Block-Hours are Block-Hours assigned to the Lead Market Participant for each Supply Offer. The daily bid Blocks in the price-based Real-Time offer/bid will be multiplied by the number of hours in the day to determine the quantity of Supply Offer Block-Hours for a given day. In the case that a Resource has a Real-Time unit status of "unavailable" for the entire day, that day will not contribute to the quantity of Supply Offer Block-Hours. However, if the Resource has at least one hour of the day with a unit status of "available," the entire day will contribute to the quantity of Supply Offer Block-Hours.

Synchronous Condenser is a generator that is synchronized to the grid but supplying no energy for the purpose of providing Operating Reserve or VAR or voltage support.

System Condition is a specified condition on the New England Transmission System or on a neighboring system, such as a constrained transmission element or flowgate, that may trigger Curtailment of Long-Term Firm MTF or OTF Service on the MTF or the OTF using the curtailment priority pursuant to Section II.44 of the Tariff or Curtailment of Local Long-Term Firm Point-to-Point Transmission Service on the non-PTF using the curtailment priority pursuant to Schedule 21 of the Tariff. Such conditions must be identified in the Transmission Customer's Service Agreement.

System Impact Study is an assessment pursuant to Part II.B, II.C, II.G, Schedule 21, Schedule 22, or Schedule 23 of the OATT of (i) the adequacy of the PTF or Non-PTF to accommodate a request for the interconnection of a new or materially changed generating unit or a new or materially changed interconnection to another Control Area or new Regional Network Service or new Local Service or an Elective Transmission Upgrade, and (ii) whether any additional costs may be required to be incurred in order to provide the interconnection or transmission service.

System Operator shall mean ISO New England Inc. or a successor organization.

System-Wide Capacity Demand Curve is the demand curve used in the Forward Capacity Market as specified in Section III.13.2.2.

TADO is the total amount due and owing (not including any amounts due under Section 14.1 of the RNA) at such time to the ISO, NEPOOL, the PTOs, the Market Participants and the Non-Market Participant Transmission Customers, by all PTOs, Market Participants and Non-Market Participant Transmission Customers.

Tangible Net Worth is the value, determined in accordance with international accounting standards or generally accepted accounting principles in the United States, of all of that entity's assets less the following: (i) assets the ISO reasonably believes to be restricted or potentially unavailable to settle a claim in the event of a default (e.g., regulatory assets, restricted assets, and Affiliate assets), net of any matching liabilities, to the extent that the result of that netting is a positive value; (ii) derivative assets, net of any matching liabilities, to the extent that the result of that netting is a positive value; (iii) the amount at which the liabilities of the entity would be shown on a balance sheet in accordance with international

accounting standards or generally accepted accounting principles in the United States; (iv) preferred stock; (v) non-controlling interest; and (vi) all of that entity's intangible assets (e.g., patents, trademarks, franchises, intellectual property, goodwill and any other assets not having a physical existence), in each case as shown on the most recent financial statements provided by such entity to the ISO.

Technical Committee is defined in Section 8.2 of the Participants Agreement.

Ten-Minute Non-Spinning Reserve (TMNSR) is the reserve capability of a generating unit that can be converted fully into energy within ten minutes from the request of the ISO, and is provided by generating units that are either electrically synchronized or not electrically synchronized to the New England Transmission System or the reserve capability of a Dispatchable Asset Related Demand that can be fully utilized within ten minutes from the request of the ISO to reduce consumption.

Ten-Minute Non-Spinning Reserve Service is the form of Ancillary Service described in Schedule 6 of the OATT.

Ten-Minute Spinning Reserve (TMSR) is the reserve capability of a generating unit that can be converted fully into energy within ten minutes from the request of the ISO or a Dispatchable Asset Related Demand pump that can reduce energy consumption to provide reserve capability within ten minutes from the request of the ISO, and is provided by generating units and Dispatchable Asset Related Demand pumps electrically synchronized to the New England Transmission System.

Ten-Minute Spinning Reserve Service is the form of Ancillary Service described in Schedule 5 of the OATT.

Third-Party Sale is any sale for resale in interstate commerce to a Power Purchaser that is not designated as part of Regional Network Load or Local Network Load under the Regional Network Service or Local Network Service, as applicable.

Thirty-Minute Operating Reserve (TMOR) means the reserve capability of a generating unit that can be converted fully into energy within thirty minutes from the request of the ISO, and is provided by generating units that are either not electrically synchronized or synchronized to the New England Transmission System or the reserve capability of a Dispatchable Asset Related Demand that can be fully utilized within thirty minutes from the request of the ISO to reduce consumption.

Thirty-Minute Operating Reserve Service is the form of Ancillary Service described in Schedule 7 of the OATT.

Through or Out Rate (TOUT Rate) is the rate per hour for Through or Out Service, as defined in Section II.25.2 of the OATT.

Through or Out Service (TOUT Service) means Point-To-Point Service over the PTF provided by the ISO with respect to a transaction that goes through the New England Control Area, as, for example, a single transaction where energy or capacity is transmitted into the New England Control Area from New Brunswick and subsequently out of the New England Control Area to New York, or a single transaction where energy or capacity is transmitted into the New England Control Area from New York through one point on the PTF and subsequently flows over the PTF prior to passing out of the New England Control Area to New York, or with respect to a transaction which originates at a point on the PTF and flows over the PTF prior to passing out of the New England Control Area, as, for example, from Boston to New York.

Tie-Line Asset is a physical transmission tie-line, or an inter-state or intra-state border arrangement created according to the ISO New England Manuals and registered in accordance with the Asset Registration Process.

Time-on-Regulation Credit is the credit associated with provision of Time-on-Regulation Megawatts and is calculated in accordance with Section III.3.2.2(b) of Market Rule 1.

Time-on-Regulation Megawatts is the amount of Regulation capability provided during one hour calculated in accordance with Section III.3.2.2(g) of Market Rule 1.

Total Available Amount is the sum of the available amount of the Shortfall Funding Arrangement and the balance in the Payment Default Shortfall Fund.

Total Blackstart Capital Payment is the annual compensation calculated under either Section 5.1 or Section 5.2 of Schedule 16 of the OATT, as applicable.

Total Blackstart O&M Payment is the annual compensation calculated under either Section 5.1 or 5.2 of Schedule 16 of the OATT, as applicable.

Total Blackstart Service Payments is monthly compensation to Blackstart Owners or Market Participants, as applicable, and as calculated pursuant to Section 5.6 of Schedule 16 to the OATT.

Total Negative Hourly Demand Response Resource Deviation means the absolute value of the sum of the negative Hourly Real-Time Demand Response Resource Deviations and negative Hourly Real-Time Emergency Generation Deviations from all Real-Time Demand Response Resources and Real-Time Emergency Generation Resources receiving Dispatch Instructions in the same hour in the same Dispatch Zone.

Total Positive Hourly Demand Response Resource Deviation means the sum of the positive Hourly Real-Time Demand Response Resource Deviations and positive Hourly Real-Time Emergency Generation Deviations from all Real-Time Demand Response Resources and Real-Time Emergency Generation Resources receiving Dispatch Instructions in the same hour in the same Dispatch Zone.

Total System Capacity is the aggregate capacity supply curve for the New England Control Area as determined in accordance with Section III.13.2.3.3 of Market Rule 1.

Transaction Unit (TU) is a type of billing determinant under Schedule 2 of Section IV.A of the Tariff used to assess charges to Customers.

Transition Period: The six-year period commencing on March 1, 1997.

Transmission Charges, for the purposes of the ISO New England Financial Assurance Policy and the ISO New England Billing Policy, are all charges and payments under Schedules 1, 8 and 9 of the OATT.

Transmission Congestion Credit means the allocated share of total Transmission Congestion Revenue credited to each holder of Financial Transmission Rights, calculated and allocated as specified in Section III.5.2 of Market Rule 1.

Transmission Congestion Revenue is defined in Section III.5.2.5(a) of Market Rule 1.

Transmission Credit Limit is a credit limit, not to be used to meet FTR Requirements, established for each Market Participant in accordance with Section II.D and each Non-Market Participant Transmission Customer in accordance with Section V.B.2 of the ISO New England Financial Assurance Policy.

Transmission Credit Test Percentage is calculated in accordance with Section III.B.1(c) of the ISO New England Financial Assurance Policy.

Transmission Customer is any Eligible Customer that (i) executes, on its own behalf or through its Designated Agent, an MPSA or TSA, or (ii) requests in writing, on its own behalf or through its Designated Agent, that the ISO, the Transmission Owner, or the Schedule 20A Service Provider, as applicable, file with the Commission, a proposed unexecuted MPSA or TSA containing terms and conditions deemed appropriate by the ISO (in consultation with the applicable PTO, OTO or Schedule 20A Service Provider) in order that the Eligible Customer may receive transmission service under Section II of this Tariff. A Transmission Customer under Section II of this Tariff includes a Market Participant or a Non-Market Participant taking Regional Network Service, Through or Out Service, MTF Service, OTF Service, Ancillary Services, or Local Service.

Transmission Default Amount is all or any part of any amount of Transmission Charges due to be paid by any Covered Entity that the ISO, in its reasonable opinion, believes will not or has not been paid when due.

Transmission Default Period is defined in Section 3.4.f of the ISO New England Billing Policy.

Transmission Late Payment Account is defined in Section 4.2 of the ISO New England Billing Policy.

Transmission Late Payment Account Limit is defined in Section 4.2 of the ISO New England Billing Policy.

Transmission Late Payment Charge is defined in Section 4.1 of the ISO New England Billing Policy.

Transmission, Markets and Services Tariff (Tariff) is the ISO New England Inc. Transmission, Markets and Services Tariff, as amended from time to time.

Transmission Obligations are determined in accordance with Section III.A(vi) of the ISO New England Financial Assurance Policy.

Transmission Operating Agreement (TOA) is the Transmission Operating Agreement between and among the ISO and the PTOs, as amended and restated from time to time.

Transmission Owner means a PTO, MTO or OTO.

Transmission Provider is the ISO for Regional Network Service and Through or Out Service as provided under Section II.B and II.C of the OATT; Cross-Sound Cable, LLC for Merchant Transmission Service as provided under Schedule 18 of the OATT; the Schedule 20A Service Providers for Phase I/II HVDC-TF Service as provided under Schedule 20A of the OATT; and the Participating Transmission Owners for Local Service as provided under Schedule 21 of the OATT.

Transmission Requirements are determined in accordance with Section III.A(iii) of the ISO New England Financial Assurance Policy.

Transmission Security Analysis Requirement shall be determined pursuant to Section III.12.2.1.2.

Transmission Service Agreement (TSA) is the initial agreement and any amendments or supplements thereto: (A) in the form specified in either Attachment A or B to the OATT, entered into by the Transmission Customer and the ISO for Regional Network Service or Through or Out Service; (B) entered into by the Transmission Customer with the ISO and PTO in the form specified in Attachment A to Schedule 21 of the OATT; (C) entered into by the Transmission Customer with an OTO or Schedule 20A Service Provider in the appropriate form specified under Schedule 20 of the OATT; or (D) entered into by the Transmission Customer with a MTO in the appropriate form specified under Schedule 18 of the OATT. A Transmission Service Agreement shall be required for Local Service, MTF Service and OTF Service, and shall be required for Regional Network Service and Through or Out Service if the Transmission Customer has not executed a MPSA.

Transmission Upgrade(s) means an upgrade, modification or addition to the PTF that becomes subject to the terms and conditions of the OATT governing rates and service on the PTF on or after January 1, 2004. This categorization and cost allocation of Transmission Upgrades shall be as provided for in Schedule 12 of the OATT.

UDS is unit dispatch system software.

Unconstrained Export Transaction is defined in Section III.1.10.7(f)(iv) of Market Rule 1.

Uncovered Default Amount is defined in Section 3.3(i) of the ISO New England Billing Policy.

Uncovered Transmission Default Amounts are defined in Section 3.4.f of the ISO New England Billing Policy.

Unrated means a Market Participant that is not a Rated Market Participant.

Unsecured Covered Entity is, collectively, an Unsecured Municipal Market Participant and an Unsecured Non-Municipal Covered Entity.

Unsecured Municipal Default Amount is defined in Section 3.3(i) of the ISO New England Billing Policy.

Unsecured Municipal Market Participant is defined in Section 3.3(h) of the ISO New England Billing Policy.

Unsecured Municipal Transmission Default Amount is defined in Section 3.4.f of the ISO New England Billing Policy.

Unsecured Non-Municipal Covered Entity is a Covered Entity that is not a Municipal Market Participant or a Non-Market Participant Transmission Customer and has a Market Credit Limit or Transmission Credit Limit of greater than \$0 under the ISO New England Financial Assurance Policy.

Unsecured Non-Municipal Default Amount is defined in Section 3.3(i) of the ISO New England Billing Policy.

Unsecured Non-Municipal Transmission Default Amount is defined in Section 3.3(i) of the ISO New England Billing Policy.

Unsecured Transmission Default Amounts are, collectively, the Unsecured Municipal Transmission Default Amount and the Unsecured Non-Municipal Transmission Default Amount.

Updated Measurement and Verification Plan is an optional Measurement and Verification Plan that may be submitted as part of a subsequent qualification process for a Forward Capacity Auction prior to the beginning of the Capacity Commitment Period of the Demand Resource project. The Updated Measurement and Verification Plan may include updated Demand Resource project specifications, measurement and verification protocols, and performance data as described in Section III.13.1.4.3.1.2 of Market Rule 1 and the ISO New England Manuals.

VAR CC Rate is the CC rate paid to Qualified Reactive Resources for VAR Service capability under Section IV.A of Schedule 2 of the OATT.

VAR Payment is the payment made to Qualified Reactive Resources for VAR Service capability under Section IV.A of Schedule 2 of the OATT.

VAR Service is the provision of reactive power voltage support to the New England Transmission System by a Qualified Reactive Resource or by other generators that are dispatched by the ISO to provide dynamic reactive power as described in Schedule 2 of the OATT.

Virtual Requirements are determined in accordance with Section III.A(iv) of the ISO New England Financial Assurance Policy.

Volt Ampere Reactive (VAR) is a measurement of reactive power.

Volumetric Measure (VM) is a type of billing determinant under Schedule 2 of Section IV.A of the Tariff used to assess charges to Customers under Section IV.A of the Tariff.

Winter ARA Qualified Capacity is described in Section III.13.4.2.1.2.1.1.2 of Market Rule 1.

Winter Capability Period means one of two time periods defined by the ISO for the purposes of rating and auditing resources. The time period associated with the Winter Capability Period is the period October 1 through May 31.

Winter Intermittent Reliability Hours are defined in Section III.13.1.2.2.2(c) of Market Rule 1.

Year means a period of 365 or 366 days, whichever is appropriate, commencing on, or on the anniversary of March 1, 1997. Year One is the Year commencing on March 1, 1997, and Years Two and higher follow it in sequence.

Zonal Price is calculated in accordance with Section III.2.7 of Market Rule 1.

III.12 Calculation of Capacity Requirements

III.12.1 Installed Capacity Requirement.

Prior to each Forward Capacity Auction, the ISO shall calculate the Installed Capacity Requirement for the New England Control Area for each upcoming Capacity Commitment Period through the Capacity Commitment Period associated with that Forward Capacity Auction in accordance with this Section III.12.1.

The ISO shall determine the Installed Capacity Requirement such that the probability of disconnecting non-interruptible customers due to resource deficiency, on average, will be no more than once in ten years. Compliance with this resource adequacy planning criterion shall be evaluated probabilistically, such that the Loss of Load Expectation (“LOLE”) of disconnecting non-interruptible customers due to resource deficiencies shall be no more than 0.1 day each year. The forecast Installed Capacity Requirement shall meet this resource adequacy planning criterion for each Capacity Commitment Period. The Installed Capacity Requirement shall be determined assuming all resources pursuant to Sections III.12.7 and III.12.9 will be deliverable to meet the forecasted demand determined pursuant to Section III.12.8.

If the Installed Capacity Requirement shows a consistent bias over time, either high or low, the ISO shall make adjustments to the modeling assumptions and/or methodology through the stakeholder process to eliminate the bias in the Installed Capacity Requirement. The modeling assumptions used in determining the Installed Capacity Requirement are specified in Sections III.12.7, III.12.8 and III.12.9. For the purpose of this Section III.12, a “resource” shall include generating resources, demand resources, and import capacity resources eligible to receive capacity payments in the Forward Capacity Market.

The ISO shall determine, by applying the same modeling assumptions and methodology used in determining the Installed Capacity Requirement, the capacity requirement value for each LOLE probability specified in Section III.13.2.2 for the System-Wide Capacity Demand Curve.

III.12.2 Local Sourcing Requirements and Maximum Capacity Limits.

Prior to each Forward Capacity Auction, the ISO shall calculate the capacity requirements and limitations, accounting for relevant transmission interface limits which shall be determined pursuant to Section III.12.5, for each modeled Capacity Zone (as described in Section III.12.4) for each upcoming Capacity Commitment Period through the Capacity Commitment Period associated with that Forward Capacity

Auction. The Local Sourcing Requirement shall represent the minimum amount of capacity that must be procured within an import-constrained Capacity Zone. The Maximum Capacity Limit shall represent the maximum amount of capacity that can be procured in an export-constrained Capacity Zone to meet the Installed Capacity Requirement.

The ISO shall use consistent assumptions and standards to establish a resource's electrical location for purposes of qualifying a resource for the Forward Capacity Market and for purposes of calculating Local Sourcing Requirements and Maximum Capacity Limits. The methodology used in determining the Local Sourcing Requirements and the Maximum Capacity Limits are specified in Sections III.12.2.1 and III.12.2.2, respectively. The modeling assumptions used in determining the Local Sourcing Requirements and the Maximum Capacity Limits are specified in Sections III.12.5, III.12.6, III.12.7, III.12.8 and III.12.9.

III.12.2.1 Calculation of Local Sourcing Requirements for Import-Constrained Capacity Zones.

For each import-constrained Capacity Zone, the Local Sourcing Requirement shall be the amount needed to satisfy the higher of: (i) the Local Resource Adequacy Requirement as determined pursuant to Section III.12.2.1.1; or (ii) the Transmission Security Analysis Requirement as determined pursuant to Section III.12.2.1.2.

III.12.2.1.1 Local Resource Adequacy Requirement.

The Local Resource Adequacy Requirement shall be calculated as follows:

- (a) Two areas shall be modeled: (i) the Capacity Zone under study which includes all load and all resources electrically located within the Capacity Zone, including external Control Area support from tie benefits on the import-constrained side of the interface, if any; and (ii) the rest of the New England Control Area which includes all load and all resources electrically located within the rest of the New England Control Area, including external Control Area support from tie benefits on the unconstrained side of the interface, if any.
- (b) The only transmission constraint to be modeled shall be the transmission interface limit between the Capacity Zone under study and the rest of the New England Control Area as identified pursuant to Section III.12.5.

(c) Any proxy units that are required in the New England Control Area pursuant to Section III.12.7.1 shall be modeled as specified in Section III.12.7.1, in order to ensure that the New England Control Area meets the resource adequacy planning criterion specified in Section III.12.1. If the system LOLE is less than 0.1 days/year, firm load is added (or unforced capacity is subtracted) so that the system LOLE equals 0.1 days/year.

(d) The Local Resource Adequacy Requirement for the import-constrained Capacity Zone Z shall be determined in accordance with the following formula:

$$LRA_Z = Resources_Z + Proxy Units_Z - (Proxy Units Adjustment_Z(1-FOR_Z)) - (Firm Load Adjustment_Z(1-FOR_Z))$$

In which:

LRA_Z = MW of Local Resource Adequacy Requirement for Capacity Zone Z;

$Resources_Z$ = MW of resources electrically located within Capacity Zone Z, including import Capacity Resources on the import-constrained side of the interface, if any;

$Proxy Units_Z$ = MW of proxy unit additions in Load Zone Z;

$Firm Load Adjustment_Z$ = MW of firm load added (or subtracted) within Capacity Zone Z to make the LOLE of the New England Control Area equal to 0.105 days per year; and

FOR_Z = Capacity weighted average of the forced outage rate modeled for all resources within Capacity Zone Z, including and proxy unit additions to Capacity Zone Z.

$Proxy Units Adjustment$ = MW of firm load added to (or unforced

capacity subtracted from) Capacity Zone Z
 until the system LOLE equals 0.1
 days/year.

To determine the Local Resource Adequacy Requirement, the firm load is adjusted within Capacity Zone Z until the LOLE of the New England Control Area reaches 0.105 days per year. The LOLE of 0.105 days per year includes an allowance for transmission related LOLE of 0.005 days per year associated with each interface. As firm load is added to (or subtracted from) Capacity Zone Z, an equal amount of firm load is removed from (or added to) the rest of New England Control Area.

III.12.2.1.2 Transmission Security Analysis Requirement.

A Transmission Security Analysis shall be used to determine the requirement of the zone being studied, and shall include the following features:

- (a) The ISO shall perform a series of transmission load flow studies and/or a deterministic operable capacity analysis targeted at determining the performance of the system under stressed conditions, and at developing a resource requirement sufficient to allow the system to operate through those stressed conditions.
- (b) The Transmission Security Analysis Requirement shall be set at a level sufficient to cover most reasonably anticipated events, but will not guarantee that every combination of obligated resources within the zone will meet system needs.
- (c) In performing the Transmission Security Analysis, the ISO may establish static transmission interface transfer limits, as identified pursuant to Section III.12.5, as a reasonable representation of the transmission system's capability to serve load with available existing resources.
- (d) The Transmission Security Analysis may model the entire New England system and individual zones, for both the first contingency (N-1) and second contingency (N-1-1) conditions. First contingency conditions (N-1) shall include the loss of the most critical generator or most critical transmission element with respect to the zone. Second contingency conditions (N-1-1) shall include both: (i) the loss of the most critical generator with respect to the zone followed by the loss of the most critical transmission element ("Line-Gen"); and (ii) the loss of the most critical transmission element followed by the loss of the next most critical transmission element ("Line-Line") with respect to the zone.

III.12.2.2 Calculation of Maximum Capacity Limit for Export-Constrained Capacity Zones.

For each export-constrained Capacity Zone, the Maximum Capacity Limit shall be calculated using the following method:

- (a) Two areas shall be modeled: (i) the Capacity Zone under study which includes all load and all resources electrically located within the Capacity Zone, including external Control Area support from tie benefits on the export-constrained side of the interface, if any; and (ii) the rest of the New England Control Area, which includes all load and all resources electrically located within the rest of the New England Control Area, including external Control Area support from tie benefits to the rest of the New England Control Area, if any.
- (b) The only transmission constraint to be modeled shall be the transmission interface limit between the Capacity Zone under study and the rest of the New England Control Area as identified pursuant to Section III.12.5.
- (c) Any proxy units that are required in the New England Control Area pursuant to Section III.12.7.1 shall be modeled as specified in Section III.12.7.1, in order to ensure that the New England Control Area meets the resource adequacy planning criterion specified in Section III.12.1. If the system LOLE is less than 0.1 days/year, firm load is added (or unforced capacity is subtracted) so that the system LOLE equals 0.1 days/year.
- (d) The Maximum Capacity Limit for the export-constrained Capacity Zone Y shall be determined in accordance with the following formula:

$$\text{Maximum Capacity Limit}_Y = \text{ICR} - \text{LRA}_{\text{RestofNewEngland}}$$

In which:

Maximum Capacity Limit_Y = Maximum MW amount of resources, including Import Capacity Resources on the export-constrained side of the interface, if any, that can be procured in the export-constrained Capacity Zone Y to meet the Installed Capacity Requirement;

ICR = MW of Installed Capacity Requirement for the New England Control Area, determined in accordance with Section III.12.1; and

$LRA_{\text{RestofNewEngland}}$ = MW of Local Sourcing Requirement for the rest of the New England Control Area, which for the purposes of this calculation is treated as an import-constrained region, determined in accordance with Section III.12.2.1.

III.12.3 Consultation and Filing of Capacity Requirements.

At least two months prior to filing the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve for each upcoming Capacity Commitment Period through the relevant Capacity Commitment Period with the Commission, the ISO shall review the modeling assumptions and resulting Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve with the Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies. Following consultation with Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies, the ISO shall file the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve for each upcoming Capacity Commitment Period through the relevant Capacity Commitment Period with the Commission pursuant to Section 205 of the Federal Power Act 90 days prior to the Forward Capacity Auction for the Capacity Commitment Period. The ISO shall file with the Commission pursuant to Section 205 of the Federal Power Act, the proposed identification of a potential new Capacity Zone when the boundary of the potential new Capacity Zone differs from the boundaries of existing Load Zones or Capacity Zones. In order to be used in a given FCA, any new Capacity Zone must have received approval from the Commission prior to the Existing Capacity Qualification Deadline of the applicable FCA.

III.12.4 Capacity Zones.

For each Forward Capacity Auction, the ISO shall, using the results of the most recent annual assessment of transmission transfer capability conducted pursuant to ISO Tariff Section II, Attachment K, determine the Capacity Zones to model as described below, and will include such designations in its filing with the Commission pursuant to Section III.13.8.1:

- (a) The ISO shall model in the Forward Capacity Auction, as separate export-constrained Capacity Zones, those zones identified in the most recent annual assessment of transmission transfer capability pursuant to ISO Tariff Section II, Attachment K, for which the Maximum Capacity Limit is less than the sum of the existing qualified capacity and proposed new capacity that could qualify to be procured in the export constrained Capacity Zone, including existing and proposed new Import Capacity Resources on the export-constrained side of the interface.
- (b) The ISO shall model in the Forward Capacity Auction, as separate import-constrained Capacity Zones, those zones identified in the most recent annual assessment of transmission transfer capability pursuant to ISO Tariff Section II, Attachment K, for which the second contingency transmission capability results in a line-line Transmission Security Analysis Requirement, calculated pursuant to Section III.12.2.1.2 and pursuant to ISO New England Planning Procedures, that is greater than the Existing Qualified Capacity in the zone, with the largest generating station in the zone modeled as out-of-service. Each assessment will model out-of-service all Non-Price Retirement Requests (including any received for the current FCA at the time of this calculation) and Permanent De-List Bids as well as rejected for reliability Static De-List Bids from the most recent previous Forward Capacity Auction and rejected for reliability Dynamic De-List Bids from the most recent previous Forward Capacity Auction.
- (c) Adjacent Load Zones that are neither export-constrained nor import-constrained shall be modeled together as the Rest of Pool Capacity Zone in the Forward Capacity Auction.

III.12.5 Transmission Interface Limits.

Transmission interface limits, used in the determination of Local Sourcing Requirements, shall be determined pursuant to ISO Tariff Section II, Attachment K using network models that include all resources, existing transmission lines and proposed transmission lines that the ISO determines, in accordance with Section III.12.6, will be in service no later than the first day of the relevant Capacity Commitment Period. The transmission interface limits shall be established, using deterministic analyses, at levels that provide acceptable thermal, voltage and stability performance of the system both with all lines in service and after any criteria contingency occurs as specified in ISO New England Manuals and ISO New England Administrative Procedures.

III.12.6 Modeling Assumptions for Determining the Network Model.

The ISO shall determine, in accordance with this Section III.12.6, the generating units and transmission infrastructure to include in the network model that: (i) are expected to be in service no later than the first day of the relevant Capacity Commitment Period; and (ii) may have a material impact on the network model, a potential interface constraint, or on one or more Local Sourcing Requirements. The network model shall be used, among other purposes, (i) for the Forward Capacity Market qualification process and (ii) to calculate transmission interface limits in order to forecast the Local Sourcing Requirements. The network model shall include generating units and associated Interconnection Facilities as specified in subsection (a) and Transmission Upgrades as specified in subsection (b).

(a) Generating units and associated Interconnection Facilities that shall be included in the network model for the relevant Capacity Commitment Period shall include:

(i) all existing resources that have not been approved to be retired for the relevant Capacity Commitment Period, as described in Section III.13.2.5.2.5.3;

(ii) all generating units that are resources cleared in previous Forward Capacity Auctions or obligated for the relevant Capacity Commitment Period that have a valid Interconnection Request for which a draft Interconnection System Impact Study report has been submitted to the Interconnection Customer; and

iii. any generating unit that has a valid Interconnection Request for which a draft Interconnection Feasibility Study report has been submitted to the Interconnection Customer and is reasonably expected to declare commercial operation no later than the first day of the relevant Capacity Commitment Period whether or not such unit is participating in the Forward Capacity Market qualification process.

(b) Prior to each Forward Capacity Auction and each annual reconfiguration auction, the ISO shall determine and publish a list of the transmission projects and elements of transmission projects that will be included in the network model. During the process of making the transmission infrastructure determinations, as described in Section III.12.6.1, the ISO shall consult with the Governance Participants, the Transmission Owners, any transmission project proponents, the state utility regulatory agencies in New England and, as appropriate, other state agencies.

III.12.6.1 Process for Establishing the Network Model

- (a) The ISO shall establish an initial network model prior to the Forward Capacity Auction that only includes transmission infrastructure that is already in service at the time that the initial network model is developed.
- (b) After establishing the initial network model, the ISO shall compile a preliminary list of the transmission projects or elements of transmission projects in the RSP Project List, individually or in combination with each other, as appropriate, to identify transmission projects that may achieve an in-service date no later than the first day of the relevant Capacity Commitment Period and that will have a material impact on the network model, on a potential interface constraint or one or more Local Sourcing Requirements.
- (c) For the transmission projects or elements of transmission projects in the RSP Project List that are included in the preliminary list developed pursuant to subsection (b), the ISO shall determine whether the transmission projects or elements of transmission projects meet all of the initial threshold milestones specified in Section III.12.6.2 and will be considered for further evaluation pursuant to subsection (d).
- (d) For those transmission projects or elements of transmission projects that meet the initial threshold milestones in subsection (c), the ISO shall use the evaluation criteria specified in Section III.12.6.3, and any other relevant information, to determine whether to include a transmission project or element of a transmission project in the final network model.
- (e) If after completing its evaluation pursuant to Sections III.12.6.1 through III.12.6.3 and conferring with the transmission project proponents, the Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies, the ISO determines that the transmission project or a portion of the transmission project is reasonably expected to be in service no later than the first day for the relevant Capacity Commitment Period, then such transmission project or portion of transmission project shall be considered in service in the finalized network model to calculate the transmission interface limits pursuant to Section III.12.5.

III.12.6.2 Initial Threshold to be Considered In-Service.

The ISO shall determine whether transmission projects or elements of transmission projects meet all of the following initial threshold milestones:

- (a) A critical path schedule for the transmission project has been furnished to ISO showing that the transmission project or the element of the transmission project will be in-service no later than the first day

of the relevant Capacity Commitment Period. The critical path schedule must be sufficiently detailed to allow the ISO to evaluate the feasibility of the schedule.

(b) At the time of the milestone review, siting and permitting processes, if required, are on schedule as shown on the critical path schedule.

(c) At the time of the milestone review, engineering is on schedule as shown on the critical path schedule.

(d) At the time of the milestone review, land acquisition, if required, is on schedule as shown on the critical path schedule.

(e) Corporate intent to build the transmission project has been furnished to the ISO. An officer of the host Transmission Owner has submitted to the ISO a statement verifying that the officer has reviewed the proposal and critical path schedule submitted to the ISO, and the Transmission Owner concurs that the schedule is achievable, and it is the intent of the Transmission Owner to build the proposed transmission project in accordance with that schedule. The Transmission Owner may develop alternatives or modifications to the transmission project during the course of design of the transmission project that accomplish at least the same transfer capability. Such alternatives or modifications are acceptable, so long as the ISO determines that the alternative or modification is reasonably expected to achieve an in-service date no later than the first day of the relevant Capacity Commitment Period. The provision of an officer's statement shall be with the understanding that the statement shall not create any liability on the officer and that any liability with respect to the Transmission Owner's obligations shall be as set forth in the Transmission Operating Agreement and shall not be affected by such officer's statement.

III.12.6.3 Evaluation Criteria.

For a transmission project or element of a transmission project that meets the initial threshold milestones specified in Section III.12.6.2, the ISO shall consider the following factors and any other relevant information to determine whether to include the transmission project or element of the transmission project in the network model for the relevant Capacity Commitment Period.

(a) Sufficient engineering to initiate construction is on schedule as shown on the critical path schedule.

- (b) Approval under Section I.3.9 of the Transmission, Markets and Services Tariff, if required, has been obtained or is on schedule to be obtained as shown on the critical path schedule.
- (c) Significant permits, including local permits, if required to initiate construction have been obtained or are on schedule consistent with the critical path schedule.
- (d) Easements, if required, have been obtained or are on schedule consistent with the critical path schedule. Needed land purchases, if required, have been made or are on schedule consistent with the critical path schedule.
- (e) Any contracts required to procure or construct a transmission project are in place consistent with the critical path schedule. The ISO's analysis may also take into account whether such contracts contain incentive and/or penalty clauses to encourage third parties to advance the delivery of material services to conform with the critical path schedule.
- (f) Physical site work is on schedule consistent with the critical path schedule.
- (g) The transmission project is in a designated National Interest Electric Transmission Corridor in accordance with Section 216 of the Federal Power Act, 16 U.S.C. §§ 824p.

III.12.7 Resource Modeling Assumptions.

III.12.7.1 Proxy Units.

When the available resources are insufficient for the unconstrained New England Control Area to meet the resource adequacy planning criterion specified in Section III.12.1, proxy units shall be used as additional capacity to determine the Installed Capacity Requirement, Local Resource Adequacy Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve. The proxy units shall reflect resource capacity and outage characteristics such that when the proxy units are used in place of all other resources in the New England Control Area, the reliability, or LOLE, of the New England Control Area does not change. The outage characteristics are the summer capacity weighted average availability of the resources in the New England Control Area as determined in accordance with Section III.12.7.3. The capacity of the proxy unit is determined by adjusting the capacity of the proxy unit until the LOLE of the New England Control Area is equal to the LOLE calculated while using the capacity assumptions described in Section III.12.7.2.

When modeling transmission constraints for the determination of Local Resource Adequacy Requirements, the same proxy units may be added to the import-constrained zone or elsewhere in the rest of the New England Control Area depending on where system constraints exist.

III.12.7.2 Capacity.

The resources included in the calculation of the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve shall include:

- (a) all Existing Generating Capacity Resources,
- (b) resources cleared in previous Forward Capacity Auctions or obligated for the relevant Capacity Commitment Period,
- (c) all Existing Import Capacity Resources backed by a multiyear contract to provide capacity in the New England Control Area, where that multiyear contract requires delivery of capacity for the Commitment Period for which the Installed Capacity Requirement is being calculated, and
- (d) Existing Demand Resources that are qualified to participate in the Forward Capacity Market and New Demand Resources that have cleared in previous Forward Capacity Auctions and obligated for the relevant Capacity Commitment Period,

but shall exclude:

- (e) capacity associated with Export Bids cleared in previous Forward Capacity Auctions and obligated for the relevant Capacity Commitment Period, and
- (f) resources for which Permanent De-list Bids cleared in previous Forward Capacity Auctions or for which Non-Price Retirement Requests have been received.

The rating of Existing Generating Capacity Resources and Existing Import Capacity Resources used in the calculation of the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve shall be the

summer Qualified Capacity value of such resources for the relevant zone. The rating of Demand Resources shall be the summer Qualified Capacity value reduced by any reserve margin adjustment factor that is otherwise included in the summer Qualified Capacity value. The rating of resources, except for Demand Resources, cleared in previous Forward Capacity Auctions and obligated for the relevant Capacity Commitment Period shall be based on the amount of Qualified Capacity that cleared in previous Forward Capacity Auctions or obligated for the relevant Capacity Commitment Period. Resources are located within the Capacity Zones in which they are electrically connected as determined during the qualification process.

III.12.7.2.1 [Reserved.]

III.12.7.3 Resource Availability.

The Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve shall be calculated taking resource availability into account and shall be determined as follows:

For Existing Generating Capacity Resources:

(a) The most recent five-year moving average of EFORd shall be used as the measure of resource availability used in the calculation of the Installed Capacity Requirement, Local Resource Adequacy Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve. The most recent five-year moving average of EFORd shall be used as the measure of resource availability for non-peaking resources used in the calculation of Transmission Security Analysis Requirements. A deterministic adjustment factor, based on the operational experience of the ISO, shall be used as the measure of resource availability for peaking resources used in the calculation of Transmission Security Analysis Requirements, and will be reviewed periodically.

(b) [Reserved.]

(c) Once sufficient data are collected under the availability incentives in the Forward Capacity Market, a resource availability metric, which reflects resource availability in a manner that is consistent with the availability incentives in the Forward Capacity Market, shall be developed and reviewed with Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies and used in the calculation of the Installed Capacity Requirement, Local Sourcing

Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve.

For resources cleared in previous Forward Capacity Auctions or obligated for the relevant Capacity Commitment Period that do not have sufficient data to calculate an availability metric as defined in subsections (a) or (c) above, class average data for similar resource types shall be used. For Demand Resources, including Real-Time Emergency Generation, historical performance data for those resources will be used to develop an availability metric for use in the calculation of the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve.

III.12.7.4 Load and Capacity Relief.

Load and capacity relief expected from system-wide implementation of the following actions specified in ISO New England Operating Procedure No. 4. Action During a Capacity Deficiency, shall be included in the calculation of the Installed Capacity Requirement, Local Resource Adequacy Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve. :

- (a) **Implement voltage reduction.** The MW value of the load relief shall be equal to the percentage load reduction achieved in the most applicable voltage reduction tests multiplied by the forecasted seasonal peak loads.
- (b) **Arrange for available Emergency energy from Market Participants or neighboring Control Areas.** These actions are included in the calculation through the use of tie benefits to meet system needs. The MW value of tie benefits is calculated in accordance with Section III.12.9.
- (c) **Maintain an adequate amount of ten-minute synchronized reserves.** The amount of system reserves included in the determination of the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve shall be consistent with those needed for reliable system operations during Emergency Conditions. When modeling transmission constraints, the reserve requirement for a zone shall be the zone's pro rata share of the forecasted system peak load multiplied by the system reserves needed for reliable system operations during Emergency Conditions.

III.12.8 Load Modeling Assumptions.

The ISO shall forecast load for the New England Control Area and for each Load Zone within the New England Control Area. The load forecasts shall be based on appropriate models and data inputs. Each year, the load forecasts and underlying methodologies, inputs and assumptions shall be reviewed with Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies. If the load forecast shows a consistent bias over time, either high or low, the ISO shall propose adjustments to the load modeling methodology to the Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies to eliminate the bias.

Demand Resources shall be reflected in the load forecast as specified below:

- (a) Expected reductions from an installed or forecast Demand Resource not qualifying for or not participating in the Forward Capacity Auction shall be reflected as a reduction in the load forecast that will be used to determine the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve for the relevant Capacity Commitment Period. The expected reduction from these resources will be included in the load forecast to the extent that they meet the qualification process rules, including monitoring and verification plan and financial assurance requirements. If no qualification process rules are in place for the expected reductions from these resources, they shall not be included within the load forecast.
- (b) Expected reductions from an installed or forecast Demand Resource that qualifies to participate in the Forward Capacity Market, participates but does not clear in the Forward Capacity Auction, or has cleared in a previous Forward Capacity Auction and is expected to continue in the Forward Capacity Market shall not be reflected as a reduction in the load forecast that will be used to determine the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve for the relevant Capacity Commitment Period.
- (c) [Reserved.]
- (d) Any realized Demand Resource reductions in the historical period that received Forward Capacity Market payments for these reductions, or Demand Resource reductions that are expected to receive Forward Capacity Market payments by participating in the upcoming Forward Capacity Auction or having cleared in a previous Forward Capacity Auction, shall be added back into the appropriate historical loads to ensure that such resources are not reflected as a reduction in the load forecast that will

be used to determine the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve for the relevant Capacity Commitment Period.

III.12.9 Tie Benefits.

The Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve shall be calculated assuming appropriate tie benefits, if any, available from interconnections with neighboring Control Areas. Tie benefits shall be calculated only for interconnections with directly interconnected neighboring Control Areas with which the ISO has in effect agreements providing for emergency support to New England, including but not limited to inter-Control Area coordination agreements, emergency aid agreements and the NPCC Regional Reliability Plan.

Tie benefits shall be calculated using a probabilistic multi-area reliability model, by comparing the LOLE for the New England system before and after interconnecting the system to the neighboring Control Areas. To quantify tie benefits, firm capacity equivalents shall be added until the LOLE of the isolated New England Control Area is equal to the LOLE of the interconnected New England Control Area.

III.12.9.1. Overview of Tie Benefits Calculation Procedure.

III.12.9.1.1. Tie Benefits Calculation for the Forward Capacity Auction and Annual Reconfiguration Auctions; Modeling Assumptions and Simulation Program.

For each Capacity Commitment Period, tie benefits shall be calculated for the Forward Capacity Auction and the third annual reconfiguration auction using the calculation methodology in this Section III.12.9. For the first and second annual reconfiguration auctions for a Capacity Commitment Period, the tie benefits calculated for the associated Forward Capacity Auction shall be utilized in determining the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve as adjusted to account for any changes in import capability of interconnections with neighboring Control Areas and changes in import capacity resources using the methodologies in Section III.12.9.6.

Tie benefits shall be calculated using the modeling assumptions developed in accordance with Section III.12.9.2 and using the General Electric Multi-area Reliability Simulation (MARS) program.

III.12.9.1.2. Tie Benefits Calculation.

The total tie benefits to New England from all directly interconnected neighboring Control Areas are calculated first using the methodology in Section III.12.9.3. Following the calculation of total tie benefits, individual tie benefits from each qualifying neighboring Control Area are calculated using the methodology in Section III.12.9.4.1. If the sum of the tie benefits from each Control Area does not equal the total tie benefits to New England, then each Control Area's tie benefits are adjusted based on the ratio of the individual Control Area tie benefits to the sum of the tie benefits calculated for each Control Area using the methodology in Section III.12.9.4.2. Following this calculation, tie benefits are calculated for each qualifying individual interconnection or group of interconnections using the methodology in Section III.12.9.5.1. If the sum of the tie benefits from individual interconnections or groups of interconnections does not equal their associated Control Area's tie benefits, then the tie benefits of each individual interconnection or group of interconnections is adjusted based on the ratio of the tie benefits of the individual interconnection or group of interconnections to the sum of the tie benefits within the Control Area using the methodology in Section III.12.9.5.2.

III.12.9.1.3. Adjustments to Account for Transmission Import Capability and Capacity Imports.

Once the initial calculation of tie benefits is performed, the tie benefits for each individual interconnection or group of interconnections is adjusted to account for capacity imports and any changes in the import capability of interconnections with neighboring Control Areas, using the methodologies in Section III.12.9.6. Once the import capability and capacity import adjustments are completed, the sum of the tie benefits of all individual interconnections and groups of interconnections for a Control Area, with the import capability and capacity import adjustments, represents the tie benefits associated with that Control Area, and the sum of the tie benefits from all Control Areas, with the import capability and capacity import adjustments, represents the total tie benefits available to New England.

III.12.9.2. Modeling Assumptions and Procedures for the Tie Benefits Calculation.

III.12.9.2.1. Assumptions Regarding System Conditions.

In calculating tie benefits, “at criterion” system conditions shall be used to model the New England Control Area and all interconnected Control Areas.

III.12.9.2.2. Modeling Internal Transmission Constraints in New England.

In calculating tie benefits, all New England internal transmission constraints that (i) are modeled in the most recent Regional System Plan resource adequacy studies and assessments and (ii) are not addressed by either a Local Sourcing Requirement or a Maximum Capacity Limit calculation shall be modeled, using the procedures in Section III.12.9.2.5.

III.12.9.2.3. Modeling Transmission Constraints in Neighboring Control Areas.

The ISO will review annually NPCC’s assumptions regarding transmission constraints in all directly interconnected neighboring Control Areas that are modeled for the tie benefits calculations. In the event that NPCC models a transmission constraint in one of the modeled neighboring Control Areas, the ISO will perform an evaluation to determine which interfaces are most critical to the ability of the neighboring Control Area to reliably provide tie benefits to New England from both operational and planning perspectives, and will model those transmission constraints in the tie benefits calculation, using the procedures in Section III.12.9.2.5.

III.12.9.2.4. Other Modeling Assumptions.

A. External transfer capability determinations. The transfer capability of all external interconnections with New England will be determined using studies that take account of the load, resource and other electrical system conditions that are consistent with those expected during the Capacity Commitment Period for which the calculation is being performed. Transfer capability studies will be performed using simulations that consider the contingencies enumerated in sub-section (iii) below.

(i) The transmission system will be modeled using the following conditions:

1. The forecast 90/10 peak load conditions for the Capacity Commitment Period;

2. Qualified Existing Generating Capacity Resources reflecting their output at their Capacity Network Resource level;
3. Qualified Existing Demand Resources reflecting their Capacity Supply Obligation received in the most recent Forward Capacity Auction;
4. Transfers on the transmission system that impact the transfer capability of the interconnection under study.

(ii) The system will be modeled in a manner that reflects the design of the interconnection. If an interconnection and its supporting system upgrades were designed to provide incremental capacity into the New England Control Area, simulations will assume imports up to the level that the interconnection was designed to support. If the interconnection was not designed to be so comparably integrated, simulations will determine the amount of power that can be delivered into New England over the interconnection.

(iii) The simulations will take into account contingencies that address a fault on a generator or transmission facility, loss of an element without a fault, and circuit breaker failure following the loss of an element or an association with the operation of a special protection system.

B. In calculating tie benefits, New England capacity exports are removed from the internal capacity resources and are modeled as a resource in the receiving Control Area. The transfer capability of external interconnections is not adjusted to account for capacity exports.

III.12.9.2.5. Procedures for Adding or Removing Capacity from Control Areas to Meet the 0.1 Days Per Year LOLE Standard.

In calculating tie benefits, capacity shall be added or removed from the interconnected system of New England and its neighboring Control Areas, until the LOLE of New England and the LOLE of each Control Area of the interconnected system equals 0.1 days per year simultaneously. The following procedures shall be used to add or remove capacity within New England and the interconnected Control Areas to achieve that goal.

- A.** Adding Proxy Units within New England when the New England system is short of capacity. In modeling New England as part of the interconnected system, if New England is short of capacity to meet the 0.1 days per year LOLE, proxy units (with the characteristics identified in Section III.12.7.1) will be added to the sub-areas that are created by any modeled internal transmission constraints within New England, beginning with the sub-area with the highest LOLE. If there are no modeled internal transmission constraints in the New England Control Area, then proxy units will be added to the entire Control Area. If, as a result of the addition of one or more proxy units, the system is surplus of capacity, then the methodology in Section III.12.9.2.5(b) will be used to remove the surplus capacity.
- B.** Removing capacity from New England when the New England system is surplus of capacity. In modeling New England as part of the interconnected system, if New England is surplus of capacity to meet the 0.1 days per year LOLE, the surplus capacity will be removed from the sub-areas as follows. Resources will be removed from sub-areas with capacity surplus based on the ratio of capacity surplus in the sub-area to the total capacity surplus in these surplus sub-areas. The amount of capacity surplus for a sub-area is the amount of the Existing Qualified Capacity, and any amount of proxy units added in that sub-area that is above its 50-50 peak load forecast. Notwithstanding the foregoing, if removing resources will exacerbate a binding transmission constraint, then capacity will not be removed from that sub-area and will instead be removed from the remaining sub-areas using the same ratios described above for the removal of capacity surplus. If there are no modeled internal transmission constraints in the New England Control Area, then the surplus capacity shall be removed from the entire Control Area.
- C.** Adding capacity within neighboring Control Areas when the neighboring Control Area is short of capacity. In modeling neighboring Control Areas as part of the interconnected system, if the neighboring Control Area is short of capacity to meet the 0.1 days per year LOLE, additional capacity will be added to the neighboring Control Area's sub-areas that are created by any modeled internal transmissions constraints, beginning with the sub-area with the highest LOLE. If there are no modeled internal transmission constraints in the Control Area, then capacity will be

added to the entire Control Area. The process that the neighboring Control Area utilizes in its resource adequacy study to meet its resource adequacy criterion will be utilized to add capacity to that Control Area. In filing the Installed Capacity Requirement values pursuant to Section III.12.3, the ISO will provide citations to any resource adequacy studies relied upon for these purposes. If, as a result of the capacity addition, the system is surplus of capacity, then the methodology in Section III.12.9.2.5(d) shall be used to remove the surplus capacity.

- D.** Removing capacity from neighboring Control Areas when the neighboring Control Area is surplus of capacity. In modeling neighboring Control Areas as part of the interconnected system, if the neighboring Control Area is surplus of capacity to meet the 0.1 days per year LOLE, the surplus capacity will be removed from the neighboring Control Area's sub-areas as follows. Resources will be removed from sub-areas with capacity surplus based on the ratio of capacity surplus in the sub-area to the total capacity surplus in the surplus sub-areas. The amount of capacity surplus for a sub-area is the amount of the installed capacity in the sub-area above its 50/50 peak load forecast. For a sub-area that has a minimum locational resource requirement above its 50/50 peak load forecast, the amount of capacity surplus is the amount of the installed capacity in the sub-area above its minimum locational resource requirement. Notwithstanding the foregoing, if removing resources from a sub-area will exacerbate a binding transmission constraint, then capacity will not be removed from that sub-area and will instead be removed from the remaining sub-areas using the same ratio of capacity surplus in the sub-area to the total capacity surplus in the those remaining surplus sub-areas. If there are no modeled internal transmission constraints in the neighboring Control Area, then the surplus capacity will be removed from the entire Control Area.
- E.** Maintaining the neighboring Control Area's locational resource requirements. In modeling a neighboring Control Area with internal transmission constraints, all minimum locational resource requirements in the Control Area's sub-areas as established by the neighboring Control Area's installed capacity requirement calculations shall be observed.

III.12.9.3. Calculating Total Tie Benefits.

The total tie benefits with all qualifying directly interconnected neighboring Control Areas shall be calculated by comparing the interconnection state of the New England system with all interconnections to neighboring Control Areas connected with the interconnection state of the New England system with all interconnections with neighboring Control Areas disconnected. To calculate total tie benefits:

- A.** The New England system shall be interconnected with all directly interconnected neighboring Control Areas and the New England Control Area, and each neighboring Control Area shall be brought to 0.1 days per year LOLE simultaneously by adjusting the capacity of each Control Area, utilizing the methods for adding or removing capacity in Section III.12.9.2.5.
- B.** Once the interconnected system is brought to 0.1 days per year LOLE, the LOLE of the New England Control Area shall be calculated a second time, with the New England system isolated from the rest of the interconnected system that was brought to 0.1 days per year LOLE.
- C.** Total tie benefits shall be the sum of the amounts of firm capacity that needs to be added to the isolated New England Control Area at the point at which each interconnection with neighboring Control Areas interconnects in New England to bring the New England LOLE back to 0.1 days per year. This value is subject to adjustment in accordance with Section III.12.9.6.

III.12.9.4. Calculating Each Control Area's Tie Benefits.

III.12.9.4.1. Initial Calculation of a Control Area's Tie Benefits.

Tie benefits from each neighboring Control Area shall be determined by calculating the tie benefits for every possible interconnection state that has an impact on the tie benefit value between the New England system and the target neighboring Control Area. If two or more interconnections between New England and the target neighboring Control Area exist, then all interconnections grouped together will be used to represent the state of interconnection between New England and the target neighboring Control Area. The tie benefits from the target neighboring Control Area shall be equal to the simple average of the tie benefits calculated from all possible interconnection states, subject to adjustment in accordance with Section III.12.9.4.2.

III.12.9.4.2. Pro Ration Based on Total Tie Benefits.

If the sum of the individual Control Area tie benefits calculated in accordance with Section III.12.9.4.1 is different than the total tie benefits from all Control Areas calculated in accordance with Section III.12.9.3, then each Control Area's tie benefits shall be increased or decreased based on the ratio of the individual Control Area tie benefits to the sum of the tie benefits for each individual Control Area, so that the sum of each Control Area's tie benefits, after the pro-ration, is equal to the total tie benefits calculated in accordance with Section III.12.9.3. The pro-rated Control Area tie benefits are subject to further adjustment in accordance with Section III.12.9.6.

III.12.9.5. Calculating Tie Benefits for Individual Ties.

Tie benefits shall be calculated for an individual interconnection or group of interconnections to the extent that a discrete and material transfer capability can be identified for the interconnection or group of interconnections. All interconnections or groups of interconnections shall have equal rights in calculating individual tie benefits, with no grandfathering or incremental tie capability treatment.

For purposes of calculating tie benefits, a group of interconnections refers to two or more AC lines that operate in parallel to form a transmission interface in which there are significant overlapping contributions of each line toward establishing the transfer limit, such that the individual lines in a group of interconnections cannot be assigned individual contributions.

III.12.9.5.1. Initial Calculation of Tie Benefits for an Individual Interconnection or Group of Interconnections.

Tie benefits for an individual interconnection or group of interconnections shall be calculated by calculating tie benefits for each possible interconnection state between the New England system and the individual interconnection or group of interconnections. The tie benefits from that interconnection or group of interconnections shall be equal to the simple average of the tie benefits calculated from all possible interconnection states, subject to adjustment in accordance with Section III.12.9.5.2.

III.12.9.5.2. Pro Ration Based on Total Tie Benefits.

If the sum of the individual interconnection's or group of interconnection's tie benefits calculated in accordance with Section III.12.9.5.1 is different than the associated Control Area's tie benefits calculated in accordance with Section III.12.9.4, then the tie benefits of the individual interconnection or group of interconnections shall be adjusted based on the ratio of the tie benefits of the individual interconnection or group of interconnections to the sum of the tie benefits for each interconnection or group of interconnections in that Control Area, so that the sum of the tie benefits for each interconnection or group of interconnections in the Control Area, after the pro-ration, is equal to the total tie benefits for the Control Area calculated in accordance with Section III.12.9.4. The pro-rated tie benefits for each interconnection or group of interconnections is subject to further adjustment in accordance with Section III.12.9.6.

III.12.9.6. Accounting for Capacity Imports and Changes in External Transmission Facility Import Capability.

III.12.9.6.1. Accounting for Capacity Imports.

In the initial tie benefits calculations, capacity imports are modeled as internal resources in New England, and the import capability of the interconnections with neighboring Control Areas is not reduced to reflect the impact of capacity imports. After the initial tie benefits calculations, total tie benefits, tie benefits for each Control Area, and tie benefits from each individual interconnection or group of interconnections shall be adjusted to account for capacity imports using the methodology contained in this Section III.12.9.6.1. For the Forward Capacity Auction and third annual reconfiguration auction, this adjustment shall be applied to the tie benefit values calculated in accordance with Sections III.12.9.3, III.12.9.4 and III.12.9.5 respectively. For the first and second annual reconfiguration auctions, this adjustment shall be applied to the tie benefits values calculated for the Forward Capacity Auction.

- A. Capacity imports shall be deducted from the import capability of each individual interconnection or group of interconnections to determine the available import capability of the interconnection or group of interconnections prior to accounting for tie benefits from those interconnections. The transfer capability of an interconnection

- or group of interconnections shall be determined using the procedures in Section III.12.9.2.4.A.
- B.** If the tie benefits value of an individual interconnection or group of interconnections, as determined in accordance with Section III.12.9.5, is greater than the remaining transmission import capability of the interconnection or group of interconnections after accounting for capacity imports, the tie benefit value of the individual interconnection or group of interconnections shall be equal to the remaining transmission import capability (taking into account any further adjustments to transmission import capability in accordance with Section III.12.9.6.2). If the tie benefits value of an individual interconnection or group of interconnections is not greater than the remaining transmission import capability after accounting for capacity imports, then the tie benefit value of the individual interconnection or group of interconnections shall be equal to the value determined in accordance with Section III.12.9.5 (taking into account any further adjustments to transmission import capability in accordance with Section III.12.9.6.2).
- C.** The tie benefits for each Control Area shall be the sum of the tie benefits from the individual interconnections or groups of interconnections with that Control Area, after accounting for any adjustment for capacity imports and any further adjustments to transmission import capability in accordance with Section III.12.9.6.2.
- D.** The total tie benefits from all qualifying neighboring Control Areas shall be the sum of the Control Area tie benefits, after accounting for any adjustment for capacity imports and any further adjustments to transmission import capability in accordance with Section III.12.9.6.2.
- E.** For purposes of determining the adjustment to tie benefits to account for capacity imports under this Section III.12.9.6.1, the capacity imports applicable for determining tie benefits for the Forward Capacity Auction shall be the Qualified Existing Import Capacity Resources for the relevant Capacity Commitment Period, and the capacity imports applicable for determining tie benefits for the annual reconfiguration auctions are those Import Capacity Resources that hold Capacity Supply Obligations for the relevant Capacity Commitment Period as of the time the tie benefits calculation is being performed for the annual reconfiguration auction.

III.12.9.6.2. Changes in the Import Capability of Interconnections with Neighboring Control Areas.

For purposes of calculating tie benefits for the Forward Capacity Auction and third annual reconfiguration auction, the most recent import capability values for an interconnection or group of interconnections with a neighboring Control Area shall be reflected in the modeling of system conditions for the tie benefits calculation. In addition, for the first and second annual reconfiguration auctions, any changes to the import capability of an interconnection or group of interconnections with a neighboring Control Area shall be reflected in the adjustment to tie benefits to account for capacity imports under Section III.12.9.6.1.

III.12.9.7 Tie Benefits Over the HQ Phase I/II HVDC-TF.

The tie benefits from the Quebec Control Area over the HQ Phase I/II HVDC-TF calculated in accordance with Section III.12.9.1 shall be allocated to the Interconnection Rights Holders or their designees in proportion to their respective percentage shares of the HQ Phase I and the HQ Phase II facilities, in accordance with Section I of the Transmission, Markets and Services Tariff.

III.12.10 Calculating the Maximum Amount of Import Capacity Resources that May be Cleared Over External Interfaces in the Forward Capacity Auction and Reconfiguration Auctions.

For external interfaces, Import Capacity Resources shall be allowed in the Forward Capacity Auction and reconfiguration auctions up to the interface limit minus the tie benefits, calculated pursuant to Section III.12.9.1 or 12.9.2 over the applicable interface.

1 England Power Pool (“NEPOOL”), and for the ISO after the staff of NEPOOL was
2 transferred to the ISO.

3
4 I have worked with NEPOOL and the ISO for more than 35 years. During this time, in
5 addition to my most recent duties described above, I have held various positions in the
6 Power Supply Planning department of New England Power Planning (“NEPLAN”), the
7 planning arm of NEPOOL. My last position at NEPLAN was Manager of Power Supply
8 Planning. During my 15 years with NEPLAN Power Supply Planning, I was involved in
9 all matters related to NEPOOL Objective Capability (which is now referred to as the
10 “Installed Capacity Requirement”) and resource adequacy. I currently serve as the Chair
11 of the NEPOOL Power Supply Planning Committee, the NEPOOL technical committee
12 that reviews all assumptions used for the calculation and development of Installed
13 Capacity Requirements, Local Sourcing Requirements, Transmission Security Analysis
14 requirements, Local Resource Adequacy Requirements and Maximum Capacity Limits
15 for New England.

16

17 **Q: WHAT IS THE PURPOSE OF THIS TESTIMONY?**

18 **A:** This testimony explains proposed changes to Section III.12 of Market Rule 1 governing
19 the calculation of certain parameters that define the shape of the new sloped system-wide
20 demand curve that will be used in New England beginning with the ninth Forward
21 Capacity Auction to be held in early 2015. The testimony also describes several
22 additional clarifying and clean-up changes to Section III.12.


23

1 **Q: PLEASE DESCRIBE THE NEW SLOPED DEMAND CURVE.**

2 **A:** The new System-Wide Capacity Demand Curve was filed in Docket No. ER14-1639 on
 3 April 1, 2014 and was accepted by the Commission in an order issued on May 30, 2014.
 4 The shape of the new demand curve is defined by Loss of Load Expectation (“LOLE”) values reflecting the “reliability” associated with higher or lower levels of installed
 5 capacity. Specifically, Section III.13.2.2 of the market rules specifies that the price cap
 6 under the demand curve applies whenever the quantity cleared in the capacity market is
 7 less than the capacity requirement value associated with an LOLE value that is less than
 8 1-in-5 days/year. When the quantity cleared in the capacity market is equal to or greater
 9 than the capacity requirement value associated with an LOLE value of 1-in-5 days/year,
 10 then the price is determined by a downward-sloping straight line that starts at the 1-in-5
 11 days/year LOLE value and ends at the 1-in-87 days/year LOLE value. The resulting
 12 demand curve, as filed in Docket No. ER14-1639, is depicted in Figure 1.
 13

14

Figure 1

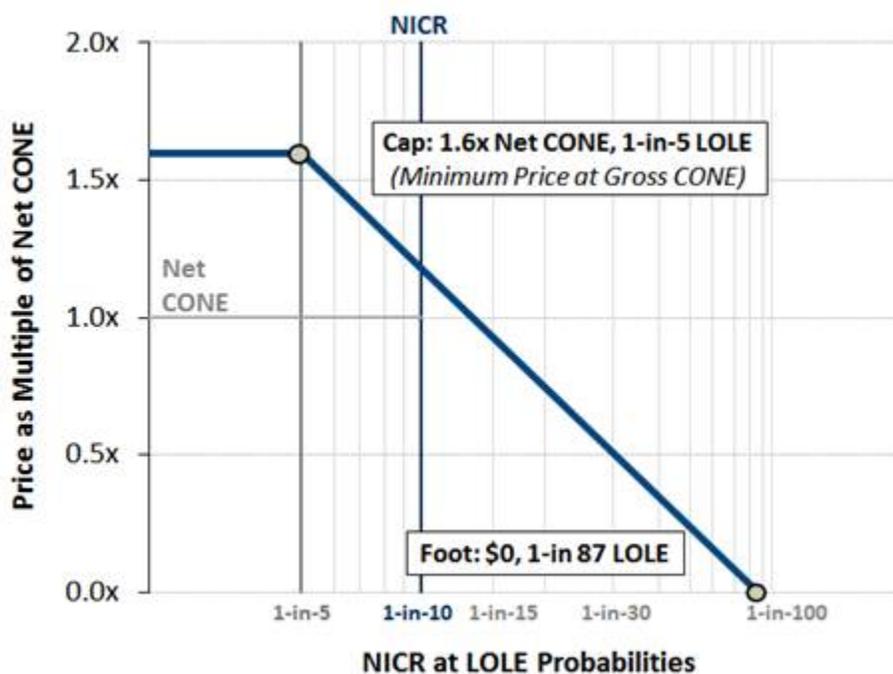

15

1 **Q: HOW WILL THE CAPACITY REQUIREMENT VALUES AT THE**
2 **ADDITIONAL LOLE PROBABILITIES BE DETERMINED?**

3 **A:** The ISO will calculate capacity requirement values at the 1-in-5 and 1-in-87 days/year
4 LOLE values using the same modeling methods, assumptions and calculations as are
5 currently used to calculate the Installed Capacity Requirement at the 1-in-10 days/year
6 LOLE value pursuant to Section III.12. The capacity requirement values calculated for
7 the System-Wide Capacity Demand Curve will also be reviewed with stakeholders and
8 filed with the Commission using the same process as is currently used for determining
9 and filing the annual Installed Capacity Requirement. Conforming changes are made
10 throughout Section III.12 to provide that the capacity requirement values calculated for
11 the System-Wide Capacity Demand Curve are determined using the same method and
12 process as is used to determine the Installed Capacity Requirement.

13
14 The Commission has determined that the existing rules for calculating capacity
15 requirements in New England, which will be used to determine the related values for the
16 demand curve, are reasonable. The Commission also has accepted the actual capacity
17 requirements produced by the rules on an annual basis prior to each Forward Capacity
18 Auction. The ISO has not identified any reason to use any different modeling methods or
19 assumptions for purposes of calculating capacity requirements at the different LOLE
20 values used for the demand curve.

1 **Q: PLEASE DESCRIBE THE ADDITIONAL CONFORMING AND “CLEAN-UP”**
2 **CHANGES MADE TO SECTION III.12.**

3 **A:** Throughout Section III.12, there are numerous changes to specify, as needed, how
4 various provisions concerning the methods and assumptions for determining the Installed
5 Capacity Requirement also are applicable to determining the capacity requirement values
6 for the demand curve, Maximum Capacity Limits, Local Resource Adequacy
7 Requirements and/or Local Sourcing Requirements.

8
9 Two new defined terms are added to Section I.2.2 - Local Resource Adequacy
10 Requirement and Transmission Security Analysis Requirement - to reflect the use of
11 these terms in Sections III.12.2.1.1 and III.12.2.1.2, respectively.

12
13 Finally, there are a handful of wording changes intended to clarify existing provisions or
14 correct typographical errors.

15
16 **Q: DOES THIS CONCLUDE YOUR TESTIMONY?**

17 **A:** Yes.

18
19 I declare under penalty of perjury that the foregoing is true and correct.

20
21
22 Executed on June 9, 2014

23 
24 _____
25 Peter K. Wong

New England Governors, State Utility Regulators and Related Agencies*

Maine

The Honorable Paul LePage
One State House Station
Office of the Governor
Augusta, ME 04333-0001

Kathleen.Newman@maine.gov

Maine Public Utilities Commission
18 State House Station
Augusta, ME 04333-0018

Maine.puc@maine.gov

Vermont Public Service Board
112 State Street
Montpelier, VT 05620-2701

mary-jo.krolewski@state.vt.us

Vermont Department of Public Service
112 State Street, Drawer 20
Montpelier, VT 05620-2601

bill.jordan@state.vt.us

chris.recchia@state.vt.us

Ed.McNamara@state.vt.us

New Hampshire

The Honorable Maggie Hassan
Office of the Governor
26 Capital Street
Concord NH 03301

Molly.Connors@nh.gov

Meredith.Hatfield@nh.gov

New Hampshire Public Utilities Commission
21 South Fruit Street, Ste. 10
Concord, NH 03301-2429

steve.mullen@puc.nh.gov

tom.frantz@puc.nh.gov

george.mccluskey@puc.nh.gov

F.Ross@puc.nh.gov

David.goyette@puc.nh.gov

RegionalEnergy@puc.nh.gov

Massachusetts

The Honorable Deval Patrick
Office of the Governor
Rm. 360 State House
Boston, MA 02133

Massachusetts Attorney General Office
One Ashburton Place
Boston, MA 02108

Jesse.reyes@state.ma.us

Massachusetts Department of Public Utilities
One South Station
Boston, MA 02110

Thomas.Bessette@state.ma.us

Nancy.Stevens@state.ma.us

morgane.treanton@state.ma.us

Vermont

The Honorable Peter Shumlin
Office of the Governor
109 State Street, Pavilion
Montpelier, VT 05609

elizabeth.miller@state.vt.us

Jeb.Spaulding@state.vt.us

Rhode Island

The Honorable Lincoln Chafee
Office of the Governor
State House Room 115
Providence, RI 02903

Marion.Gold@energy.ri.gov

CKearns@doa.ri.gov

Danny.Musher@energy.ri.gov

nicholas.ucci@energy.ri.gov

*People on this list are included on the distribution lists used by Legal (filings), Finance (default on payment notices) and Enterprise Risk Management (financial assurance changes) for email correspondence and notices. Updates should be sent to the "Membership Coordinator" list in the global address list of Outlook so changes can be made in the CAMS system for Enterprise Risk Management. In your email to the membership coordinator: 1) Identify in the subject that it is an update to the external affairs company/contact information in CAMS and 2) Include in the body of the email the company that is being updated and what the updates are. Updates should be made in EtQ for Finance and Legal receives a copy of this document if changes are made.

New England Governors, State Utility Regulators and Related Agencies*

Rhode Island Public Utilities Commission
89 Jefferson Blvd.
Warwick, RI 02888
paul.roberty@puc.ri.gov

Connecticut

The Honorable Dannel P. Malloy
Office of the Governor
State Capitol
210 Capitol Ave.
Hartford, CT 06106
Liz.Donohue@ct.gov
Luke.Bronin@ct.gov
Paul.Mounds@ct.gov

Connecticut Public Utilities Regulatory
Authority
10 Franklin Square
New Britain, CT 06051-2605
robert.luysterborghs@ct.gov
michael.coyle@ct.gov
clare.kindall@ct.gov

New England Governors, Utility Regulatory and Related Agencies

Anne Stubbs
Coalition of Northeastern Governors
400 North Capitol Street, NW
Washington, DC 20001
coneg@sso.org

Heather Hunt, Executive Director
New England States Committee on Electricity
655 Longmeadow Street
Longmeadow, MA 01106
HeatherHunt@nescoe.com
JasonMarshall@nescoe.com

Sarah Hofman, Executive Director
New England Conference of Public Utilities
Commissioners
50 State Street – Suite 1
Montpelier, VT 05602
director@necpuc.org
shofmannnecpuc@gmail.com

James Volz, President
New England Conference of Public Utilities
Commissioners
112 State Street, Drawer 20
Montpelier, VT 05620-2601
james.volz@state.vt.us

Harvey L. Reiter, Esq.
Counsel for New England Conference of Public
Utilities Commissioners, Inc.
c/o Stinson Morrison Hecker LLP
1150 18th Street, N.W., Ste. 800
Washington, DC 20036-3816
HReiter@stinson.com

*People on this list are included on the distribution lists used by Legal (filings), Finance (default on payment notices) and Enterprise Risk Management (financial assurance changes) for email correspondence and notices. Updates should be sent to the "Membership Coordinator" list in the global address list of Outlook so changes can be made in the CAMS system for Enterprise Risk Management. In your email to the membership coordinator: 1) Identify in the subject that it is an update to the external affairs company/contact information in CAMS and 2) Include in the body of the email the company that is being updated and what the updates are. Updates should be made in EtQ for Finance and Legal receives a copy of this document if changes are made.

FERC rendition of the electronically filed tariff records in Docket No. ER14-02153-000

Filing Data:

CID: C000029

Filing Title: Demand Curve Revisions

Company Filing Identifier: 383

Type of Filing Code: 10

Associated Filing Identifier:

Tariff Title: ISO New England Inc. Transmission, Markets and Services Tariff

Tariff ID: 1

Payment Confirmation:

Suspension Motion:

Tariff Record Data:

Record Content Description, Tariff Record Title, Record Version Number, Option Code:

I.2, I.2 Rules of Construction; Definitions, 62.0.0, A

Record Narrative Name: I.2 - Rules of Construction;Definitions

Tariff Record ID: 5

Tariff Record Collation Value: 20398056 Tariff Record Parent Identifier: 2

Proposed Date: 2014-09-01

Priority Order: 50

Record Change Type: CHANGE

Record Content Type: 1

Associated Filing Identifier:

I.2 Rules of Construction; Definitions

I.2.1 Rules of Construction:

In this Tariff, unless otherwise provided herein:

- (a) words denoting the singular include the plural and vice versa;
- (b) words denoting a gender include all genders;
- (c) references to a particular part, clause, section, paragraph, article, exhibit, schedule, appendix or other attachment shall be a reference to a part, clause, section, paragraph, or article of, or an exhibit, schedule, appendix or other attachment to, this Tariff;
- (d) the exhibits, schedules and appendices attached hereto are incorporated herein by reference and shall be construed with an as an integral part of this Tariff to the same extent as if they were set forth verbatim herein;
- (e) a reference to any statute, regulation, proclamation, ordinance or law includes all statutes, regulations, proclamations, amendments, ordinances or laws varying, consolidating or replacing the same from time to time, and a reference to a statute includes all regulations, policies, protocols, codes, proclamations and ordinances issued or otherwise applicable under that statute unless, in any such case, otherwise expressly provided in any such statute or in this Tariff;
- (f) a reference to a particular section, paragraph or other part of a particular statute shall be deemed to be a reference to any other section, paragraph or other part substituted therefor

- from time to time;
- (g) a definition of or reference to any document, instrument or agreement includes any amendment or supplement to, or restatement, replacement, modification or novation of, any such document, instrument or agreement unless otherwise specified in such definition or in the context in which such reference is used;
 - (h) a reference to any person (as hereinafter defined) includes such person's successors and permitted assigns in that designated capacity;
 - (i) any reference to "days" shall mean calendar days unless "Business Days" (as hereinafter defined) are expressly specified;
 - (j) if the date as of which any right, option or election is exercisable, or the date upon which any amount is due and payable, is stated to be on a date or day that is not a Business Day, such right, option or election may be exercised, and such amount shall be deemed due and payable, on the next succeeding Business Day with the same effect as if the same was exercised or made on such date or day (without, in the case of any such payment, the payment or accrual of any interest or other late payment or charge, provided such payment is made on such next succeeding Business Day);
 - (k) words such as "hereunder," "hereto," "hereof" and "herein" and other words of similar import shall, unless the context requires otherwise, refer to this Tariff as a whole and not to any particular article, section, subsection, paragraph or clause hereof; and a reference to "include" or "including" means including without limiting the generality of any description preceding such term, and for purposes hereof the rule of *ejusdem generis* shall not be applicable to limit a general statement, followed by or referable to an enumeration of specific matters, to matters similar to those specifically mentioned.

I.2.2. Definitions:

In this Tariff, the terms listed in this section shall be defined as described below:

Actual Load is the consumption at the Retail Delivery Point for the hour.

Adjusted Audited Demand Reduction is the Audited Demand Reduction of a Demand Response Resource adjusted in accordance with Section III.13.7.1.5.10.1.1.

Additional Resource Blackstart O&M Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Additional Resource Specified-Term Blackstart Capital Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Additional Resource Standard Blackstart Capital Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Administrative Costs are those costs incurred in connection with the review of Applications for transmission service and the carrying out of System Impact Studies and Facilities Studies.

Administrative Export De-List Bid is a bid that may be submitted in a Forward Capacity Auction by certain Existing Generating Capacity Resources subject to a multi-year contract to sell capacity outside of the New England Control Area during the associated Capacity Commitment Period, as described in Section III.13.1.2.3.1.4 of Market Rule 1.

Administrative Sanctions are defined in Section III.B.4.1.2 of Appendix B of Market Rule 1.

ADR Neutrals are one or more firms or individuals identified by the ISO with the advice and consent of the Participants Committee that are prepared to act as neutrals in ADR proceedings under Appendix D to Market Rule 1.

Advance is defined in Section IV.A.3.2 of the Tariff.

Affected Party, for purposes of the ISO New England Billing Policy, is defined in Section 6.3.5 of the ISO New England Billing Policy.

Affiliate is any person or entity that controls, is controlled by, or is under common control by another person or entity. For purposes of this definition, "control" means the possession, directly or indirectly, of the authority to direct the management or policies of an entity. A voting interest of ten percent or more shall create a rebuttable presumption of control.

AGC is automatic generation control.

Allocated Assessment is a Covered Entity's right to seek and obtain payment and recovery of its

share in any shortfall payments under Section 3.3 or Section 3.4 of the ISO New England Billing Policy.

Alternative Capacity Price Rule is a rule potentially affecting Capacity Clearing Prices in a Forward Capacity Auction, as described in Section III.13.2.7.8 of Market Rule 1.

Alternative Dispute Resolution (ADR) is the procedure set forth in Appendix D to Market Rule 1.

Alternative Technologies Regulation Pilot Program is the pilot described in Appendix J to Market Rule 1.

Ancillary Services are those services that are necessary to support the transmission of electric capacity and energy from resources to loads while maintaining reliable operation of the New England Transmission System in accordance with Good Utility Practice.

Announced Schedule 1 EA Amount, Announced Schedule 2 EA Amount, Announced Schedule 3 EA Amount are defined in Section IV.B.2.2 of the Tariff.

Annual Transmission Revenue Requirements are the annual revenue requirements of a PTO's PTF or of all PTOs' PTF for purposes of the OATT shall be the amount determined in accordance with Attachment F to the OATT.

Annualized FCA Payment is used to determine a resource's availability penalties and is calculated in accordance with Section III.13.7.2.7.1.2(b) of Market Rule 1.

Applicants, for the purposes of the ISO New England Financial Assurance Policy, are entities applying for Market Participant status or for transmission service from the ISO.

Application is a written request by an Eligible Customer for transmission service pursuant to the provisions of the OATT.

APR-1 means the first of three Alternative Capacity Price Rule mechanisms described in Section III.13.2.7.8.

APR-2 means the second of three Alternative Capacity Price Rule mechanisms described in Section III.13.2.7.8.

APR-3 means the third of three Alternative Capacity Price Rule mechanisms described in Section III.13.2.7.8.

Asset is a generating unit, interruptible load, a component of a demand response resource or load asset.

Asset Registration Process is the ISO business process for registering a physical load, generator, or tie-line for settlement purposes. The Asset Registration Process is posted on the ISO's website.

Asset Related Demand is a physical load that has been discretely modeled within the ISO's dispatch and settlement systems, settles at a Node and, except for pumped storage load, is made up of one or more individual end-use metered customers receiving service from the same point or points of electrical supply, with an aggregate average hourly load of 1 MW or greater during the 12 months preceding its registration.

Asset Related Demand Bid Block-Hours are Block-Hours assigned to the Lead Market Participant for each Asset Related Demand bid. The daily bid Blocks in the price-based Real-Time bid will be multiplied by the number of hours in the day to determine the daily quantity of Asset Related Demand Bid Block-Hours. In the case that a Resource has a Real-Time unit status of "unavailable" for an entire day, that day will not contribute to the quantity of Asset Related Demand Bid Block-Hours. However, if the Resource has at least one hour of the day with a unit status of "available," the entire day will contribute to the quantity of Asset Related Demand Bid Block-Hours.

Asset-Specific Going Forward Costs are the net risk-adjusted going forward costs of an asset that is part of an Existing Generating Capacity Resource, calculated for the asset in the same manner as the net-risk adjusted going forward costs of Existing Generating Capacity Resources as described in Section III.13.1.2.3.2.1.2.

Assigned Meter Reader reports to the ISO the hourly and monthly MWh associated with the

Asset. These MWh are used for settlement. The Assigned Meter Reader may designate an agent to help fulfill its Assigned Meter Reader responsibilities; however, the Assigned Meter Reader remains functionally responsible to the ISO.

Auction Revenue Right (ARR) is a right to receive FTR Auction Revenues in accordance with Appendix C of Market Rule 1.

Auction Revenue Right Allocation (ARR Allocation) is defined in Section 1 of Appendix C of Market Rule 1.

Auction Revenue Right Holder (ARR Holder) is an entity which is the record holder of an Auction Revenue Right (excluding an Incremental ARR) in the register maintained by the ISO.

Audited Demand Reduction is the seasonal claimed capability of a Demand Response Resource as established pursuant to Section III.13.6.1.5.4.

Audited Full Reduction Time is the Offered Full Reduction Time associated with the Demand Response Resource's most recent audit.

Authorized Commission is defined in Section 3.3 of the ISO New England Information Policy.

Authorized Person is defined in Section 3.3 of the ISO New England Information Policy.

Automatic Response Rate is the response rate, in MW/Minute, at which a Market Participant is willing to have a generating unit change its output while providing Regulation between the Regulation High Limit and Regulation Low Limit.

Average Hourly Load Reduction is either: (i) the sum of the Demand Resource's electrical energy reduction during Demand Resource On-Peak Hours in the month divided by the number of Demand Resource On-Peak Hours in the month; (ii) the sum of the Demand Resource's electrical energy reduction during Demand Resource Seasonal Peak Hours in the month divided by the number of Demand Resource Seasonal Peak Hours in the month; or (iii) in each Real-Time Demand Response Event Hour, the sum of the baseline electrical energy consumption less the sum of the actual electrical energy consumption of all of the Real-Time Demand Response Assets

associated with the Real-Time Demand Response Resource as registered with the ISO as of the first day of the month; or (iv) in each Real-Time Emergency Generation Event Hour, the sum of the baseline electrical energy consumption less the sum of the actual electrical energy consumption of all of the Real-Time Emergency Generation Assets associated with the Real-time Emergency Generation Resource as registered with the ISO as of the first day of the month. The Demand Resource's electrical energy reduction and Average Hourly Load Reduction shall be determined consistent with the Demand Resource's Measurement and Verification Plan, which shall be reviewed by the ISO to ensure consistency with the measurement and verification requirements, as described in Section III.13.1.4.3 of Market Rule 1 and the ISO New England Manuals.

Average Hourly Output is either: (i) the sum of the Demand Resource's electrical energy output during Demand Resource On-Peak Hours in the month divided by the number of Demand Resource On-Peak Hours in the month; (ii) the sum of the Demand Resource's electrical energy output during Demand Resource Seasonal Peak Hours in the month divided by the number of Demand Resource Seasonal Peak Hours in the month; or (iii) in each Real-Time Demand Response Event Hour or Real-Time Emergency Generation Event Hour, the sum of the electrical energy output of all of the Real-Time Demand Response Assets or Real-Time Emergency Generation Assets associated with the Real-Time Demand Response Resource or Real-Time Emergency Generation Resource as registered with the ISO as of the first day of the month. Electrical energy output and Average Hourly Output shall be determined consistent with the Demand Resource's Measurement and Verification Plan, which shall be reviewed by the ISO to ensure consistency with the measurement and verification requirements, as described in Section III.13.1.4.3 of Market Rule 1 and the ISO New England Manuals.

Average Monthly PER is calculated in accordance with Section III.13.7.2.7.1.1.2(a) of Market Rule 1.

Bankruptcy Code is the United States Bankruptcy Code.

Bankruptcy Event occurs when a Covered Entity files a voluntary or involuntary petition in bankruptcy or commences a proceeding under the United States Bankruptcy Code or any other applicable law concerning insolvency, reorganization or bankruptcy by or against such Covered Entity as debtor.

Bilateral Contract (BC) is any of the following types of contracts: Internal Bilateral for Load, Internal Bilateral for Market for Energy, and External Transactions.

Bilateral Contract Block-Hours are Block-Hours assigned to the seller and purchaser of an Internal Bilateral for Load, Internal Bilateral for Market for Energy and External Transactions; provided, however, that only those contracts which apply to the Real-Time Energy Market will accrue Block-Hours.

Blackstart Capability Test is the test, required by ISO New England Operating Documents, of a resource's capability to provide Blackstart Service.

Blackstart Capital Payment is the annual compensation, as calculated pursuant to Section 5.1, or as referred to in Section 5.2, of Schedule 16 to the OATT, for a Designated Blackstart Resource's Blackstart Equipment capital costs associated with the provision of Blackstart Service (excluding the capital costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Blackstart CIP Capital Payment is the annual compensation level, as calculated pursuant to Section 5.1 utilizing data from Table 6 of Appendix A to this Schedule 16, or as referred to in Section 5.2, of Schedule 16 to the OATT, for a Blackstart Station's costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service.

Blackstart CIP O&M Payment is the annual compensation level, as calculated pursuant to Section 5.1 of Schedule 16 to the OATT, utilizing data from Table 6 of Appendix A to this Schedule 16, for a Blackstart Station's operating and maintenance costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of the provision of Blackstart Service.

Blackstart Equipment is any equipment that is solely necessary to enable the Designated Blackstart Resource to provide Blackstart Service and is not required to provide other products or services under the Tariff.

Blackstart O&M Payment is the annual compensation, as calculated pursuant to Section 5.1 of Schedule 16 to the OATT, for a Designated Blackstart Resource's operating and maintenance costs associated with the provision of Blackstart Service (except for operating and maintenance costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Blackstart Owner is the Market Participant who is authorized on behalf of the Generator Owner(s) to offer or operate the resource as a Designated Blackstart Resource and is authorized to commit the resource to provide Blackstart Service.

Blackstart Service is the Ancillary Service described in Section II.47 of the Tariff and Schedule 16 of the OATT, which also encompasses "System Restoration and Planning Service" under the predecessor version of Schedule 16.

Blackstart Service Commitment is the commitment by a Blackstart Owner for its resource to provide Blackstart Service and the acceptance of that commitment by the ISO, in the manner detailed in ISO New England Operating Procedure No. 11 – Designated Blackstart Resource Administration (OP 11), and which includes a commitment to provide Blackstart Service under a "Signature Page for Schedule 16 of the NEPOOL OATT" that was executed and in effect prior to January 1, 2013 for Category A Designated Blackstart Resources or a commitment to provide Blackstart Service established under Operating Procedure 11 – Designated Blackstart Resource Administration (OP11) for Category B Designated Blackstart Resources.

Blackstart Service Minimum Criteria are the minimum criteria that a Blackstart Owner and its resource must meet in order to establish and maintain a resource as a Designated Blackstart Resource.

Blackstart Standard Rate Payment is the formulaic rate of monthly compensation, as calculated pursuant to Section 5 of Schedule 16 to the OATT, paid to a Blackstart Owner for the provision of Blackstart Service from a Designated Blackstart Resource.

Blackstart Station is comprised of (i) a single Designated Blackstart Resource or (ii) two or more Designated Blackstart Resources that share Blackstart Equipment.

Blackstart Station-specific Rate Payment is the Commission-approved compensation, as calculated pursuant to Section 5.2 of Schedule 16 to the OATT, paid to a Blackstart Owner on a monthly basis for the provision of Blackstart Service by Designated Blackstart Resources located at a specific Blackstart Station.

Blackstart Station-specific Rate Capital Payment is a component of the Blackstart Station-specific Rate Payment that reflects a Blackstart Station's capital Blackstart Equipment costs associated with the provision of Blackstart Service (excluding the capital costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Blackstart Station-specific Rate CIP Capital Payment is a component of the Blackstart Station-specific Rate Payment that reflects a Blackstart Station's capital costs associated with compliance with NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service.

Block is defined as follows: (1) With respect to Bilateral Contracts, a Bilateral Contract administered by the ISO for an hour; (2) with respect to Supply Offers administered by the ISO, a quantity with a related price for Energy (Supply Offers for Energy may contain multiple sets of quantity and price pairs for the day); (3) with respect to Demand Bids administered by the ISO, a quantity with a related price for Energy (Demand Bids for Energy may contain multiple sets of quantity and price pairs for each hour); (4) with respect to Increment Offers administered by the ISO, a quantity with a related price for Energy (Increment Offers for Energy may contain multiple sets of quantity and price pairs for each hour); (5) with respect to Decrement Bids administered by the ISO, a quantity with a related price for Energy (Decrement Bids for Energy may contain multiple sets of quantity and price pairs for each hour); (6) with respect to Asset Related Demand bids administered by the ISO, a quantity with a related price for Energy (Asset Related Demand bids may contain multiple sets of quantity and price pairs for each hour); and (7) with respect to Demand Reduction Offers administered by the ISO, a quantity of reduced demand with a related price (for Capacity Commitment Periods commencing on or after June 1, 2017, Demand Reduction Offers may contain multiple sets of quantity and price pairs for the day).

Block-Hours are the number of Blocks administered for a particular hour.

Budget and Finance Subcommittee is a subcommittee of the Participants Committee, the responsibilities of which are specified in Section 8.4 of the Participants Agreement.

Business Day is any day other than a Saturday or Sunday or ISO holidays as posted by the ISO on its website.

Cancellation Fee is defined in Section III.1.10.2(d).

Cancelled Start Credit is a credit calculated pursuant to Section III.F.2.5 of Appendix F to Market Rule 1 as the NCPC Credit due to each Market Participant for pool-scheduled generating Resources that were scheduled by the ISO to start after the close of the Day-Ahead Energy Market and that were cancelled by the ISO prior to their assigned commitment time.

Capability Demonstration Year is the one year period from September 1 through August 31.

Capability Year means a year's period beginning on June 1 and ending May 31.

Capacity Acquiring Resource is a resource that is seeking to acquire a Capacity Supply Obligation through a Capacity Supply Obligation Bilateral, as described in Section III.13.5.1 of Market Rule 1.

Capacity Balancing Ratio is a ratio used in calculating the Capacity Performance Payment in the Forward Capacity Market beginning on June 1, 2018 pursuant to rules filed with the Commission on January 17, 2014.

Capacity Capability Interconnection Standard has the meaning specified in Schedule 22 and Schedule 23 of the OATT.

Capacity Carried Forward Due to Rationing is described in Section III.13.2.7.8.2.1(c)(b)(ii) of Market Rule 1.

Capacity Clearing Price is the clearing price for a Capacity Zone for a Capacity Commitment Period resulting from the Forward Capacity Auction conducted for that Capacity Commitment Period, as determined in accordance with Section III.13.2.7 of Market Rule 1.

Capacity Clearing Price Floor is described in Section III.13.2.7.

Capacity Commitment Period is the one-year period from June 1 through May 31 for which obligations are assumed and payments are made in the Forward Capacity Market.

Capacity Cost (CC) is one of four forms of compensation that may be paid to resources providing VAR Service under Schedule 2 of the OATT.

Capacity Export Through Import Constrained Zone Transaction is defined in Section III.1.10.7(f)(i) of Market Rule 1.

Capacity Load Obligation is the quantity of capacity for which a Market Participant is financially responsible, equal to that Market Participant's Capacity Requirement (if any) adjusted to account for any relevant Capacity Load Obligation Bilaterals, as described in Section III.13.7.3.1 of Market Rule 1.

Capacity Load Obligation Acquiring Participant is a load serving entity or any other Market Participant seeking to acquire a Capacity Load Obligation through a Capacity Load Obligation Bilateral, as described in Section III.13.5.2 of Market Rule 1.

Capacity Load Obligation Bilateral is a bilateral contract through which a Market Participant may transfer all or a portion of its Capacity Load Obligation to another entity, as described in Section III.13.5 of Market Rule 1.

Capacity Load Obligation Transferring Participant is an entity that has a Capacity Load Obligation and is seeking to shed such obligation through a Capacity Load Obligation Bilateral, as described in Section III.13.5.2 of Market Rule 1.

Capacity Network Resource (CNR) is defined in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Capacity Network Resource Interconnection Service is defined in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Capacity Performance Payment is the performance-dependent portion of revenue received in the Forward Capacity Market beginning on June 1, 2018 pursuant to rules filed with the Commission on January 17, 2014.

Capacity Rationing Rule addresses whether offers and bids in a Forward Capacity Auction may be rationed, as described in Section III.13.2.6 of Market Rule 1.

Capacity Requirement is described in Section III.13.7.3.1 of Market Rule 1.

Capacity Supply Obligation is an obligation to provide capacity from a resource, or a portion thereof, to satisfy a portion of the Installed Capacity Requirement that is acquired through a Forward Capacity Auction in accordance with Section III.13.2, a reconfiguration auction in accordance with Section III.13.4, or a Capacity Supply Obligation Bilateral in accordance with Section III.13.5.1 of Market Rule 1.

Capacity Supply Obligation Bilateral is a bilateral contract through which a Market Participant may transfer all or a part of its Capacity Supply Obligation to another entity, as described in Section III.13.5.1 of Market Rule 1.

Capacity-to-Service Ratio is defined in Section III.3.2.2(h) of Market Rule 1.

Capacity Transfer Right (CTR) is a financial right that entitles the holder to the difference in the Net Regional Clearing Prices between Capacity Zones for which the transfer right is defined, in the MW amount of the holder's entitlement.

Capacity Transferring Resource is a resource that has a Capacity Supply Obligation and is seeking to shed such obligation, or a portion thereof, through a Capacity Supply Obligation Bilateral, as described in Section III.13.5.1 of Market Rule 1.

Capacity Value is the value (in kW-month) of a Demand Resource for a month determined pursuant to Section III.13.7.1.5 of Market Rule 1.

Capacity Zone is a geographic sub-region of the New England Control Area as determined in

accordance with Section III.12.4 of Market Rule 1.

Capital Funding Charge (CFC) is defined in Section IV.B.2 of the Tariff.

CARL Data is Control Area reliability data submitted to the ISO to permit an assessment of the ability of an external Control Area to provide energy to the New England Control Area in support of capacity offered to the New England Control Area by that external Control Area.

Carried Forward Excess Capacity is calculated as described in Section III.13.2.7.8.2.1(c) of Market Rule 1.

Category A Designated Blackstart Resource is a Designated Blackstart Resource that has committed to provide Blackstart Service under a “Signature Page for Schedule 16 of the NEPOOL OATT” that was executed and in effect prior to January 1, 2013 and has not been converted to a Category B Designated Blackstart Resource.

Category B Designated Blackstart Resource is a Designated Blackstart Resource that is not a Category A Designated Blackstart Resource.

Charge is a sum of money due from a Covered Entity to the ISO, either in its individual capacity or as billing and collection agent for NEPOOL pursuant to the Participants Agreement.

CLAIM10 is the value, expressed in megawatts, calculated pursuant to Section III.9.5.3 of the Tariff.

CLAIM30 is the value, expressed in megawatts, calculated pursuant to Section III.9.5.3 of the Tariff.

Claimed Capability Audit is performed to determine the real power output capability of a Generator Asset.

CNR Capability is defined in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Coincident Peak Contribution is a Market Participant's share of the New England Control Area coincident peak demand for the prior calendar year as determined prior to the start of each power year, which reflects the sum of the prior year's annual coincident peak contributions of the customers served by the Market Participant at each Load Asset in all Load Zones. Daily Coincident Peak Contribution values shall be submitted by the Assigned Meter Reader or Host Participant by the meter reading deadline to the ISO.

Cold Weather Conditions means any calendar day when that day's Effective Temperatures are forecast to be equal to or less than zero degrees Fahrenheit for any single on-peak hour and that day's total Effective Heating Degree Days are forecast to be greater than or equal to 65.

Cold Weather Event means days when Cold Weather Conditions are forecast to exist and the Seven-Day Forecast indicates a capacity margin less than or equal to 0 MW for an Operating Day. Cold Weather Events are declared by 1100 two days prior to the Operating Day. A Cold Weather Warning will be used for all future days within the Seven-Day Forecast when a capacity margin of less than or equal to 0 MW exists, until such time that the ISO declares a Cold Weather Event.

Cold Weather Warning means days when Cold Weather Conditions are forecast to exist and the Seven-Day Forecast indicates a capacity margin less than 1,000 MW. In addition, a Cold Weather Warning will be used for all future days within the Seven-Day Forecast when a capacity margin of less than or equal to 0 MW exists for days not yet declared as a Cold Weather Event.

Cold Weather Watch means days when Cold Weather Conditions are forecast to exist and the Seven-Day Forecast indicates a capacity margin greater than or equal to 1,000 MW.

Commercial Capacity, for the purposes of the ISO New England Financial Assurance Policy, is defined in Section VII.A of that policy.

Commission is the Federal Energy Regulatory Commission.

Common Costs are those costs associated with a Station that are avoided only by (1) the clearing of the Static De-List Bids or the Permanent De-List Bids of all the Existing Generating Capacity Resources comprising the Station; or (2) the acceptance of a Non-Price Retirement Request of the

Station.

Completed Application is an Application that satisfies all of the information and other requirements of the OATT, including any required deposit.

Compliance Effective Date is the date upon which the changes in the predecessor NEPOOL Open Access Transmission Tariff which have been reflected herein to comply with the Commission's Order of April 20, 1998 became effective.

Composite FCM Transaction is a transaction for separate resources seeking to participate as a single composite resource in a Forward Capacity Auction in which multiple Designated FCM Participants provide capacity, as described in Section III.13.1.5 of Market Rule 1.

Conditional Qualified New Generating Capacity Resource is defined in Section III.13.1.1.2.3(f) of Market Rule 1.

Confidential Information is defined in Section 2.1 of the ISO New England Information Policy, which is Attachment D to the Tariff.

Confidentiality Agreement is Attachment 1 to the ISO New England Billing Policy.

Congestion is a condition of the New England Transmission System in which transmission limitations prevent unconstrained regional economic dispatch of the power system. Congestion is the condition that results in the Congestion Component of the Locational Marginal Price at one Location being different from the Congestion Component of the Locational Marginal Price at another Location during any given hour of the dispatch day in the Day-Ahead Energy Market or Real-Time Energy Market.

Congestion Component is the component of the nodal price that reflects the marginal cost of congestion at a given Node or External Node relative to the reference point. When used in connection with Zonal Price and Hub Price, the term Congestion Component refers to the Congestion Components of the nodal prices that comprise the Zonal Price and Hub Price weighted and averaged in the same way that nodal prices are weighted to determine Zonal Price and averaged to determine the Hub Price.

Congestion Cost is the cost of congestion as measured by the difference between the Congestion Components of the Locational Marginal Prices at different Locations and/or Reliability Regions on the New England Transmission System.

Congestion Paying LSE is, for the purpose of the allocation of FTR Auction Revenues to ARR Holders as provided for in Appendix C of Market Rule 1, a Market Participant or Non-Market Participant Transmission Customer that is responsible for paying for Congestion Costs as a Transmission Customer paying for Regional Network Service under the Transmission, Markets and Services Tariff, unless such Transmission Customer has transferred its obligation to supply load in accordance with ISO New England System Rules, in which case the Congestion Paying LSE shall be the Market Participant supplying the transferred load obligation. The term Congestion Paying LSE shall be deemed to include, but not be limited to, the seller of internal bilateral transactions that transfer Real-Time Load Obligations under the ISO New England System Rules.

Congestion Revenue Fund is the amount available for payment of target allocations to FTR Holders from the collection of Congestion Cost.

Congestion Shortfall means congestion payments exceed congestion charges during the billing process in any billing period.

Control Agreement is the document posted on the ISO website that is required if a Market Participant's cash collateral is to be invested in BlackRock funds.

Control Area is an electric power system or combination of electric power systems to which a common automatic generation control scheme is applied in order to:

- (1) match, at all times, the power output of the generators within the electric power system(s) and capacity and energy purchased from entities outside the electric power system(s), with the load within the electric power system(s);
- (2) maintain scheduled interchange with other Control Areas, within the limits of Good Utility Practice;
- (3) maintain the frequency of the electric power system(s) within reasonable limits in

accordance with Good Utility Practice and the criteria of the applicable regional reliability council or the North American Electric Reliability Corporation; and

(4) provide sufficient generating capacity to maintain operating reserves in accordance with Good Utility Practice.

Correction Limit means the date that is one hundred and one (101) calendar days from the last Operating Day of the month to which the data applied. As described in Section III.3.6.1 of Market Rule 1, this will be the period during which meter data corrections must be submitted unless they qualify for submission as a Requested Billing Adjustment under Section III.3.7 of Market Rule 1.

Cost of Energy Consumed (CEC) is one of four forms of compensation that may be paid to resources providing VAR Service under Schedule 2 of the OATT.

Cost of Energy Produced (CEP) is one of four forms of compensation that may be paid to resources providing VAR Service under Schedule 2 of the OATT.

Cost of New Entry (CONE) is the estimated cost of new entry (\$/kW-month) for a capacity resource that is determined by the ISO for each Forward Capacity Auction pursuant to Section III.13.2.4.

Counterparty means the status in which the ISO acts as the contracting party, in its name and own right and not as an agent, to an agreement or transaction with a Customer (including assignments involving Customers) involving sale to the ISO, and/or purchase from the ISO, of Regional Transmission Service and market and other products and services, and other transactions and assignments involving Customers, all as described in the Tariff.

Covered Entity is defined in the ISO New England Billing Policy.

Credit Coverage is third-party credit protection obtained by the ISO, in the form of credit insurance coverage, a performance or surety bond, or a combination thereof.

Credit Qualifying means a Rated Market Participant that has an Investment Grade Rating and an Unrated Market Participant that satisfies the Credit Threshold.

Credit Threshold consists of the conditions for Unrated Market Participants outlined in Section II.B.2 of the ISO New England Financial Assurance Policy.

Critical Energy Infrastructure Information (CEII) is defined in Section 3.0(j) of the ISO New England Information Policy, which is Attachment D to the Tariff.

Current Ratio is, on any date, all of a Market Participant's or Non-Market Participant Transmission Customer's current assets divided by all of its current liabilities, in each case as shown on the most recent financial statements provided by such Market Participant or Non-Market Participant Transmission Customer to the ISO.

Curtailement is a reduction in the dispatch of a transaction that was scheduled, using transmission service, in response to a transfer capability shortage as a result of system reliability conditions.

Customer is a Market Participant, a Transmission Customer or another customer of the ISO.

Data Reconciliation Process means the process by which meter reconciliation and data corrections that are discovered by Governance Participants after the Invoice has been issued for a particular month or that are discovered prior to the issuance of the Invoice for the relevant month but not included in that Invoice or in the other Invoices for that month and are reconciled by the ISO on an hourly basis based on data submitted to the ISO by the Host Participant Assigned Meter Reader or Assigned Meter Reader.

Day-Ahead is the calendar day immediately preceding the Operating Day.

Day-Ahead Adjusted Load Obligation is defined in Section III.3.2.1(a)(iii) of Market Rule 1.

Day-Ahead Congestion Revenue is defined in Section III.3.2.1(f) of Market Rule 1.

Day-Ahead Demand Reduction Obligation is a cleared Demand Reduction Offer multiplied by one plus the percent average avoided peak distribution losses. For Capacity Commitment Periods commencing on or after June 1, 2017, Day-Ahead Demand Reduction Obligation is the hourly demand reduction amounts of a Demand Response Resource scheduled by the ISO as a result of

the Day-Ahead Energy Market, multiplied by one plus the percent average avoided peak distribution losses.

Day-Ahead Energy Market means the schedule of commitments for the purchase or sale of energy, payment of Congestion Costs, payment for losses developed by the ISO as a result of the offers and specifications submitted in accordance with Section III.1.10 of Market Rule 1 and purchase of demand reductions pursuant to Appendix III.E2 of Market Rule 1 for Capacity Commitment Periods commencing on or after June 1, 2017.

Day-Ahead Energy Market Congestion Charge/Credit is defined in Section III.3.2.1(d) of Market Rule 1.

Day-Ahead Energy Market Energy Charge/Credit is defined in Section III.3.2.1(d) of Market Rule 1.

Day-Ahead Energy Market Loss Charge/Credit is defined in Section III.3.2.1(d) of Market Rule 1.

Day-Ahead Generation Obligation is defined in Section III.3.2.1(a)(ii) of Market Rule 1.

Day-Ahead Load Obligation is defined in Section III.3.2.1(a)(i) of Market Rule 1.

Day-Ahead Load Response Program provides a Day-Ahead aspect to the Load Response Program. The Day-Ahead Load Response Program allows Market Participants with registered Load Response Program Assets to make energy reduction offers into the Day-Ahead Load Response Program concurrent with the Day-Ahead Energy Market.

Day-Ahead Locational Adjusted Net Interchange is defined in Section III.3.2.1(a)(iv) of Market Rule 1.

Day-Ahead Loss Charges or Credits is defined in Section III.3.2.1(h) of Market Rule 1.

Day-Ahead Loss Revenue is defined in Section III.3.2.1(g) of Market Rule 1.

Day-Ahead Prices means the Locational Marginal Prices resulting from the Day-Ahead Energy Market.

Debt-to-Total Capitalization Ratio is, on any date, a Market Participant's or Non-Market Participant Transmission Customer's total debt (including all current borrowings) divided by its total shareholders' equity plus total debt, in each case as shown on the most recent financial statements provided by such Market Participant or Non-Market Participant Transmission Customer to the ISO.

Decrement Bid means a bid to purchase energy at a specified Location in the Day-Ahead Energy Market which is not associated with a physical load. An accepted Decrement Bid results in scheduled load at the specified Location in the Day-Ahead Energy Market.

Default Amount is all or any part of any amount due to be paid by any Covered Entity that the ISO, in its reasonable opinion, believes will not or has not been paid when due (other than in the case of a payment dispute for any amount due for transmission service under the OATT).

Default Period is defined in Section 3.3.h(i) of the ISO New England Billing Policy.

Delivering Party is the entity supplying capacity and/or energy to be transmitted at Point(s) of Receipt under the OATT.

Demand Bid means a request to purchase an amount of energy, at a specified Location, or an amount of energy at a specified price, that is associated with a physical load. A cleared Demand Bid in the Day-Ahead Energy Market results in scheduled load at the specified Location. Demand Bids submitted for use in the Real-Time Energy Market are specific to Dispatchable Asset Related Demands only.

Demand Bid Block-Hours are the Block-Hours assigned to the submitting Customer for each Demand Bid.

Demand Designated Entity is the entity designated by a Market Participant to receive Dispatch Instructions for Demand Response Resources, Real-Time Demand Response Resources and Real-Time Emergency Generation Resources in accordance with the provisions set forth in ISO New

England Operating Procedure No. 14.

Demand Reduction Offer is an offer by a Market Participant with a Real-Time Demand Response Asset to reduce demand. For Capacity Commitment Periods commencing on or after June 1, 2017, Demand Reduction Offer is an offer by a Market Participant with a Demand Response Resource to reduce demand.

Demand Reduction Threshold Price is a minimum offer price calculated pursuant to Section III.E1.6 and Section III.E2.6.

Demand Reduction Value is the quantity of reduced demand calculated pursuant to Section III.13.7.1.5.3 of Market Rule 1.

Demand Resource is a resource defined as Demand Response Capacity Resources, On-Peak Demand Resources, Seasonal Peak Demand Resources, Real-Time Demand Response Resources, or Real-Time Emergency Generation Resources. Demand Resources are installed measures (i.e., products, equipment, systems, services, practices and/or strategies) that result in additional and verifiable reductions in end-use demand on the electricity network in the New England Control Area pursuant to Appendix III.E1 and Appendix III.E2 of Market Rule 1, or during Demand Resource On-Peak Hours, Demand Resource Seasonal Peak Hours, Real-Time Demand Response Event Hours, or Real-Time Emergency Generation Event Hours, respectively. A Demand Resource may include a portfolio of measures aggregated together to meet or exceed the minimum Resource size requirements of the Forward Capacity Auction.

Demand Resource Commercial Operation Audit is an audit initiated pursuant to Section III.13.6.1.5.4.4.

Demand Resource Forecast Peak Hours are those hours, or portions thereof, in which, absent the dispatch of Real-Time Demand Response Resources, Dispatch Zone, Load Zone, or system-wide implementation of the action of ISO New England Operating Procedure No. 4 where the ISO would have begun to allow the depletion of Thirty-Minute Operating Reserve is forecasted in the ISO's most recent next-day forecast.

Demand Resource On-Peak Hours are hours ending 1400 through 1700, Monday through

Friday on non-Demand Response Holidays during the months of June, July, and August and hours ending 1800 through 1900, Monday through Friday on non-Demand Response Holidays during the months of December and January.

Demand Resource Operable Capacity Analysis means an analysis performed by the ISO estimating the expected dispatch hours of active Demand Resources given different assumed levels of Demand Resources clearing in the primary Forward Capacity Auction.

Demand Resource Performance Incentives means the additional monthly capacity payment that a Demand Resource may earn for producing a positive Monthly Capacity Variance in a period where other Demand Resources yield a negative monthly capacity variance.

Demand Resource Performance Penalties means the reduction in the monthly capacity payment to a Demand Resource for producing a negative Monthly Capacity Variance.

Demand Resource Seasonal Peak Hours are those hours in which the actual, real-time hourly load, as measured using real-time telemetry (adjusted for transmission and distribution losses, and excluding load associated with Exports and the pumping load associated with pumped storage generators) for Monday through Friday on non-Demand Response Holidays, during the months of June, July, August, December, and January, as determined by the ISO, is equal to or greater than 90% of the most recent 50/50 system peak load forecast, as determined by the ISO, for the applicable summer or winter season.

Demand Response Asset is the electricity consumption of an individual end-use customer at a Retail Delivery Point or the aggregated electricity consumption of multiple end use customers from multiple delivery points that meets the registration requirements in Section III.E2.2.

Demand Response Available is the capability of the Demand Response Resource, in whole or in part, at any given time, to reduce demand in response to a Dispatch Instruction.

Demand Response Baseline is the expected baseline demand of an individual end-use metered customer or group of end-use metered customers or the expected output levels of the generation of an individual end-use metered customer whose asset is comprised of Distributed Generation as determined pursuant to Section III.8A or Section III.8B.

Demand Response Capacity Resource is one or more Demand Response Resources located within the same Dispatch Zone, that is registered with the ISO, assigned a unique resource identification number by the ISO, and participates in the Forward Capacity Market to fulfill a Market Participant's Capacity Supply Obligation pursuant to Section III.13 of Market Rule 1.

Demand Response Holiday is New Year's Day, Memorial Day, Independence Day, Labor Day, Veterans Day, Thanksgiving Day, and Christmas Day. If the holiday falls on a Saturday, the holiday will be observed on the preceding Friday; if the holiday falls on a Sunday, the holiday will be observed on the following Monday.

Demand Response Resource is an individual Demand Response Asset or aggregation of Demand Response Assets within a Dispatch Zone that meets the registration requirements and participates in the Energy Market pursuant to Appendix III.E2 of Market Rule 1 for Capacity Commitment Periods commencing on or after June 1, 2017.

Demand Response Resource Notification Time is the minimum time, from the receipt of a Dispatch Instruction, that it takes a Demand Response Resource that was not previously reducing demand to start reducing demand.

Demand Response Resource Ramp Rate is the average rate, expressed in MW per minute, at which the Demand Response Resource can reduce demand.

Demand Response Resource Start-Up Time is the time required from the time a Demand Response Resource that was not previously reducing demand starts reducing demand in response to a Dispatch Instruction and the time the resource achieves its Minimum Reduction.

Designated Agent is any entity that performs actions or functions required under the OATT on behalf of the ISO, a Transmission Owner, a Schedule 20A Service Provider, an Eligible Customer, or a Transmission Customer.

Designated Blackstart Resource is a resource that meets the eligibility requirements specified in Schedule 16 of the OATT, and may be a Category A Designated Blackstart Resource or a

Category B Designated Blackstart Resource.

Designated Entity is the entity designated by a Market Participant to receive Dispatch Instructions for generation and/or Dispatchable Asset Related Demand in accordance with the provisions set forth in ISO New England Operating Procedure No. 14.

Designated FCM Participant is any Lead Market Participant, including any Provisional Member that is a Lead Market Participant, transacting in any Forward Capacity Auction, reconfiguration auctions or Capacity Supply Obligation Bilateral for capacity that is otherwise required to provide additional financial assurance under the ISO New England Financial Assurance Policy.

Designated FTR Participant is a Market Participant, including FTR-Only Customers, transacting in the FTR Auction that is otherwise required to provide additional financial assurance under the ISO New England Financial Assurance Policy.

Desired Dispatch Point (DDP) is the Dispatch Rate expressed in megawatts.

Direct Assignment Facilities are facilities or portions of facilities that are constructed for the sole use/benefit of a particular Transmission Customer requesting service under the OATT or a Generator Owner requesting an interconnection. Direct Assignment Facilities shall be specified in a separate agreement among the ISO, Interconnection Customer and Transmission Customer, as applicable, and the Transmission Owner whose transmission system is to be modified to include and/or interconnect with the Direct Assignment Facilities, shall be subject to applicable Commission requirements, and shall be paid for by the Customer in accordance with the applicable agreement and the Tariff.

Directly Metered Assets are specifically measured by OP-18 compliant metering as currently described in Section IV (Metering and Recording for Settlements) of OP-18. Directly Metered Assets include all Tie-Line Assets, all Generator Assets, as well as some Load Assets. Load Assets for which the Host Participant is not the Assigned Meter Reader are considered Directly Metered Assets. In addition, the Host Participant Assigned Meter Reader determines which additional Load Assets are considered Directly Metered Assets and which ones are considered Profiled Load Assets based upon the Host Participant Assigned Meter Reader reporting systems

and process by which the Host Participant Assigned Meter Reader allocates non-PTF losses.

Disbursement Agreement is the Rate Design and Funds Disbursement Agreement among the PTOs, as amended and restated from time to time.

Dispatch Instruction means directions given by the ISO to Market Participants, which may include instructions to start up, shut down, raise or lower generation, curtail or restore loads from Demand Resources, change External Transactions, or change the status of a Dispatchable Asset Related Demand in accordance with the Resource's or contract's Supply Offer or Demand Bid parameters. Such instructions may also require a change to the operation of a Pool Transmission Facility. Such instructions are given through either electronic or verbal means.

Dispatch Rate means the control signal, expressed in dollars per MWh and/or megawatts, calculated and transmitted to direct the output level of each generating Resource and each Dispatchable Asset Related Demand and each Demand Response Resource dispatched by the ISO in accordance with the Offer Data.

Dispatch Zone means a subset of Nodes located within a Load Zone established by the ISO for each Capacity Commitment Period pursuant to Section III.13.1.4.6.1.

Dispatchable Asset Related Demand is any portion of an Asset Related Demand of a Market Participant that is capable of having its energy consumption modified in Real-Time in response to Dispatch Instructions has Electronic Dispatch Capability, and must be able to increase or decrease energy consumption between its Minimum Consumption Limit and Maximum Consumption Limit in accordance with Dispatch Instructions and must meet the technical requirements specified in the ISO New England Manuals. Pumped storage facilities may qualify as Dispatchable Asset Related Demand resources, however, such resources shall not qualify as a capacity resource for both the generating output and dispatchable pumping demand of the facility.

Dispute Representatives are defined in 6.5.c of the ISO New England Billing Policy.

Disputed Amount is a Covered Entity's disputed amount due on any fully paid monthly Invoice and/or any amount believed to be due or owed on a Remittance Advice, as defined in Section 6 of the ISO New England Billing Policy.

Disputing Party, for the purposes of the ISO New England Billing Policy, is any Covered Entity seeking to recover a Disputed Amount.

Distributed Generation means generation resources directly connected to end-use customer load and located behind the end-use customer's meter, which reduce the amount of energy that would otherwise have been produced by other capacity resources on the electricity network in the New England Control Area during Demand Resource On-Peak Hours, Demand Resource Seasonal Peak Hours, Real-Time Demand Response Event Hours, or Real-Time Emergency Generation Event Hours, provided that the aggregate nameplate capacity of the generation resource does not exceed 5 MW, or does not exceed the most recent annual non-coincident peak demand of the end-use metered customer at the location where the generation resource is directly connected, whichever is greater. Generation resources cannot participate in the Forward Capacity Market or the Energy Markets as Demand Resources or Demand Response Resources, unless they meet the definition of Distributed Generation.

Do Not Exceed Dispatch Point is a Dispatch Instruction indicating a maximum output level that a wind resource must not exceed.

DR Auditing Period is the summer DR Auditing Period or winter DR Auditing Period as defined in Section III.13.6.1.5.4.3.1.

Dynamic De-List Bid is a bid that may be submitted by Existing Generating Capacity Resources, Existing Import Capacity Resources, and Existing Demand Resources in the Forward Capacity Auction at or below the Dynamic De-List Bid Threshold, as described in Section III.13.2.3.2(d) of Market Rule 1.

Dynamic De-List Bid Threshold is the price specified in Section III.13.1.2.3.1.A of Market Rule 1 associated with the submission of Dynamic De-List Bids in the Forward Capacity Auction.

EA Amount is defined in Section IV.B.2.2 of the Tariff.

Early Amortization Charge (EAC) is defined in Section IV.B.2 of the Tariff.

Early Amortization Working Capital Charge (EAWCC) is defined in Section IV.B.2 of the Tariff.

Early Payment Shortfall Funding Amount (EPSF Amount) is defined in Section IV.B.2.4 of the Tariff.

Early Payment Shortfall Funding Charge (EPSFC) is defined in Section IV.B.2 of the Tariff.

EAWW Amount is defined in Section IV.B.2.3 of the Tariff.

EBITDA-to-Interest Expense Ratio is, on any date, a Market Participant's or Non-Market Participant Transmission Customer's earnings before interest, taxes, depreciation and amortization in the most recent fiscal quarter divided by that Market Participant's or Non-Market Participant Transmission Customer's expense for interest in that fiscal quarter, in each case as shown on the most recent financial statements provided by such Market Participant or Non-Market Participant Transmission Customer to the ISO.

Economic Maximum Limit or Economic Max is the maximum available output, in MW, of a resource that a Market Participant offers to supply in the Day-Ahead Energy Market or Real-Time Energy Market, as reflected in the resource's Supply Offer. This represents the highest MW output a Market Participant has offered for a resource for economic dispatch. A Market Participant must maintain an up-to-date Economic Maximum Limit for all hours in which a resource has been offered into the Day-Ahead Energy Market or Real-Time Energy Market.

Economic Minimum Limit or Economic Min is the maximum of the following values: (i) the Emergency Minimum Limit; (ii) a level supported by environmental and/or operating permit restrictions; or (iii) a level that addresses any significant economic penalties associated with operating at lower levels that can not be adequately represented by three part bidding (Start-Up Fee, No-Load Fee and incremental energy price). In no event shall the Economic Minimum Limit submitted as part of a generating unit's Offer Data be higher than the generation level at which a generating unit's incremental heat rate is minimized (i.e., transitioning from decreasing as output increases to increasing as output increases) except that a Self-Scheduled Resource may modify its Economic Minimum Limit on an hourly basis, as part of its Supply Offer, in order to indicate the desired level of Self-Scheduled MWs.

Economic Study is defined in Section 4.1(b) of Attachment K to the OATT.

EFT is electronic funds transfer.

Effective Heating Degree Days is equal to $68 - (\text{average of max and min Effective Temperature of the day})$.

Effective Temperature is equal to $\text{dry bulb temperature} - [\text{windspeed} \times (65 - \text{dry bulb temp}) / 100]$.

Elective Transmission Upgrade is a Transmission Upgrade that is participant-funded (i.e., voluntarily funded by an entity or entities that have agreed to pay for all of the costs of such Transmission Upgrade), and is not: (i) a Generator Interconnection Related Upgrade; (ii) a Reliability Transmission Upgrade (including a NEMA Upgrade, as appropriate); (iii) an Market Efficiency Transmission Upgrade (including a NEMA Upgrade, as appropriate); or (iv) initially proposed in an Elective Transmission Upgrade Application filed with the ISO in accordance with Section II.47.5 on a date after the addition or modification already has been otherwise identified in the current Regional System Plan (other than as an Elective Transmission Upgrade) in publication as of the date of that application.

Elective Transmission Upgrade Applicant is defined in Section II.47.5 of the OATT.

Electric Reliability Organization (ERO) is defined in 18 C.F.R. § 39.1.

Electronic Dispatch Capability is the ability to provide for the electronic transmission, receipt, and acknowledgment of data relative to the dispatch of generating units and Dispatchable Asset Related Demands and the ability to carry out the real-time dispatch processes from ISO issuance of Dispatch Instructions to the actual increase or decrease in output of dispatchable Resources.

Eligible Customer is: (i) Any entity that is engaged, or proposes to engage, in the wholesale or retail electric power business is an Eligible Customer under the OATT. (ii) Any electric utility (including any power marketer), Federal power marketing agency, or any other entity generating electric energy for sale or for resale is an Eligible Customer under the OATT. Electric energy

sold or produced by such entity may be electric energy produced in the United States, Canada or Mexico. However, with respect to transmission service that the Commission is prohibited from ordering by Section 212(h) of the Federal Power Act, such entity is eligible only if the service is provided pursuant to a state requirement that the Transmission Owner with which that entity is directly interconnected or the distribution company having the service territory in which that entity is located (if that entity is a retail customer) offer the unbundled transmission service or Local Delivery Service, or pursuant to a voluntary offer of such service by the Transmission Owner with which that entity is directly interconnected or the distribution company having the service territory in which that entity is located (if that entity is a retail customer). (iii) Any end user taking or eligible to take unbundled transmission service or Local Delivery Service pursuant to a state requirement that the Transmission Owner with which that end user is directly interconnected or the distribution company having the service territory in which that entity is located (if that entity is a retail customer) offer the transmission service or Local Delivery Service, or pursuant to a voluntary offer of such service by the Transmission Owner with which that end user is directly interconnected, or the distribution company having the service territory in which that entity is located (if that entity is a retail customer) is an Eligible Customer under the OATT.

Eligible FTR Bidder is an entity that has satisfied applicable financial assurance criteria, and shall not include the auctioneer, its Affiliates, and their officers, directors, employees, consultants and other representatives.

Emergency is an abnormal system condition on the bulk power systems of New England or neighboring Control Areas requiring manual or automatic action to maintain system frequency, or to prevent the involuntary loss of load, equipment damage, or tripping of system elements that could adversely affect the reliability of an electric system or the safety of persons or property; or a fuel shortage requiring departure from normal operating procedures in order to minimize the use of such scarce fuel; or a condition that requires implementation of Emergency procedures as defined in the ISO New England Manuals.

Emergency Condition means an Emergency has been declared by the ISO in accordance with the procedures set forth in the ISO New England Manuals and ISO New England Administrative Procedures.

Emergency Energy is energy transferred from one control area operator to another in an Emergency.

Emergency Minimum Limit or Emergency Min means the minimum generation amount, in MWs, that a generating unit can deliver for a limited period of time without exceeding specified limits of equipment stability and operating permits.

EMS is energy management system.

End-of-Round Price is the lowest price associated with a round of a Forward Capacity Auction, as described in Section III.13.2.3.1 of Market Rule 1.

End User Participant is defined in Section 1 of the Participants Agreement.

Energy is power produced in the form of electricity, measured in kilowatthours or megawatthours.

Energy Administration Service (EAS) is the service provided by the ISO, as described in Schedule 2 of Section IV.A of the Tariff, in order to facilitate: (1) bilateral Energy transactions; (2) self-scheduling of Energy; (3) Interchange Transactions in the Energy Market; and (4) Energy Imbalance Service under Section II of the Tariff.

Energy Component means the Locational Marginal Price at the reference point.

Energy Efficiency is installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that reduce the total amount of electrical energy needed, while delivering a comparable or improved level of end-use service. Such measures include, but are not limited to, the installation of more energy efficient lighting, motors, refrigeration, HVAC equipment and control systems, envelope measures, operations and maintenance procedures, and industrial process equipment.

Energy Imbalance Service is the form of Ancillary Service described in Schedule 4 of the OATT.

Energy Market is, collectively, the Day-Ahead Energy Market and the Real-Time Energy Market.

Energy Non-Zero Spot Market Settlement Hours are hours for which the Customer has a positive or negative Real-Time System Adjusted Net Interchange as determined by the ISO settlement process for the Energy Market.

Energy Transaction Units (Energy TUs) are the sum for the month for a Customer of Bilateral Contract Block-Hours, Demand Bid Block-Hours, Asset Related Demand Bid Block-Hours, Supply Offer Block-Hours and Energy Non-Zero Spot Market Settlement Hours.

Enrolling Participant is the Market Participant that registers Customers for the Load Response Program.

Equipment Damage Reimbursement is the compensation paid to the owner of a Designated Blackstart Resource as specified in Section 5.5 of Schedule 16 to the OATT.

Equivalent Demand Forced Outage Rate (EFORD) means the portion of time a unit is in demand, but is unavailable due to forced outages.

Estimated Capacity Load Obligation is, for the purposes of the ISO New England Financial Assurance Policy, the Capacity Requirement from the latest available month, adjusted as appropriate to account for any relevant Capacity Load Obligation Bilaterals, HQICCs, and Self-Supplied FCA Resource designations for the applicable month.

Establish Claimed Capability Audit is the audit performed pursuant to Section III.1.5.1.2.

Estimated Net Regional Clearing Price (ENRCP) is calculated in accordance with Section VII.C of the ISO New England Financial Assurance Policy.

Excepted Transaction is a transaction specified in Section II.40 of the Tariff for the applicable period specified in that Section.

Exempt Real-Time Generation Obligation means that portion of a Market Participant's Real-

Time Generation Obligation that is not included in the calculation of Minimum Generation Emergency Credits pursuant to Appendix F of Market Rule 1.

Existing Capacity Qualification Deadline is a deadline, specified in Section III.13.1.10 of Market Rule 1, for submission of certain qualification materials for the Forward Capacity Auction, as discussed in Section III.13.1 of Market Rule 1.

Existing Capacity Qualification Package is information submitted by certain existing resources prior to participation in the Forward Capacity Auction, as described in Section III.13.1 of Market Rule 1.

Existing Capacity Resource is any resource that does not meet any of the eligibility criteria to participate in the Forward Capacity Auction as a New Capacity Resource, and, subject to ISO evaluation, for the Forward Capacity Auction to be conducted beginning February 1, 2008, any resource that is under construction and within 12 months of its expected commercial operations date.

Existing Demand Resource is a type of Demand Resource participating in the Forward Capacity Market, as defined in Section III.13.1.4.1.1 of Market Rule 1.

Existing Generating Capacity Resource is a type of resource participating in the Forward Capacity Market, as defined in Section III.13.1.2.1 of Market Rule 1.

Existing Import Capacity Resource is a type of resource participating in the Forward Capacity Market, as defined in Section III.13.1.3.1 of Market Rule 1.

Expedited Study Request is defined in Section II.34.7 of the OATT.

Export-Adjusted LSR is as defined in Section III.12.4(b)(ii).

Export Bid is a bid that may be submitted by certain resources in the Forward Capacity Auction to export capacity to an external Control Area, as described in Section III.13.1.2.3.1.3 of Market Rule 1.

Exports are Real-Time External Transactions, which are limited to sales from the New England Control Area, for exporting energy out of the New England Control Area.

External Market Monitor means the person or entity appointed by the ISO Board of Directors pursuant to Section III.A.1.2 of Appendix A of Market Rule 1 to carry out the market monitoring and mitigation functions specified in Appendix A and elsewhere in Market Rule 1.

External Node is a proxy bus or buses used for establishing a Locational Marginal Price for energy received by Market Participants from, or delivered by Market Participants to, a neighboring Control Area or for establishing Locational Marginal Prices associated with energy delivered through the New England Control Area by Non-Market Participants for use in calculating Non-Market Participant Congestion Costs and loss costs.

External Resource means a generation resource located outside the metered boundaries of the New England Control Area.

External Transaction is the import of external energy into the New England Control Area by a Market Participant or the export of internal energy out of the New England Control Area by a Market Participant in the Day-Ahead Energy Market and/or Real-Time Energy Market, or the wheeling of external energy through the New England Control Area by a Market Participant or a Non-Market Participant in the Real-Time Energy Market.

External Transmission Project is a transmission project comprising facilities located wholly outside the New England Control Area and regarding which an agreement has been reached whereby New England ratepayers will support all or a portion of the cost of the facilities.

Facilities Study is an engineering study conducted pursuant to the OATT by the ISO (or, in the case of Local Service or interconnections to Local Area Facilities as defined in the TOA, by one or more affected PTOs) or some other entity designated by the ISO in consultation with any affected Transmission Owner(s), to determine the required modifications to the PTF and Non-PTF, including the cost and scheduled completion date for such modifications, that will be required to provide a requested transmission service or interconnection on the PTF and Non-PTF.

Failure to Maintain Blackstart Capability is a failure of a Blackstart Owner or Designated

Blackstart Resource to meet the Blackstart Service Minimum Criteria or Blackstart Service obligations, but does not include a Failure to Perform During a System Restoration event.

Failure to Perform During a System Restoration is a failure of a Blackstart Owner or Designated Blackstart Resource to follow ISO or Local Control Center dispatch instructions or perform in accordance with the dispatch instructions or the Blackstart Service Minimum Criteria and Blackstart Service obligations, described within the ISO New England Operating Documents, during a restoration of the New England Transmission System.

Fast Start Generator means a generating unit that the ISO may dispatch within the hour through electronic dispatch and that meets the following criteria: (i) minimum run time does not exceed one hour; (ii) minimum down time does not exceed one hour; (iii) time to start does not exceed 30 minutes; (iv) available for dispatch and manned or has automatic remote dispatch capability; (v) capable of receiving and acknowledging a start-up or shut-down dispatch instruction electronically; and (vi) has satisfied its minimum down time.

FCA Cleared Export Transaction is defined in Section III.1.10.7(f)(ii) of Market Rule 1.

FCA Payment is the monthly capacity payment for a resource whose offer has cleared in a Forward Capacity Auction as described in Section III.13.7.2.1.1(a) of Market Rule 1.

FCA Qualified Capacity is the Qualified Capacity that is used in a Forward Capacity Auction.

FCM Capacity Charge Requirements are calculated in accordance with Section VII.C of the ISO New England Financial Assurance Policy.

FCM Deposit is calculated in accordance with Section VII.B.1 of the ISO New England Financial Assurance Policy.

FCM Financial Assurance Requirements are described in Section VII of the ISO New England Financial Assurance Policy.

Final Forward Reserve Obligation is calculated in accordance with Section III.9.8(a) of Market Rule 1.

Financial Assurance Default results from a Market Participant or Non-Market Participant Transmission Customer's failure to comply with the ISO New England Financial Assurance Policy.

Financial Assurance Obligations relative to the ISO New England Financial Assurance Policy are determined in accordance with Section III.A(v) of the ISO New England Financial Assurance Policy.

Financial Transmission Right (FTR) is a financial instrument that evidences the rights and obligations specified in Sections III.5.2.2 and III.7 of the Tariff.

Firm Point-To-Point Service is service which is arranged for and administered between specified Points of Receipt and Delivery in accordance with Part II.C of the OATT.

Firm Transmission Service is Regional Network Service, Through or Out Service, service for Excepted Transactions, firm MTF Service, firm OTF Service, and firm Local Service.

Force Majeure - An event of Force Majeure means any act of God, labor disturbance, act of the public enemy or terrorists, war, invasion, insurrection, riot, fire, storm or flood, ice, explosion, breakage or accident to machinery or equipment, any curtailment, order, regulation or restriction imposed by governmental military or lawfully established civilian authorities, or any other cause beyond the control of the ISO, a Transmission Owner, a Schedule 20A Service Provider, or a Customer, including without limitation, in the case of the ISO, any action or inaction by a Customer, a Schedule 20A Service Provider, or a Transmission Owner, in the case of a Transmission Owner, any action or inaction by the ISO, any Customer, a Schedule 20A Service Provider, or any other Transmission Owner, in the case of a Schedule 20A Service Provider, any action or inaction by the ISO, any Customer, a Transmission Owner, or any other Schedule 20A Service Provider, and, in the case of a Transmission Customer, any action or inaction by the ISO, a Schedule 20A Service Provider, or any Transmission Owner.

Forecast Hourly Demand Reduction means the estimated maximum quantity of energy reduction (MWh), measured at the end-use customer meter that can be produced by a Real-Time Demand Response Resource, or Real-Time Emergency Generation Resource, in each hour of an

Operating Day. For a Real-Time Emergency Generation Asset that is metered at the generator and associated with a Real-Time Emergency Generation Resource, the Forecast Hourly Demand Reduction means the estimated maximum generator output (MWh) in each hour of an Operating Day.

Formal Warning is defined in Section III.B.4.1.1 of Appendix B of Market Rule 1.

Formula-Based Sanctions are defined in Section III.B.4.1.3 of Appendix B of Market Rule 1.

Forward Capacity Auction (FCA) is the annual descending clock auction in the Forward Capacity Market, as described in Section III.13.2 of Market Rule 1.

Forward Capacity Auction Starting Price is calculated in accordance with Section III.13.2.4 of Market Rule 1.

Forward Capacity Market (FCM) is the forward market for procuring capacity in the New England Control Area, as described in Section III.13 of Market Rule 1.

Forward Reserve means TMNSR and TMOR purchased by the ISO on a forward basis on behalf of Market Participants as provided for in Section III.9 of Market Rule 1.

Forward Reserve Assigned Megawatts is the amount of Forward Reserve, in megawatts, that a Market Participant assigns to eligible Forward Reserve Resources to meet its Forward Reserve Obligation as defined in Section III.9.4.1 of Market Rule 1.

Forward Reserve Auction is the periodic auction conducted by the ISO in accordance with Section III.9 of Market Rule 1 to procure Forward Reserve.

Forward Reserve Auction Offers are offers to provide Forward Reserve to meet system and Reserve Zone requirements as submitted by a Market Participant in accordance with Section III.9.3 of Market Rule 1.

Forward Reserve Charge is a Market Participant's share of applicable system and Reserve Zone Forward Reserve costs attributable to meeting the Forward Reserve requirement as calculated in

accordance with Section III.9.9 of Market Rule 1.

Forward Reserve Clearing Price is the clearing price for TMNSR or TMOR, as applicable, for the system and each Reserve Zone resulting from the Forward Reserve Auction as defined in Section III.9.4 of Market Rule 1.

Forward Reserve Credit is the credit received by a Market Participant that is associated with that Market Participant's Final Forward Reserve Obligation as calculated in accordance with Section III.9.8 of Market Rule 1.

Forward Reserve Delivered Megawatts are calculated in accordance with Section III.9.6.5 of Market Rule 1.

Forward Reserve Delivery Period is defined in Section III.9.1 of Market Rule 1.

Forward Reserve Failure-to-Activate Megawatts are calculated in accordance with Section III.9.7.2(a) of Market Rule 1.

Forward Reserve Failure-to-Activate Penalty is the penalty associated with a Market Participant's failure to activate Forward Reserve when requested to do so by the ISO and is defined in Section III.9.7.2 of Market Rule 1.

Forward Reserve Failure-to-Activate Penalty Rate is specified in Section III.9.7.2 of Market Rule 1.

Forward Reserve Failure-to-Reserve, as specified in Section III.9.7.1 of Market Rule 1, occurs when a Market Participant's Forward Reserve Delivered Megawatts for a Reserve Zone in an hour is less than that Market Participant's Forward Reserve Obligation for that Reserve Zone in that hour. Under these circumstances the Market Participant pays a penalty based upon the Forward Reserve Failure-to-Reserve Penalty Rate and that Market Participant's Forward Reserve Failure-to-Reserve Megawatts.

Forward Reserve Failure-to-Reserve Megawatts are calculated in accordance with Section III.9.7.1(a) of Market Rule 1.

Forward Reserve Failure-to-Reserve Penalty is the penalty associated with a Market Participant's failure to reserve Forward Reserve and is defined in Section III.9.7.1 of Market Rule 1.

Forward Reserve Failure-to-Reserve Penalty Rate is specified in Section III.9.7.1(b)(ii) of Market Rule 1.

Forward Reserve Fuel Index is the index or set of indices used to calculate the Forward Reserve Threshold Price as defined in Section III.9.6.2 of Market Rule 1.

Forward Reserve Heat Rate is the heat rate as defined in Section III.9.6.2 of Market Rule 1 that is used to calculate the Forward Reserve Threshold Price.

Forward Reserve Market is a market for forward procurement of two reserve products, Ten-Minute Non-Spinning Reserve (TMNSR) and Thirty-Minute Operating Reserve (TMOR).

Forward Reserve MWs are those megawatts assigned to specific eligible Forward Reserve Resources which convert a Forward Reserve Obligation into a Resource-specific obligation.

Forward Reserve Obligation is a Market Participant's amount, in megawatts, of Forward Reserve that cleared in the Forward Reserve Auction and adjusted, as applicable, to account for bilateral transactions that transfer Forward Reserve Obligations.

Forward Reserve Obligation Charge is defined in Section III.10.4 of Market Rule 1.

Forward Reserve Offer Cap is \$14,000/megawatt-month.

Forward Reserve Payment Rate is defined in Section III.9.8 of Market Rule 1.

Forward Reserve Procurement Period is defined in Section III.9.1 of Market Rule 1.

Forward Reserve Qualifying Megawatts refer to all or a portion of a Forward Reserve Resource's capability offered into the Real-Time Energy Market at energy offer prices above the

applicable Forward Reserve Threshold Price that are calculated in accordance with Section III.9.6.4 of Market Rule 1.

Forward Reserve Resource is a Resource that meets the eligibility requirements defined in Section III.9.5.2 of Market Rule 1 that has been assigned Forward Reserve Obligation by a Market Participant.

Forward Reserve Threshold Price is the minimum price at which assigned Forward Reserve Megawatts are required to be offered into the Real-Time Energy Market as calculated in Section III.9.6.2 of Market Rule 1.

FTR Auction is the periodic auction of FTRs conducted by the ISO in accordance with Section III.7 of Market Rule 1.

FTR Auction Revenue is the revenue collected from the sale of FTRs in FTR Auctions. FTR Auction Revenue is payable to FTR Holders who submit their FTRs for sale in the FTR Auction in accordance with Section III.7 of Market Rule 1 and to ARR Holders and Incremental ARR Holders in accordance with Appendix C of Market Rule 1.

FTR Award Financial Assurance is a required amount of financial assurance that must be maintained at all times from a Designated FTR Participant for each FTR awarded to the participant in any FTR Auctions. This amount is calculated pursuant to Section VI.C of the ISO New England Financial Assurance Policy.

FTR Bid Financial Assurance is an amount of financial assurance required from a Designated FTR Participant for each bid submission into an FTR auction. This amount is calculated pursuant to Section VI.B of the ISO New England Financial Assurance Policy.

FTR Credit Test Percentage is calculated in accordance with Section III.B.1(b) of the ISO New England Financial Assurance Policy.

FTR Financial Assurance Requirements are described in Section VI of the ISO New England Financial Assurance Policy.

FTR Holder is an entity that acquires an FTR through the FTR Auction to Section III.7 of Market Rule 1 and registers with the ISO as the holder of the FTR in accordance with Section III.7 of Market Rule 1 and applicable ISO New England Manuals.

FTR-Only Customer is a Market Participant that transacts in the FTR Auction and that does not participate in other markets or programs of the New England Markets. References in this Tariff to a “Non-Market Participant FTR Customers” and similar phrases shall be deemed references to an FTR-Only Customer.

FTR Settlement Risk Financial Assurance is an amount of financial assurance required by a Designated FTR Participant for each bid submission into an FTR Auction and for each bid awarded to the individual participant in an FTR Auction. This amount is calculated pursuant to Section VI.A of the ISO New England Financial Assurance Policy.

GADS Data means data submitted to the NERC for collection into the NERC’s Generating Availability Data System (GADS).

Gap Request for Proposals (Gap RFP) is defined in Section III.11 of Market Rule 1.

Gas Day means a period of 24 consecutive hours beginning at 0900 hrs Central Time.

Generating Capacity Resource means a New Generating Capacity Resource or an Existing Generating Capacity Resource.

Generator Asset is a generator that has been registered in accordance with the Asset Registration Process.

Generator Imbalance Service is the form of Ancillary Service described in Schedule 10 of the OATT.

Generator Interconnection Related Upgrade is an addition to or modification of the New England Transmission System (pursuant to Section II.47.1, Schedule 22 or Schedule 23 of the OATT) to effect the interconnection of a new generating unit or an existing generating unit whose energy capability or capacity capability is being materially changed and increased whether or not

the interconnection is being effected to meet the Capacity Capability Interconnection Standard or the Network Capability Interconnection Standard. As to Category A Projects (as defined in Schedule 11 of the OATT), a Generator Interconnection Related Upgrade also includes an upgrade beyond that required to satisfy the Network Capability Interconnection Standard (or its predecessor) for which the Generator Owner has committed to pay prior to October 29, 1998.

Generator Owner is the owner, in whole or part, of a generating unit whether located within or outside the New England Control Area.

Good Utility Practice means any of the practices, methods and acts engaged in or approved by a significant portion of the electric utility industry during the relevant time period, or any of the practices, methods and acts which, in the exercise of reasonable judgment in light of the facts known at the time the decision was made, could have been expected to accomplish the desired result at a reasonable cost consistent with good business practices, reliability, safety and expedition. Good Utility Practice is not intended to be limited to the optimum practice, method, or act to the exclusion of all others, but rather includes all acceptable practices, methods, or acts generally accepted in the region, including those practices required by Federal Power Act Section 215(a)(4).

Governance Only Member is defined in Section 1 of the Participants Agreement.

Governance Participant is defined in the Participants Agreement.

Governing Documents, for the purposes of the ISO New England Billing Policy, are the Transmission, Markets and Services Tariff and ISO Participants Agreement.

Governing Rating is the lowest corporate rating from any Rating Agency for that Market Participant, or, if the Market Participant has no corporate rating, then the lowest rating from any Rating Agency for that Market Participant's senior unsecured debt.

Grandfathered Agreements (GAs) is a transaction specified in Section II.45 for the applicable period specified in that Section.

Grandfathered Intertie Agreement (GIA) is defined pursuant to the TOA.

Handy-Whitman Index of Public Utility Construction Costs is the Total Other Production Plant index shown in the Cost Trends of Electric Utility Construction for the North Atlantic Region as published in the Handy-Whitman Index of Public Utility Construction Costs.

Highgate Transmission Facilities (HTF) are existing U. S.-based transmission facilities covered under the Agreement for Joint Ownership, Construction and Operation of the Highgate Transmission Interconnection dated as of August 1, 1984 including (1) the whole of a 200 megawatt high-voltage, back-to-back, direct-current converter facility located in Highgate, Vermont and (2) a 345 kilovolt transmission line within Highgate and Franklin, Vermont (which connects the converter facility at the U.S.-Canadian border to a Hydro-Quebec 120 kilovolt line in Bedford, Quebec). The HTF include any upgrades associated with increasing the capacity or changing the physical characteristics of these facilities as defined in the above stated agreement dated August 1, 1984 until the Operations Date, as defined in the TOA. The current HTF rating is a nominal 225 MW. The HTF are not defined as PTF. Coincident with the Operations Date and except as stipulated in Schedules, 9, 12, and Attachment F to the OATT, HTF shall be treated in the same manner as PTF for purposes of the OATT and all references to PTF in the OATT shall be deemed to apply to HTF as well. The treatment of the HTF is not intended to establish any binding precedent or presumption with regard to the treatment for other transmission facilities within the New England Transmission System (including HVDC, MTF, or Control Area Interties) for purposes of the OATT.

Host Participant or Host Utility is a Market Participant or a Governance Participant transmission or distribution provider that reconciles the loads within the metering domain with OP-18 compliant metering.

Hourly Adjusted Audited Demand Reduction is calculated in accordance with Section III.13.7.1.5.10.1.2.

Hourly Calculated Demand Resource Performance Value means the performance of a Demand Resource during Real-Time Demand Response Event Hours and Real-Time Emergency Generation Event Hours for purposes of calculating a Demand Reduction Value pursuant to Sections III.13.7.1.5.7.3 and III.13.7.1.5.8.3.

Hourly Charges are defined in Section 1.3 of the ISO New England Billing Policy.

Hourly PER is calculated in accordance with Section III.13.7.2.7.1.1.1(a) of Market Rule 1.

Hourly Real-Time Demand Response Resource Deviation means the difference between the Average Hourly Load Reduction or Average Hourly Output of the Real-Time Demand Response Resource and the amount of load reduction or output that the Market Participant was instructed to produce pursuant to a Dispatch Instruction calculated pursuant to Section III.13.7.1.5.7.3.1.

Hourly Real-Time Emergency Generation Resource Deviation is calculated pursuant to Section III.13.7.1.5.8.3.1.

Hourly Requirements are determined in accordance with Section III.A(i) of the ISO New England Financial Assurance Policy.

Hub is a specific set of pre-defined Nodes for which a Locational Marginal Price will be calculated for the Day-Ahead Energy Market and Real-Time Energy Market and which can be used to establish a reference price for energy purchases and the transfer of Day-Ahead Adjusted Load Obligations and Real-Time Adjusted Load Obligations and for the designation of FTRs.

Hub Price is calculated in accordance with Section III.2.8 of Market Rule 1.

HQ Interconnection Capability Credit (HQICC) is a monthly value reflective of the annual installed capacity benefits of the Phase I/II HVDC-TF, as determined by the ISO, using a standard methodology on file with the Commission, in conjunction with the setting of the Installed Capacity Requirement. An appropriate share of the HQICC shall be assigned to an IRH if the Phase I/II HVDC-TF support costs are paid by that IRH and such costs are not included in the calculation of the Regional Network Service rate. The share of HQICC allocated to such an eligible IRH for a month is the sum in kilowatts of (1)(a) the IRH's percentage share, if any, of the Phase I Transfer Capability times (b) the Phase I Transfer Credit, plus (2)(a) the IRH's percentage share, if any, of the Phase II Transfer Capability, times (b) the Phase II Transfer Credit. The ISO shall establish appropriate HQICCs to apply for an IRH which has such a percentage share.

Import Capacity Resource means an Existing Import Capacity Resource or a New Import Capacity Resource offered to provide capacity in the New England Control Area from an external Control Area.

Inadequate Supply is defined in Section III.13.2.8.1 of Market Rule 1.

Inadvertent Energy Revenue is defined in Section III.3.2.1(k) of Market Rule 1.

Inadvertent Energy Revenue Charges or Credits is defined in Section III.3.2.1(l) of Market Rule 1.

Inadvertent Interchange means the difference between net actual energy flow and net scheduled energy flow into or out of the New England Control Area.

Increment Offer means an offer to sell energy at a specified Location in the Day-Ahead Energy Market which is not associated with a physical supply. An accepted Increment Offer results in scheduled generation at the specified Location in the Day-Ahead Energy Market.

Incremental ARR is an ARR provided in recognition of a participant-funded transmission system upgrade pursuant to Appendix C of this Market Rule.

Incremental ARR Holder is an entity which is the record holder of an Incremental Auction Revenue Right in the register maintained by the ISO.

Incremental Cost of Reliability Service is described in Section III.13.2.5.2.5.2 of Market Rule 1.

Independent Transmission Company (ITC) is a transmission entity that assumes certain responsibilities in accordance with Section 10.05 of the Transmission Operating Agreement and Attachment M to the OATT, subject to the acceptance or approval of the Commission and a finding of the Commission that the transmission entity satisfies applicable independence requirements.

Information Request is a request from a potential Disputing Party submitted in writing to the ISO for access to Confidential Information.

Initial Market Participant Financial Assurance Requirement is calculated for new Market Participants and Returning Market Participants, other than an FTR-Only Customer or a Governance Only Member, according to Section IV of the ISO New England Financial Assurance Policy.

Installed Capacity Requirement means the level of capacity required to meet the reliability requirements defined for the New England Control Area, as described in Section III.12 of Market Rule 1.

Insufficient Competition is defined in Section III.13.2.8.2 of Market Rule 1.

Interchange Transactions are transactions deemed to be effected under Market Rule 1.

Interconnecting Transmission Owner has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Interconnection Agreement is the “Large Generator Interconnection Agreement” or the “Small Generator Interconnection Agreement” pursuant to Schedules 22 and 23 of the ISO OATT or an interconnection agreement approved by the Commission prior to the adoption of the Interconnection Procedures.

Interconnection Customer has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Interconnection Feasibility Study Agreement has the meaning specified in Section I of Schedule 22 or Attachment 1 to Schedule 23 of the OATT.

Interconnection Procedure is the “Large Generator Interconnection Procedures” or the “Small Generator Interconnection Procedures” pursuant to Schedules 22 and 23 of the ISO OATT.

Interconnection Request has the meaning specified in Section I of Schedule 22 or Attachment 1

to Schedule 23 of the OATT.

Interconnection Rights Holder(s) (IRH) has the meaning given to it in Schedule 20A to Section II of this Tariff.

Interconnection System Impact Study Agreement has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Interest is interest calculated in the manner specified in Section II.8.3.

Intermittent Power Resource is defined in Section III.13.1.2.2.2 of Market Rule 1.

Intermittent Settlement Only Resource is a Settlement Only Resource that is also an Intermittent Power Resource.

Internal Bilateral for Load is an internal bilateral transaction under which the buyer receives a reduction in Real-Time Load Obligation and the seller receives a corresponding increase in Real-Time Load Obligation in the amount of the sale, in MWs. An Internal Bilateral for Load transaction is only applicable in the Real-Time Energy Market.

Internal Bilateral for Market for Energy is an internal bilateral transaction for Energy which applies in the Day-Ahead Energy Market and Real-Time Energy Market or just the Real-Time Energy Market under which the buyer receives a reduction in Day-Ahead Adjusted Load Obligation and Real-Time Adjusted Load Obligation and the seller receives a corresponding increase in Day-Ahead Adjusted Load Obligation and Real-Time Adjusted Load Obligation in the amount of the sale, in MWs.

Internal Market Monitor means the department of the ISO responsible for carrying out the market monitoring and mitigation functions specified in Appendix A and elsewhere in Market Rule 1.

Interregional Planning Stakeholder Advisory Committee (IPSAC) is the committee described as such in the Northeast Planning Protocol.

Interregional Transmission Project is a transmission project located within the New England Control Area and one or more of the neighboring transmission planning regions.

Interruption Cost is the amount, in dollars, that must be paid to a Market Participant each time the Market Participant's Demand Response Resource is scheduled or dispatched in the New England Markets to reduce demand.

Investment Grade Rating, for a Market (other than an FTR-Only Customer) or Non-Market Participant Transmission Customer, is either (a) a corporate investment grade rating from one or more of the Rating Agencies, or (b) if the Market Participant or Non-Market Participant Transmission Customer does not have a corporate rating from one of the Rating Agencies, then an investment grade rating for the Market Participant's or Non-Market Participant Transmission Customer's senior unsecured debt from one or more of the Rating Agencies.

Invoice is a statement issued by the ISO for the net Charge owed by a Covered Entity pursuant to the ISO New England Billing Policy.

Invoice Date is the day on which the ISO issues an Invoice.

ISO means ISO New England Inc.

ISO Charges, for the purposes of the ISO New England Billing Policy, are both Non-Hourly Charges and Hourly Charges.

ISO Control Center is the primary control center established by the ISO for the exercise of its Operating Authority and the performance of functions as an RTO.

ISO-Initiated Claimed Capability Audit is the audit performed pursuant to Section III.1.5.1.4.

ISO New England Administrative Procedures means procedures adopted by the ISO to fulfill its responsibilities to apply and implement ISO New England System Rules.

ISO New England Billing Policy is Exhibit ID to Section I of the Transmission, Markets and Services Tariff.

ISO New England Filed Documents means the Transmission, Markets and Services Tariff, including but not limited to Market Rule 1, the Participants Agreement, the Transmission Operating Agreement or other documents that affect the rates, terms and conditions of service.

ISO New England Financial Assurance Policy is Exhibit IA to Section I of the Transmission, Markets and Services Tariff.

ISO New England Information Policy is the policy establishing guidelines regarding the information received, created and distributed by Market Participants and the ISO in connection with the settlement, operation and planning of the System, as the same may be amended from time to time in accordance with the provisions of this Tariff. The ISO New England Information Policy is Attachment D to the Transmission, Markets and Services Tariff.

ISO New England Manuals are the manuals implementing Market Rule 1, as amended from time to time in accordance with the Participants Agreement. Any elements of the ISO New England Manuals that substantially affect rates, terms, and/or conditions of service shall be filed with the Commission under Section 205 of the Federal Power Act.

ISO New England Operating Documents are the Tariff and the ISO New England Operating Procedures.

ISO New England Operating Procedures are the ISO New England Planning Procedures and the operating guides, manuals, procedures and protocols developed and utilized by the ISO for operating the ISO bulk power system and the New England Markets.

ISO New England Planning Procedures are the procedures developed and utilized by the ISO for planning the ISO bulk power system.

ISO New England System Rules are Market Rule 1, the ISO New England Information Policy, the ISO New England Administrative Procedures, the ISO New England Manuals and any other system rules, procedures or criteria for the operation of the New England Transmission System and administration of the New England Markets and the Transmission, Markets and Services Tariff.

ITC Agreement is defined in Attachment M to the OATT.

ITC Rate Schedule is defined in Section 3.1 of Attachment M to the OATT.

ITC System is defined in Section 2.2 of Attachment M to the OATT.

ITC System Planning Procedures is defined in Section 15.4 of Attachment M to the OATT.

Joint ISO/RTO Planning Committee (JIPC) is the committee described as such in the Northeastern Planning Protocol.

Late Payment Account is a segregated interest-bearing account into which the ISO deposits Late Payment Charges due from ISO Charges and interest owed from participants for late payments that are collected and not distributed to the Covered Entities, until the Late Payment Account Limit is reached, under the ISO New England Billing Policy and penalties collected under the ISO New England Financial Assurance Policy.

Late Payment Account Limit is defined in Section 4.2 of the ISO New England Billing Policy.

Late Payment Charge is defined in Section 4.1 of the ISO New England Billing Policy.

Lead Market Participant, for purposes other than the Forward Capacity Market, is the entity authorized to submit Supply Offers or Demand Bids for a Resource and to whom certain Energy TUs are assessed under Schedule 2 of Section IV.A of the Tariff. For purposes of the Forward Capacity Market, the Lead Market Participant is the entity designated to participate in that market on behalf of an Existing Capacity Resource or a New Capacity Resource.

Limited Energy Resource means generating resources that, due to design considerations, environmental restriction on operations, cyclical requirements, such as the need to recharge or refill or manage water flow, or fuel limitations, are unable to operate continuously at full output on a daily basis.

Load Asset means a physical load that has been registered in accordance with the Asset

Registration Process.

Load Management means installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that curtail electrical usage or shift electrical usage from Demand Resource On-Peak Hours, Demand Resource Seasonal Peak Hours, or Real-Time Demand Response Event Hours to other hours and reduce the amount of capacity needed, while delivering a comparable or acceptable level of end-use service. Such measures include, but are not limited to, energy management systems, load control end-use cycling, load curtailment strategies, chilled water storage, and other forms of electricity storage.

Load Response Program means the program implemented and administered by the ISO to promote demand side response as described in Appendix E to Market Rule 1.

Load Response Program Asset means one or more individual end-use metered customers that report load reduction and consumption, or generator output as a single set of values, are assigned an identification number, that participate in the Load Response Program and which encompass assets registered in the Real-Time Price Response Program or Real-Time Demand Response Assets, and are further described in Appendix E of Market Rule 1.

Load Shedding is the systematic reduction of system demand by temporarily decreasing load.

Load Zone is a Reliability Region, except as otherwise provided for in Section III.2.7 of Market Rule 1.

Local Area Facilities are defined in the TOA.

Local Benefit Upgrade(s) (LBU) is an upgrade, modification or addition to the transmission system that is: (i) rated below 115kV or (ii) rated 115kV or above and does not meet all of the non-voltage criteria for PTF classification specified in the OATT.

Local Control Centers are those control centers in existence as of the effective date of the OATT (including the CONVEX, REMVEC, Maine and New Hampshire control centers) or established by the PTOs in accordance with the TOA that are separate from the ISO Control Center and perform certain functions in accordance with the OATT and the TOA.

Local Delivery Service is the service of delivering electric energy to end users. This service is subject to state jurisdiction regardless of whether such service is provided over local distribution or transmission facilities. An entity that is an Eligible Customer under the OATT is not excused from any requirements of state law, or any order or regulation issued pursuant to state law, to arrange for Local Delivery Service with the Participating Transmission Owner and/or distribution company providing such service and to pay all applicable charges associated with such service, including charges for stranded costs and benefits.

Local Network is defined as the transmission facilities constituting a local network as identified in Attachment E, as such Attachment may be modified from time to time in accordance with the Transmission Operating Agreement.

Local Network Load is the load that a Network Customer designates for Local Network Service under Schedule 21 to the OATT.

Local Network RNS Rate is the rate applicable to Regional Network Service to effect a delivery to load in a particular Local Network, as determined in accordance with Schedule 9 to the OATT.

Local Network Service (LNS) is the network service provided under Schedule 21 and the Local Service Schedules to permit the Transmission Customer to efficiently and economically utilize its resources to serve its load.

Local Point-To-Point Service (LPTP) is Point-to-Point Service provided under Schedule 21 of the OATT and the Local Service Schedules to permit deliveries to or from an interconnection point on the PTF.

Local Resource Adequacy Requirement is calculated pursuant to Section III.12.2.1.1.

Local Second Contingency Protection Resources are those Resources identified by the ISO on a daily basis as necessary for the provision of Operating Reserve requirements and adherence to NERC, NPCC and ISO reliability criteria over and above those Resources required to meet first contingency reliability criteria within a Reliability Region.

Local Service is transmission service provided under Schedule 21 and the Local Service Schedules thereto.

Local Service Schedule is a PTO-specific schedule to the OATT setting forth the rates, charges, terms and conditions applicable to Local Service.

Local Sourcing Requirement (LSR) is the minimum amount of capacity that must be located within an import-constrained Load Zone, calculated as described in Section III.12.2 of Market Rule 1.

Local System Planning (LSP) is the process defined in Appendix 1 of Attachment K to the OATT.

Localized Costs are the incremental costs resulting from a RTEP02 Upgrade or a Regional Benefit Upgrade that exceeds those requirements that the ISO deems reasonable and consistent with Good Utility Practice and the current engineering design and construction practices in the area in which the Transmission Upgrade is built. In making its determination of whether Localized Costs exist, the ISO will consider, in accordance with Schedule 12C of the OATT, the reasonableness of the proposed engineering design and construction method with respect to alternate feasible Transmission Upgrades and the relative costs, operation, timing of implementation, efficiency and reliability of the proposed Transmission Upgrade. The ISO, with advisory input from the Reliability Committee, as appropriate, shall review such Transmission Upgrade, and determine whether there are any Localized Costs resulting from such Transmission Upgrade. If there are any such costs, the ISO shall identify them in the Regional System Plan.

Location is a Node, External Node, Load Zone or Hub. For Capacity Commitment Periods commencing on or after June 1, 2017, the Location also is a Dispatch Zone.

Locational Marginal Price (LMP) is defined in Section III.2 of Market Rule 1. The Locational Marginal Price for a Node is the nodal price at that Node; the Locational Marginal Price for an External Node is the nodal price at that External Node; the Locational Marginal Price for a Load Zone or Reliability Region is the Zonal Price for that Load Zone or Reliability Region, respectively; and the Locational Marginal Price for a Hub is the Hub Price for that Hub. For Capacity Commitment Periods commencing on or after June 1, 2017, the Location Marginal Price

for a Dispatch Zone is the Zonal Price for that Dispatch Zone.

Long Lead Time Generating Facility (Long Lead Facility) has the meaning specified in Section I of Schedule 22 of the OATT.

Long-Term is a term of one year or more.

Long-Term Transmission Outage is a long-term transmission outage scheduled in accordance with ISO New England Operating Procedure No. 3.

Loss Component is the component of the nodal LMP at a given Node or External Node on the PTF that reflects the cost of losses at that Node or External Node relative to the reference point. The Loss Component of the nodal LMP at a given Node on the non-PTF system reflects the relative cost of losses at that Node adjusted as required to account for losses on the non-PTF system already accounted for through tariffs associated with the non-PTF. When used in connection with Hub Price or Zonal Price, the term Loss Component refers to the Loss Components of the nodal LMPs that comprise the Hub Price or Zonal Price, which Loss Components are averaged or weighted in the same way that nodal LMPs are averaged to determine Hub Price or weighted to determine Zonal Price.

Loss of Load Expectation (LOLE) is the probability of disconnecting non-interruptible customers due to a resource deficiency.

Lost Opportunity Cost (LOC) is one of four forms of compensation that may be paid to resources providing VAR Service under Schedule 2 of the OATT.

LSE means load serving entity.

Lump Sum Blackstart Payment is defined and calculated as specified in Section 5.4 of Schedule 16 to the OATT.

Lump Sum Blackstart Capital Payment is defined and calculated as specified in Section 5.4 of Schedule 16 to the OATT.

Lump Sum Blackstart CIP Capital Payment is defined and calculated as specified in Section 5.4 of Schedule 16 to the OATT.

Major Transmission Outage is a major transmission outage scheduled in accordance with ISO New England Operating Procedure No. 3.

Manual Response Rate is the rate, in MW/Minute, at which the output of a Generator Asset is capable of changing.

Marginal Loss Revenue Load Obligation is defined in Section III.3.2.1(b)(v) of Market Rule 1.

Market Credit Limit is a credit limit for a Market Participant's Financial Assurance Obligations (except FTR Financial Assurance Requirements) established for each Market Participant in accordance with Section II.C of the ISO New England Financial Assurance Policy.

Market Credit Test Percentage is calculated in accordance with Section III.B.1(a) of the ISO New England Financial Assurance Policy.

Market Efficiency Transmission Upgrade is defined as those additions and upgrades that are not related to the interconnection of a generator, and, in the ISO's determination, are designed to reduce bulk power system costs to load system-wide, where the net present value of the reduction in bulk power system costs to load system-wide exceeds the net present value of the cost of the transmission addition or upgrade. For purposes of this definition, the term "bulk power system costs to load system-wide" includes, but is not limited to, the costs of energy, capacity, reserves, losses and impacts on bilateral prices for electricity.

Market Participant is a participant in the New England Markets (including a FTR-Only Customer) that has executed a Market Participant Service Agreement, or on whose behalf an unexecuted Market Participant Service Agreement has been filed with the Commission.

Market Participant Financial Assurance Requirement is defined in Section III of the ISO New England Financial Assurance Policy.

Market Participant Obligations is defined in Section III.B.1.1 of Appendix B of Market Rule 1.

Market Participant Service Agreement (MPSA) is an agreement between the ISO and a Market Participant, in the form specified in Attachment A or Attachment A-1 to the Tariff, as applicable.

Market Rule 1 is ISO Market Rule 1 and appendices set forth in Section III of this ISO New England Inc. Transmission, Markets and Services Tariff, as it may be amended from time to time.

Market Violation is a tariff violation, violation of a Commission-approved order, rule or regulation, market manipulation, or inappropriate dispatch that creates substantial concerns regarding unnecessary market inefficiencies.

Material Adverse Change is any change in financial status including, but not limited to a downgrade to below an Investment Grade Rating by any Rating Agency, being placed on credit watch with negative implication by any Rating Agency if the Market Participant or Non-Market Participant Transmission Customer does not have an Investment Grade Rating, a bankruptcy filing or other insolvency, a report of a significant quarterly loss or decline of earnings, the resignation of key officer(s), the sanctioning of the Market Participant or Non-Market Participant Transmission Customer or any of its Principles imposed by the Federal Energy Regulatory Commission, the Securities Exchange Commission, any exchange monitored by the National Futures Association, or any state entity responsible for regulating activity in energy markets; the filing of a material lawsuit that could materially adversely impact current or future financial results; a significant change in the Market Participant's or Non-Market Participant Transmission Customer's credit default spreads; or a significant change in market capitalization.

Material Adverse Impact is defined, for purposes of review of ITC-proposed plans, as a proposed facility or project will be deemed to cause a "material adverse impact" on facilities outside of the ITC System if: (i) the proposed facility or project causes non-ITC facilities to exceed their capabilities or exceed their thermal, voltage or stability limits, consistent with all applicable reliability criteria, or (ii) the proposed facility or project would not satisfy the standards set forth in Section I.3.9 of the Transmission, Markets and Services Tariff. This standard is intended to assure the continued service of all non-ITC firm load customers and the ability of the non-ITC systems to meet outstanding transmission service obligations.

Maximum Capacity Limit is the maximum amount of capacity that can be procured in an export-constrained Load Zone, calculated as described in Section III.12.2 of Market Rule 1, to meet the Installed Capacity Requirement.

Maximum Consumption Limit is the maximum amount, in MW, available from the Dispatchable Asset Related Demand for economic dispatch and is based on the physical characteristics as submitted as part of a Resource's Offer Data except that a Self-Scheduled Dispatchable Asset Related Demand may modify its Minimum Consumption Limit on an hourly basis, as part of its Demand Bid, in order to indicate the desired level of Self-Scheduled MW.

Maximum Facility Load is the most recent annual non-coincident peak demand or, if unavailable, an estimate of the annual non-coincident peak demand of a Real-Time Demand Response Asset or a Real-Time Emergency Generation Asset, where the demand evaluated is established by adding actual metered demand and the output of all generators located behind the asset's end-use customer meter in the same time intervals.

Maximum Generation is the maximum generation output of a Real-Time Demand Response Asset comprised of Distributed Generation or the maximum generation output of a Demand Response Asset comprised of Distributed Generation.

Maximum Interruptible Capacity is an estimate of the maximum hourly demand reduction amount that a Real-Time Demand Response Asset, Real-Time Emergency Generation Asset or a Demand Response Asset can deliver. For assets that deliver demand reduction, the Maximum Interruptible Capacity is the asset's peak load less its uninterruptible load. For assets that deliver reductions through the use of generation, the Maximum Interruptible Capacity is the difference between the generator's maximum possible output and its expected output when not providing demand reduction.

Maximum Load is the most recent annual non-coincident peak demand or, if unavailable, an estimate of the annual non-coincident peak demand, of a Demand Response Asset, Real-Time Demand Response Asset or Real-Time Emergency Generation Asset.

Maximum Net Supply is an estimate of the maximum hourly Net Supply for a Demand Response Asset as measured from the Demand Response Asset's Retail Delivery Point.

Maximum Reduction is the maximum available demand reduction, in MW, of a Demand Response Resource that a Market Participant offers to deliver in the Day-Ahead Energy Market or Real-Time Energy Market, as reflected in the Demand Response Resource's Demand Reduction Offer.

Measure Life is the estimated time a Demand Resource measure will remain in place, or the estimated time period over which the facility, structure, equipment or system in which a measure is installed continues to exist, whichever is shorter. Suppliers of Demand Resources comprised of an aggregation of measures with varied Measures Lives shall determine and document the Measure Life either: (i) for each type of measure with a different Measure Life and adjust the aggregate performance based on the individual measure life calculation in the portfolio; or (ii) as the average Measure Life for the aggregated measures as long as the Demand Reduction Value of the Demand Resource is greater than or equal to the amount that cleared in the Forward Capacity Auction or reconfiguration auction for the entire Capacity Commitment Period, and the Demand Reduction Value for an Existing Demand Resource is not over-stated in a subsequent Capacity Commitment Period. Measure Life shall be determined consistent with the Demand Resource's Measurement and Verification Plan, which shall be reviewed by the ISO to ensure consistency with the measurement and verification requirements of Market Rule 1 and the ISO New England Manuals.

Measurement and Verification Documents mean the measurement and verification documents described in Section 13.1.4.3.1 of Market Rule 1, which includes Measurement and Verification Plans, Updated Measurement and Verification Plans, Measurement and Verification Summary Reports, and Measurement and Verification Reference Reports.

Measurement and Verification Plan means the measurement and verification plan submitted by a Demand Resource supplier as part of the qualification process for the Forward Capacity Auction pursuant to the requirements of Section III.13.1.4.3 of Market Rule 1 and the ISO New England Manuals.

Measurement and Verification Reference Reports are optional reports submitted by Demand Resource suppliers during the Capacity Commitment Period subject to the schedule in the Measurement and Verification Plan and consistent with the schedule and reporting standards set

forth in the ISO New England Manuals. Measurement and Verification Reference Reports update the prospective Demand Reduction Value of the Demand Resource project based on measurement and verification studies performed during the Capacity Commitment Period.

Measurement and Verification Summary Report is the monthly report submitted by a Demand Resource supplier with the monthly settlement report for the Forward Capacity Market, which documents the total Demand Reduction Values for all Demand Resources in operation as of the end of the previous month.

MEPCO Grandfathered Transmission Service Agreement (MG TSA) is a MEPCO long-term firm point-to-point transmission service agreement with a POR or POD at the New Brunswick border and a start date prior to June 1, 2007 where the holder has elected, by written notice delivered to MEPCO within five (5) days following the filing of the settlement agreement in Docket Nos. ER07-1289 and EL08-56 or by September 1, 2008 (whichever is later), MG TSA treatment as further described in Section II.45.1.

Merchant Transmission Facilities (MTF) are the transmission facilities owned by MTOs, defined and classified as MTF pursuant to Schedule 18 of the OATT, over which the ISO shall exercise Operating Authority in accordance with the terms set forth in a MTOA or Attachment K to the OATT, rated 69 kV or above and required to allow energy from significant power sources to move freely on the New England Transmission System.

Merchant Transmission Facilities Provider (MTF Provider) is an entity as defined in Schedule 18 of the OATT.

Merchant Transmission Facilities Service (MTF Service) is transmission service over MTF as provided for in Schedule 18 of the OATT.

Merchant Transmission Operating Agreement (MTOA) is an agreement between the ISO and an MTO with respect to its MTF.

Merchant Transmission Owner (MTO) is an owner of MTF.

Meter Data Error means an error in meter data, including an error in Coincident Peak

Contribution values, on an Invoice issued by the ISO after the completion of the data reconciliation process as described in the ISO New England Manuals and in Section III.3.8 of Market Rule 1.

Meter Data Error RBA Submission Limit means the date thirty 30 calendar days after the issuance of the Invoice containing the results of the data reconciliation process as described in the ISO New England Manuals and in Section III.3.6 of Market Rule 1.

Minimum Consumption Limit is the minimum amount, in MW, available from a Dispatchable Asset Related Demand that is not available for economic dispatch and is based on the physical characteristics as submitted as part of a Resource's Offer Data.

Minimum Generation Emergency means an Emergency declared by the ISO in which the ISO anticipates requesting one or more generating Resources to operate at or below Economic Minimum Limit, in order to manage, alleviate, or end the Emergency.

Minimum Generation Emergency Charge means the charge used to allocate the cost of Minimum Generation Emergency Credits. Minimum Generation Emergency Charges are discussed in Appendix F of Market Rule 1.

Minimum Generation Emergency Credits are credits calculated pursuant to Appendix F of Market Rule 1 to compensate certain generating Resources for operation in excess of their Economic Minimum Limits during a Minimum Generation Emergency.

Minimum Reduction is the minimum available demand reduction, in MW, of a Demand Response Resource that a Market Participant offers to deliver in the Day-Ahead Energy Market or Real-Time Energy Market, as reflected in the Demand Response Resource's Demand Reduction Offer.

Minimum Reduction Time is the minimum number of hours of demand reduction at or above the Minimum Reduction for which the ISO must dispatch a Demand Response Resource to reduce demand.

Minimum Time Between Reductions is the minimum number of hours that a Market Participant

requires between the time the Demand Response Resource receives a Dispatch Instruction from the ISO to not reduce demand and the time the Demand Response Resource receives a Dispatch Instruction from the ISO to reduce demand.

Monthly Blackstart Service Charge is the charge made to Transmission Customers pursuant to Section 6 of Schedule 16 to the OATT.

Monthly Capacity Variance means a Demand Resource's actual monthly Capacity Value established pursuant to Section III.13.7.1.5.1 of Market Rule 1, minus the Demand Resource's final Capacity Supply Obligation for the month.

Monthly Peak is defined in Section II.21.2 of the OATT.

Monthly PER is calculated in accordance with Section III.13.7.2.7.1.1.2(a) of Market Rule 1.

Monthly Real-Time Generation Obligation is the sum, for all hours in a month, at all Locations, of a Customer's Real-Time Generation Obligation, in MWhs.

Monthly Real-Time Load Obligation is the absolute value of a Customer's hourly Real-Time Load Obligation summed for all hours in a month, in MWhs.

Monthly Regional Network Load is defined in Section II.21.2 of the OATT.

Monthly Statement is the first weekly Statement issued on a Monday after the tenth of a calendar month that includes both the Hourly Charges for the relevant billing period and Non-Hourly Charges for the immediately preceding calendar month.

MUI is the market user interface.

Municipal Market Participant is defined in Section II of the ISO New England Financial Assurance Policy.

MW is megawatt.

MWh is megawatt-hour.

Native Load Customers are the wholesale and retail power customers of a Transmission Owner on whose behalf the Transmission Owner, by statute, franchise, regulatory requirement, or contract, has undertaken an obligation to construct and operate its system to meet the reliable electric needs of such customers.

NCPC Charge means the charges to Market Participants as provided in Section III.3.2.3, Section III.6.4 and Appendix F.

NCPC Credit means the payment made to a Resource as provided in Section III.3.2.3, Section III.6.4 and Appendix F.

Needs Assessment is defined in Section 4.1 of Attachment K to the OATT.

NEMA, for purposes of Section III of the Tariff, is the Northeast Massachusetts Reliability Region.

NEMA Contract is a contract described in Appendix C of Market Rule 1 and listed in Exhibit 1 of Appendix C of Market Rule 1.

NEMA Load Serving Entity (NEMA LSE) is a Transmission Customer or Congestion Paying LSE Entity that serves load within NEMA.

NEMA or Northeast Massachusetts Upgrade, for purposes of Section II of the Tariff, is an addition to or modification of the PTF into or within the Northeast Massachusetts Reliability Region that was not, as of December 31, 1999, the subject of a System Impact Study or application filed pursuant to Section I.3.9 of the Transmission, Markets and Services Tariff; that is not related to generation interconnections; and that will be completed and placed in service by June 30, 2004. Such upgrades include, but are not limited to, new transmission facilities and related equipment and/or modifications to existing transmission facilities and related equipment. The list of NEMA Upgrades is contained in Schedule 12A of the OATT.

NEPOOL is the New England Power Pool, and the entities that collectively participated in the

New England Power Pool.

NEPOOL Agreement is the agreement among the participants in NEPOOL.

NEPOOL GIS is the generation information system.

NEPOOL GIS Administrator is the entity or entities that develop, administer, operate and maintain the NEPOOL GIS.

NERC is the North American Electric Reliability Corporation or its successor organization.

Net Commitment Period Compensation (NCPC) is the compensation methodology for Resources that is described in Appendix F to Market Rule 1.

Net CONE is an estimate of the Cost of New Entry, net of the first-year non-capacity market revenues, for a reference technology resource type and is intended to equal the amount of capacity revenue the reference technology resource would require, in its first year of operation, to be economically viable given reasonable expectations of the first year energy and ancillary services revenues, and projected revenue for subsequent years.

Net Regional Clearing Price is described in Section III.13.7.3 of Market Rule 1.

Net Supply is energy injected at the Retail Delivery Point by a Demand Response Asset with Distributed Generation.

Net Supply Generator Asset is the Generator Asset registered in the energy market at the same Retail Delivery Point as a Demand Response Asset with Distributed Generation capable of delivering Net Supply.

Network Capability Interconnection Standard has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Network Customer is a Transmission Customer receiving RNS or LNS.

Network Resource is defined as follows: (1) With respect to Market Participants, (a) any generating resource located in the New England Control Area which has been placed in service prior to the Compliance Effective Date (including a unit that has lost its capacity value when its capacity value is restored and a deactivated unit which may be reactivated without satisfying the requirements of Section II.46 of the OATT in accordance with the provisions thereof) until retired; (b) any generating resource located in the New England Control Area which is placed in service after the Compliance Effective Date until retired, provided that (i) the Generator Owner has complied with the requirements of Sections II.46 and II.47 and Schedules 22 and 23 of the OATT, and (ii) the output of the unit shall be limited in accordance with Sections II.46 and II.47 and Schedules 22 and 23, if required; and (c) any generating resource or combination of resources (including bilateral purchases) located outside the New England Control Area for so long as any Market Participant has an Ownership Share in the resource or resources which is being delivered to it in the New England Control Area to serve Regional Network Load located in the New England Control Area or other designated Regional Network Loads contemplated by Section II.18.3 of the OATT taking Regional Network Service. (2) With respect to Non-Market Participant Transmission Customers, any generating resource owned, purchased or leased by the Non-Market Participant Transmission Customer which it designates to serve Regional Network Load.

New Brunswick Security Energy is defined in Section III.3.2.6A of Market Rule 1.

New Capacity Offer is an offer in the Forward Capacity Auction to provide capacity from a New Generating Capacity Resource, New Import Capacity Resource, or New Demand Resource, as described in Section III.13.2.3.2 of Market Rule 1.

New Capacity Qualification Deadline is a deadline, specified in Section III.13.1.10 of Market Rule 1, for submission of certain qualification materials for the Forward Capacity Auction, as discussed in Section III.13.1 of Market Rule 1.

New Capacity Qualification Package is information submitted by certain new resources prior to participation in the Forward Capacity Auction, as described in Section III.13.1 of Market Rule 1.

New Capacity Required is the amount of additional capacity required to meet the Installed

Capacity Requirement or a Capacity Zone's Local Sourcing Requirement, as described in Section III.13.2.8.1.1 of Market Rule 1.

New Capacity Resource is a resource (i) that never previously received any payment as a capacity resource including any capacity payment pursuant to the market rules in effect prior to June 1, 2010 and that has not cleared in any previous Forward Capacity Auction; or (ii) that is otherwise eligible to participate in the Forward Capacity Auction as a New Capacity Resource.

New Capacity Show of Interest Form is described in Section III.13.1.1.2.1 of Market Rule 1.

New Capacity Show of Interest Submission Window is the period of time during which a Project Sponsor may submit a New Capacity Show of Interest Form or a New Demand Resource Show of Interest Form, as described in Section III.13.1.10 of Market Rule 1.

New Demand Resource is a type of Demand Resource participating in the Forward Capacity Market, as defined in Section III.13.1.4.1.2 of Market Rule 1.

New Demand Resource Qualification Package is the information that a Project Sponsor must submit, in accordance with Section III 13.1.4.2.3 of Market Rule 1, for each resource that it seeks to offer in the Forward Capacity Auction as a New Demand Resource.

New Demand Resource Show of Interest Form is described in Section III.13.1.4.2 of Market Rule 1.

New Demand Response Asset is a Real-Time Demand Response Asset, Real-Time Emergency Generation Asset or Demand Response Asset that is registered with the ISO, has been mapped to a resource, is ready to respond, and has been included in the dispatch model of the remote terminal unit but does not have a winter audit value and a summer audit value.

New Demand Response Asset Audit is an audit of a New Demand Response Asset performed pursuant to Section III.13.6.1.5.4.8.

New England Control Area is the Control Area for New England, which includes PTF, Non-PTF, MTF and OTF. The New England Control Area covers Connecticut, Rhode Island,

Massachusetts, New Hampshire, Vermont, and part of Maine (i.e., excluding the portions of Northern Maine and the northern portion of Eastern Maine which are in the Maritimes Control Area).

New England Markets are markets or programs for the purchase of energy, capacity, ancillary services, demand response services or other related products or services (including Financial Transmission Rights) that are delivered through or useful to the operation of the New England Transmission System and that are administered by the ISO pursuant to rules, rates, or agreements on file from time to time with the Federal Energy Regulatory Commission.

New England System Restoration Plan is the plan that is developed by ISO, in accordance with NERC Reliability Standards, NPCC regional criteria and standards, ISO New England Operating Documents and ISO operating agreements, to facilitate the restoration of the New England Transmission System following a partial or complete shutdown of the New England Transmission System.

New England Transmission System is the system of transmission facilities, including PTF, Non-PTF, OTF and MTF, within the New England Control Area under the ISO's operational jurisdiction.

New Generating Capacity Resource is a type of resource participating in the Forward Capacity Market, as described in Section III.13.1.1.1 of Market Rule 1.

New Import Capacity Resource is a type of resource participating in the Forward Capacity Market, as defined in Section III.13.1.3.4 of Market Rule 1.

NMPTC means Non-Market Participant Transmission Customer.

NMPTC Credit Threshold is described in Section V.A.2 of the ISO New England Financial Assurance Policy.

NMPTC Financial Assurance Requirement is an amount of additional financial assurance for Non-Market Participant Transmission Customers described in Section V.D of the ISO New England Financial Assurance Policy.

Nodal Amount is node(s)-specific on-peak and off-peak proxy value to which an FTR bid or awarded FTR bid relates.

Node is a point on the New England Transmission System at which LMPs are calculated.

No-Load Fee is the amount, in dollars per hour, for a generating unit that must be paid to Market Participants with an Ownership Share in the unit for being scheduled in the New England Markets, in addition to the Start-Up Fee and price offered to supply energy, for each hour that the generating unit is scheduled in the New England Markets.

Nominated Consumption Limit is the consumption level specified by the Market Participant for a Dispatchable Asset Related Demand as adjusted in accordance with the provisions of Section III.13.7.3.1.3.

Non-Commercial Capacity is the capacity of a New Capacity Resource or an increment of an Existing Capacity Resource that is treated as a New Capacity Resource in the Forward Capacity Auction and that has not been declared commercial and has not had its capacity rating verified by the ISO.

Non-Commercial Capacity Cure Period is the time period described in Section VII.D of the ISO New England Financial Assurance Policy.

Non-Commercial Capacity Financial Assurance Amount (Non-Commercial Capacity FA Amount) is the financial assurance amount held on Non-Commercial Capacity cleared in a Forward Capacity Auction as calculated in accordance with Section VII.B.2 of the ISO New England Financial Assurance Policy.

Non-Designated Blackstart Resource Study Cost Payments are the study costs reimbursed under Section 5.3 of Schedule 16 of the OATT.

Non-Hourly Charges are defined in Section 1.3 of the ISO New England Billing Policy.

Non-Hourly Requirements are determined in accordance with Section III.A(ii) of the ISO New

England Financial Assurance Policy, which is Exhibit 1A of Section I of the Tariff.

Non-Intermittent Settlement Only Resource is a Settlement Only Resource that is not an Intermittent Power Resource.

Non-Market Participant is any entity that is not a Market Participant.

Non-Market Participant Transmission Customer is any entity which is not a Market Participant but is a Transmission Customer.

Non-Municipal Market Participant is defined in Section II of the ISO New England Financial Assurance Policy.

Non-Price Retirement Request is a binding request to retire the entire capacity of a Generating Capacity Resource as described in Section III.13.1.2.3.1.5.

Non-PTF Transmission Facilities (Non-PTF) are the transmission facilities owned by the PTOs that do not constitute PTF, OTF or MTF.

Non-Qualifying means a Market Participant that is not a Credit Qualifying Market Participant.

Notice of RBA is defined in Section 6.3.2 of the ISO New England Billing Policy.

Notification Time is the time required for a Generator Asset to synchronize to the system from the time a startup Dispatch Instruction is received from the ISO.

Northeastern Planning Protocol is the Amended and Restated Northeastern ISO/RTO Planning Coordination Protocol on file with the Commission.

NPCC is the Northeast Power Coordinating Council.

Obligation Month means a time period of one calendar month for which capacity payments are

issued and the costs associated with capacity payments are allocated.

Offer Data means the scheduling, operations planning, dispatch, new Resource, and other data, including generating unit and Dispatchable Asset Related Demand, and for Capacity Commitment Periods commencing on or after June 1, 2017, Demand Response Resource operating limits based on physical characteristics, and information necessary to schedule and dispatch generating and Dispatchable Asset Related Demand Resources, and for Capacity Commitment Periods commencing on or after June 1, 2017. Demand Response Resources for the provision of energy and other services and the maintenance of the reliability and security of the transmission system in the New England Control Area, and specified for submission to the New England Markets for such purposes by the ISO.

Offered CLAIM10 is a Supply Offer value between 0 and the CLAIM10 of a Resource that represents the amount of TMNSR available from the Resource.

Offered CLAIM30 is a Supply Offer value between 0 and the CLAIM30 of a Resource that represents the amount of offline TMOR available from the Resource.

Offered Full Reduction Time is the value calculated pursuant to Section III.13.6.1.5.4.6.

On-Peak Demand Resource is a type of Demand Resource and means installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that reduce the total amount of electrical energy consumed during Demand Resource On-Peak Hours, while delivering a comparable or acceptable level of end-use service. Such measures include Energy Efficiency, Load Management, and Distributed Generation.

Open Access Same-Time Information System (OASIS) is the ISO information system and standards of conduct responding to requirements of 18 C.F.R. §37 of the Commission's regulations and all additional requirements implemented by subsequent Commission orders dealing with OASIS.

Open Access Transmission Tariff (OATT) is Section II of the ISO New England Inc. Transmission, Markets and Services Tariff.

Operating Authority is defined pursuant to a MTOA, an OTOA, the TOA or the OATT, as applicable.

Operating Data means GADS Data, data equivalent to GADS Data, CARL Data, metered load data, or actual system failure occurrences data, all as described in the ISO New England Operating Procedures.

Operating Day means the calendar day period beginning at midnight for which transactions on the New England Markets are scheduled.

Operating Reserve means Ten-Minute Spinning Reserve (TMSR), Ten-Minute Non-Spinning Reserve (TMNSR) and Thirty-Minute Operating Reserve (TMOR).

Operations Date is February 1, 2005.

OTF Service is transmission service over OTF as provided for in Schedule 20.

Other Transmission Facility (OTF) are the transmission facilities owned by Transmission Owners, defined and classified as OTF pursuant to Schedule 20, over which the ISO shall exercise Operating Authority in accordance with the terms set forth in the OTOA, rated 69 kV or above, and required to allow energy from significant power sources to move freely on the New England Transmission System. OTF classification shall be limited to the Phase I/II HVDC-TF.

Other Transmission Operating Agreements (OTOA) is the agreement(s) between the ISO, an OTO and/or the associated service provider(s) with respect to an OTF, which includes the HVDC Transmission Operating Agreement and the Phase I/II HVDC-TF Transmission Service Administration Agreement. With respect to the Phase I/II HVDC-TF, the HVDC Transmission Operating Agreement covers the rights and responsibilities for the operation of the facility and the Phase I/II HVDC-TF Transmission Service Administration Agreement covers the rights and responsibilities for the administration of transmission service.

Other Transmission Owner (OTO) is an owner of OTF.

Ownership Share is a right or obligation, for purposes of settlement, to a percentage share of all

credits or charges associated with a generating unit asset or Load Asset, where such unit or load is interconnected to the New England Transmission System.

Participant Expenses are defined in Section 1 of the Participants Agreement.

Participant Required Balance is defined in Section 5.3 of the ISO New England Billing Policy.

Participant Vote is defined in Section 1 of the Participants Agreement.

Participants Agreement is the agreement among the ISO, the New England Power Pool and Individual Participants, as amended from time to time, on file with the Commission.

Participants Committee is the principal committee referred to in the Participants Agreement.

Participating Transmission Owner (PTO) is a transmission owner that is a party to the TOA.

Payment is a sum of money due to a Covered Entity from the ISO.

Payment Default Shortfall Fund is defined in Section 5.1 of the ISO New England Billing Policy.

Peak Energy Rent (PER) is described in Section III.13.7.2.7.1 of Market Rule 1.

PER Proxy Unit is described in Section III.13.7.2.7.1 of Market Rule 1.

Percent of Total Demand Reduction Value Complete means the delivery schedule as a percentage of a Demand Resource's total Demand Reduction Value that will be or has been achieved as of specific target dates, as described in Section III.13 of Market Rule 1.

Permanent De-list Bid is a bid that may be submitted by an Existing Generating Capacity Resource, Existing Import Capacity Resource, or Existing Demand Resource in the Forward Capacity Auction to permanently remove itself from the capacity market, as described in Section III.13.1.2.3.1.2 of Market Rule 1.

Phase I Transfer Credit is 40% of the HQICC, or such other fraction of the HQICC as the ISO may establish.

Phase I/II HVDC-TF is defined in Schedule 20A to Section II of this Tariff.

Phase I/II HVDC-TF Transfer Capability is the transfer capacity of the Phase I/II HVDC-TF under normal operating conditions, as determined in accordance with Good Utility Practice. The “Phase I Transfer Capability” is the transfer capacity under normal operating conditions, as determined in accordance with Good Utility Practice, of the Phase I terminal facilities as determined initially as of the time immediately prior to Phase II of the Phase I/II HVDC-TF first being placed in service, and as adjusted thereafter only to take into account changes in the transfer capacity which are independent of any effect of Phase II on the operation of Phase I. The “Phase II Transfer Capability” is the difference between the Phase I/II HVDC-TF Transfer Capability and the Phase I Transfer Capability. Determinations of, and any adjustment in, Phase I/II HVDC-TF Transfer Capability shall be made by the ISO, and the basis for any such adjustment shall be explained in writing and posted on the ISO website.

Phase II Transfer Credit is 60% of the HQICC, or such other fraction of the HQICC as the ISO may establish.

Planning Advisory Committee is the committee described in Attachment K of the OATT.

Planning and Reliability Criteria is defined in Section 3.3 of Attachment K to the OATT.

Planning Authority is an entity defined as such by the North American Electric Reliability Corporation.

Point(s) of Delivery (POD) is point(s) of interconnection where capacity and/or energy transmitted by a Transmission Customer will be made available to the Receiving Party under the OATT.

Point(s) of Receipt (POR) is point(s) of interconnection where capacity and/or energy transmitted by a Transmission Customer will be made available by the Delivering Party under the OATT.

Point-To-Point Service is the transmission of capacity and/or energy on either a firm or non-firm basis from the Point(s) of Receipt to the Point(s) of Delivery under the OATT pursuant to Local Point-To-Point Service or OTF Service or MTF Service; and the transmission of capacity and/or energy from the Point(s) of Receipt to the Point(s) of Delivery under the OATT pursuant to Through or Out Service.

Pool-Planned Unit is one of the following units: New Haven Harbor Unit 1 (Coke Works), Mystic Unit 7, Canal Unit 2, Potter Unit 2, Wyman Unit 4, Stony Brook Units 1, 1A, 1B, 1C, 2A and 2B, Millstone Unit 3, Seabrook Unit 1 and Waters River Unit 2 (to the extent of 7 megawatts of its Summer capability and 12 megawatts of its Winter capability).

Pool PTF Rate is the transmission rate determined in accordance with Schedule 8 to the OATT.

Pool RNS Rate is the transmission rate determined in accordance with paragraph (2) of Schedule 9 of Section II of the Tariff.

Pool-Scheduled Resources are described in Section III.1.10.2 of Market Rule 1.

Pool Supported PTF is defined as: (i) PTF first placed in service prior to January 1, 2000; (ii) Generator Interconnection Related Upgrades with respect to Category A and B projects (as defined in Schedule 11), but only to the extent not paid for by the interconnecting Generator Owner; and (iii) other PTF upgrades, but only to the extent the costs therefore are determined to be Pool Supported PTF in accordance with Schedule 12.

Pool Transmission Facility (PTF) means the transmission facilities owned by PTOs which meet the criteria specified in Section II.49 of the OATT.

Poorly Performing Resource is described in Section III.13.7.1.1.5 of Market Rule 1.

Posting Entity is any Market Participant or Non-Market Participant Transmission Customer providing financial security under the provisions of the ISO New England Financial Assurance Policy.

Posture means an action of the ISO to deviate from the jointly optimized security constrained economic dispatch for Energy and Operating Reserves solution for a Resource produced by the ISO's technical software for the purpose of maintaining sufficient Operating Reserve (both online and off-line) or for the provision of voltage or VAR support.

Posturing Credit is calculated pursuant to Section III.F.2.6.2 of Appendix F to Market Rule 1.

Power Purchaser is the entity that is purchasing the capacity and/or energy to be transmitted under the OATT.

Principal is (i) the sole proprietor of a sole proprietorship; (ii) a general partner of a partnership; (iii) a president, chief executive officer, chief operating officer or chief financial officer (or equivalent position) of an organization; (iv) a manager, managing member or a member vested with the management authority for a limited liability company or limited liability partnership; (v) any person or entity that has the power to exercise a controlling influence over an organization's activities that are subject to regulation by the Federal Energy Regulatory Commission, the Securities and Exchange Commission, the Commodity Futures Trading Commission, any exchange monitored by the National Futures Association, or any state entity responsible for regulating activity in energy markets; or (vi) any person or entity that: (a) is the direct owner of 10% or more of any class of an organization's equity securities; or (b) has directly contributed 10% or more of an organization's capital.

Profiled Load Assets include all Load Assets that are not directly metered by OP-18 compliant metering as currently described in Section IV (Metering and Recording for Settlements) of OP18, and some Load Assets that are measured by OP-18 compliant metering (as currently described in Section IV of OP-18) to which the Host Participant Assigned Meter Reader allocates non-PTF losses.

Project Sponsor is an entity seeking to have a New Generating Capacity Resource or New Demand Resource participate in the Forward Capacity Market, as described in Section III.13.

Provisional Member is defined in Section I.68A of the Restated NEPOOL Agreement.

PTO Administrative Committee is the committee referred to in Section 11.04 of the TOA.

Publicly Owned Entity is defined in Section I of the Restated NEPOOL Agreement.

Qualification Process Cost Reimbursement Deposit is described in Section III.13.1.9.3 of Market Rule 1.

Qualified Capacity is the amount of capacity a resource may provide in the summer or winter in a Capacity Commitment Period, as determined in the Forward Capacity Market qualification processes.

Qualified Generator Reactive Resource(s) is any generator source of dynamic reactive power that meets the criteria specified in Schedule 2 of the OATT.

Qualified Non-Generator Reactive Resource(s) is any non-generator source of dynamic reactive power that meets the criteria specified in Schedule 2 of the OATT.

Qualified Reactive Resource(s) is any Qualified Generator Reactive Resource and/or Qualified Non-Generator Reactive Resource that meets the criteria specified in Schedule 2 of the OATT.

Queue Position has the meaning specified in Section I of Schedule 22 and Attachment 1 to Schedule 23 of the OATT.

Rated means a Market Participant that receives a credit rating from one or more of the Rating Agencies, or, if such Market Participant is not rated by one of the Rating Agencies, then a Market Participant that has outstanding unsecured debt rated by one or more of the Rating Agencies.

Rating Agencies are Standard and Poor's (S&P), Moody's, and Fitch.

RBA Decision is a written decision provided by the ISO to a Disputing Party and to the Chair of the NEPOOL Budget and Finance Subcommittee accepting or denying a Requested Billing Adjustment within twenty Business Days of the date the ISO distributes a Notice of RBA, unless some later date is agreed upon by the Disputing Party and the ISO.

Reactive Supply and Voltage Control Service is the form of Ancillary Service described in

Schedule 2 of the OATT.

Real-Time is a period in the current Operating Day for which the ISO dispatches Resources for energy and Regulation, designates Resources for Regulation and Operating Reserve and, if necessary, commits additional Resources.

Real-Time Adjusted Load Obligation is defined in Section III.3.2.1(b)(iii) of Market Rule 1.

Real-Time Adjusted Load Obligation Deviation is defined in Section III.3.2.1(c)(iii) of Market Rule 1.

Real-Time Commitment Periods are periods of continuous operation bounded by a start up and the earlier to occur of a shut-down or a unit trip used to determine eligibility for Real Time NCPC Credit.

Real-Time Congestion Revenue is defined in Section III.3.2.1(f) of Market Rule 1.

Real-Time Demand Reduction Obligation is a Real-Time demand reduction amount determined pursuant to Section III.E1.8 for Capacity Commitment Periods commencing prior to June 1, 2017, and Section III.E2.7 for Capacity Commitment Periods commencing on or after June 1, 2017.

Real-Time Demand Resource Dispatch Hours means those hours, or portions thereof, in which ISO New England Operating Procedure No. 4 is implemented and the ISO has begun to allow the depletion of Thirty-Minute Operating Reserve on a Dispatch Zone, Load Zone, or system-wide basis, and the ISO notifies the Market Participants with Real-Time Demand Response Resources of such hours.

Real-Time Demand Response Asset means one or more individual end-use metered customers that are located at a single Node, report load reduction and consumption, or generator output as a single set of values, are assigned a unique asset identification number by the ISO, and that participate in the Forward Capacity Market as part of a Market Participant's Real-Time Demand Response Resource.

Real-Time Demand Response Event Hours means hours when the ISO dispatches Real-Time Demand Response Resources in response to Real-Time Demand Resource Dispatch Hours, which may include Dispatch Zone, Load Zone, or system-wide dispatch of such resources.

Real-Time Demand Response Resource is a type of Demand Resource that is comprised of installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that: (i) curtail electrical usage in response to a Dispatch Instruction; and (ii) continue curtailing electrical usage until receiving Dispatch Instructions to restore electrical usage. Such measures include Load Management and Distributed Generation. The period of curtailment shall be consistent with Real-Time Demand Response Event Hours.

Real-Time Emergency Generation Asset means one or more individual end-use metered customers that are located at a single Node, report load reduction and consumption, or generator output as a single set of values, are assigned a unique asset identification number by the ISO, and that participate in the Forward Capacity Market as part of a Market Participant's Real-Time Emergency Generation Resource.

Real-Time Emergency Generation Event Hours means those hours, or portions thereof, between 7 a.m. and 7 p.m. Monday through Friday, non-Demand Response Holidays in which the ISO dispatches Real-Time Emergency Generation Resources on a Dispatch Zone, Load Zone, or system-wide basis when deficient in Thirty-Minute Operating Reserve and when the ISO implements voltage reductions of five percent of normal operating voltage that require more than 10 minutes to implement.

Real-Time Emergency Generation Resource is Distributed Generation whose federal, state and/or local air quality permits, rules or regulations limit operation in response to requests from the ISO to the times when the ISO implements voltage reductions of five percent of normal operating voltage that require more than 10 minutes to implement. A Real-Time Emergency Generation Resource must be capable of: (i) curtailing its end-use electric consumption from the New England grid within 30 minutes of receiving a Dispatch Instruction; and (ii) continuing that curtailment until receiving a Dispatch Instruction to restore consumption.

Real-Time Energy Market means the purchase or sale of energy, purchase of demand reductions pursuant to Appendix III.E2 of Market Rule 1, payment of Congestion Costs, and

payment for losses for quantity deviations from the Day-Ahead Energy Market in the Operating Day and designation of and payment for provision of Operating Reserve in Real-Time.

Real-Time Energy Market Deviation Congestion Charge/Credit is defined in Section III.3.2.1(e) of Market Rule 1.

Real-Time Energy Market Deviation Energy Charge/Credit is defined in Section III.3.2.1(e) of Market Rule 1.

Real-Time Energy Market Deviation Loss Charge/Credit is defined in Section III.3.2.1(e) of Market Rule 1.

Real-Time Generation Obligation is defined in Section III.3.2.1(b)(ii) of Market Rule 1.

Real-Time Generation Obligation Deviation is defined in Section III.3.2.1(c)(ii) of Market Rule 1.

Real-Time High Operating Limit is the maximum output, in MW, of a resource that could be achieved, consistent with Good Utility Practice, in response to an ISO request for Energy under Section III.13.6.4 of Market Rule 1, for each hour of the Operating Day, as reflected in the resource's Offer Data. This value is based on real-time operating conditions and the physical operating characteristics and operating permits of the unit.

Real-Time Load Obligation is defined in Section III.3.2.1(b)(i) of Market Rule 1.

Real-Time Load Obligation Deviation is defined in Section III.3.2.1(c)(i) of Market Rule 1.

Real-Time Locational Adjusted Net Interchange is defined in Section III.3.2.1(b)(iv) of Market Rule 1.

Real-Time Locational Adjusted Net Interchange Deviation is defined in Section III.3.2.1(c)(iv) of Market Rule 1.

Real-Time Loss Revenue is defined in Section III.3.2.1(i) of Market Rule 1.

Real-Time Loss Revenue Charges or Credits are defined in Section III.3.2.1(m) of Market Rule 1.

Real-Time NCP Load Obligation is the maximum hourly value, during a month, of a Market Participant's Real-Time Load Obligation summed over all Locations, excluding exports, in kilowatts.

Real-Time Price Response Program is the program described in Appendix E to Market Rule 1.

Real-Time Prices means the Locational Marginal Prices resulting from the ISO's dispatch of the New England Markets in the Operating Day.

Real-Time Reserve Charge is a Market Participant's share of applicable system and Reserve Zone Real-Time Operating Reserve costs attributable to meeting the Real-Time Operating Reserve requirement as calculated in accordance with Section III.10 of Market Rule 1.

Real-Time Reserve Clearing Price is the Real-Time TMSR, TMNSR or TMOR clearing price, as applicable, for the system and each Reserve Zone that is calculated in accordance with Section III.2.4 of Market Rule 1.

Real-Time Reserve Credit is a Market Participant's compensation associated with that Market Participant's Resources' Real-Time Reserve Designation as calculated in accordance with Section III.10 of Market Rule 1.

Real-Time Reserve Designation is the amount, in MW, of Operating Reserve designated to a Resource in Real-Time by the ISO as adjusted after-the-fact utilizing revenue quality meter data as described under Section III.10 of Market Rule 1.

Real-Time Reserve Opportunity Cost is defined in Section III.2.7A(b) of Market Rule 1.

Real-Time System Adjusted Net Interchange means, for each hour, the sum of Real-Time Locational Adjusted Net Interchange for a Market Participant over all Locations, in kilowatts.

Receiving Party is the entity receiving the capacity and/or energy transmitted to Point(s) of

Delivery under the OATT.

Reference Level is defined in Section III.A.5.6.1 of Appendix A of Market Rule 1.

Regional Benefit Upgrade(s) (RBU) means a Transmission Upgrade that: (i) is rated 115kV or above; (ii) meets all of the non-voltage criteria for PTF classification specified in the OATT; and (iii) is included in the Regional System Plan as either a Reliability Transmission Upgrade or an Market Efficiency Transmission Upgrade identified as needed pursuant to Attachment K of the OATT. The category of RBU shall not include any Transmission Upgrade that has been categorized under any of the other categories specified in Schedule 12 of the OATT (e.g., an Elective Transmission Upgrade shall not also be categorized as an RBU). Any upgrades to transmission facilities rated below 115kV that were PTF prior to January 1, 2004 shall remain classified as PTF and be categorized as an RBU if, and for so long as, such upgrades meet the criteria for PTF specified in the OATT.

Regional Network Load is the load that a Network Customer designates for Regional Network Service under Part II.B of the OATT. The Network Customer's Regional Network Load shall include all load designated by the Network Customer (including losses) and shall not be credited or reduced for any behind-the-meter generation. A Network Customer may elect to designate less than its total load as Regional Network Load but may not designate only part of the load at a discrete Point of Delivery. Where a Transmission Customer has elected not to designate a particular load at discrete Points of Delivery as Regional Network Load, the Transmission Customer is responsible for making separate arrangements under Part II.C of the OATT for any Point-To-Point Service that may be necessary for such non-designated load.

Regional Network Service (RNS) is the transmission service over the PTF described in Part II.B of the OATT, including such service which is used with respect to Network Resources or Regional Network Load that is not physically interconnected with the PTF.

Regional Planning Dispute Resolution Process is described in Section 12 of Attachment K to the OATT.

Regional System Plan (RSP) is the plan developed under the process specified in Attachment K of the OATT.

Regional Transmission Service (RTS) is Regional Network Service and Through or Out Service as provided over the PTF in accordance with Section II.B, Section II.C, Schedule 8 and Schedule 9 of the OATT.

Regulation is the capability of a specific generating unit with appropriate telecommunications, control and response capability to increase or decrease its output in response to a regulating control signal, in accordance with the specifications in the ISO New England Manuals and ISO New England Administrative Procedures.

Regulation and Frequency Response Service is the form of Ancillary Service described in Schedule 3 of the OATT. The capability of performing Regulation and Frequency Response Service is referred to as automatic generation control (AGC).

Regulation Capability (REGCAP) means the amount of Regulation capability available on a Market Participant's Resource as calculated by the ISO based upon that Resource's Automatic Response Rate and the available regulating range as specified in ISO New England Manual 11 – Market Operations.

Regulation Clearing Price is defined in Section III.3.2.2(e) of Market Rule 1.

Regulation High Limit is the maximum amount of energy that a generating unit can reliably produce when that unit is providing Regulation. The Regulation High Limit may be less than or equal to the unit's Economic Maximum Limit.

Regulation Low Limit is the minimum amount of energy that a generating unit can reliably produce when that unit is providing Regulation. The Regulation Low Limit may be greater than or equal to the unit's Economic Minimum Limit.

Regulation Opportunity Cost is defined in Section III.3.2.2(i) of Market Rule 1.

Regulation Rank Price is calculated in accordance with Section III.1.11.5(b) of Market Rule 1.

Regulation Requirement is the hourly amount of Regulation MWs required by the ISO to

maintain system control and reliability as calculated and posted on the ISO website.

Regulation Service Credit is the credit associated with provision of Regulation Service Megawatts and is calculated in accordance with Section III.3.2.2(c) of Market Rule 1.

Regulation Service Megawatts are calculated in accordance with Section III.3.2.2(f) of Market Rule 1.

Related Person is defined pursuant to Section 1.1 of the Participants Agreement.

Related Transaction is defined in Section III.1.4.3 of Market Rule 1.

Reliability Administration Service (RAS) is the service provided by the ISO, as described in Schedule 3 of Section IV.A of the Tariff, in order to administer the Reliability Markets and provide other reliability-related and informational functions.

Reliability Committee is the committee whose responsibilities are specified in Section 8.2.3 of the Participants Agreement.

Reliability Markets are, collectively, the ISO's administration of Regulation, the Forward Capacity Market, and Operating Reserve.

Reliability Region means any one of the regions identified on the ISO's website. Reliability Regions are intended to reflect the operating characteristics of, and the major transmission constraints on, the New England Transmission System.

Reliability Transmission Upgrade means those additions and upgrades not required by the interconnection of a generator that are nonetheless necessary to ensure the continued reliability of the New England Transmission System, taking into account load growth and known resource changes, and include those upgrades necessary to provide acceptable stability response, short circuit capability and system voltage levels, and those facilities required to provide adequate thermal capability and local voltage levels that cannot otherwise be achieved with reasonable assumptions for certain amounts of generation being unavailable (due to maintenance or forced outages) for purposes of long-term planning studies. Good Utility Practice, applicable reliability

principles, guidelines, criteria, rules, procedures and standards of ERO and NPCC and any of their successors, applicable publicly available local reliability criteria, and the ISO System Rules, as they may be amended from time to time, will be used to define the system facilities required to maintain reliability in evaluating proposed Reliability Transmission Upgrades. A Reliability Transmission Upgrade may provide market efficiency benefits as well as reliability benefits to the New England Transmission System.

Remittance Advice is an issuance from the ISO for the net Payment owed to a Covered Entity where a Covered Entity's total Payments exceed its total Charges in a billing period.

Remittance Advice Date is the day on which the ISO issues a Remittance Advice.

Renewable Technology Resource is a Generating Capacity Resource that satisfies the requirements specified in Section III.13.1.1.1.7.

Re-Offer Period is the period that normally occurs between the posting of the of the Day-Ahead Energy Market results and 2:00 p.m. on the day before the Operating Day during which a Market Participant may submit revised Supply Offers, revised External Transactions, or revised Demand Bids associated with Dispatchable Asset Related Demands or, for Capacity Commitment Periods commencing on or after June 1, 2017, revised Demand Reduction Offers associated with Demand Response Resources.

Replacement Reserve is described in Part III, Section VII of ISO New England Operating Procedure No. 8.

Request for Alternative Proposals (RFAP) is the request described in Attachment K of the OATT.

Requested Billing Adjustment (RBA) is defined in Section 6.1 of the ISO New England Billing Policy.

Required Balance is an amount as defined in Section 5.3 of the Billing Policy.

Reseller is a MGTTSA holder that sells, assigns or transfers its rights under its MGTTSA, as

described in Section II.45.1(a) of the OATT.

Reserve Constraint Penalty Factors (RCPFs) are rates, in \$/MWh, that are used within the Real-Time dispatch and pricing algorithm to reflect the value of Operating Reserve shortages and are defined in Section III.2.7A(c) of Market Rule 1.

Reserve Zone is defined in Section III.2.7 of Market Rule 1.

Reserved Capacity is the maximum amount of capacity and energy that is committed to the Transmission Customer for transmission over the New England Transmission System between the Point(s) of Receipt and the Point(s) of Delivery under Part II.C or Schedule 18, 20 or 21 of the OATT, as applicable. Reserved Capacity shall be expressed in terms of whole kilowatts on a sixty-minute interval (commencing on the clock hour) basis, or, in the case of Reserved Capacity for Local Point-to-Point Service, in terms of whole megawatts on a sixty-minute interval basis.

Resource means a generating unit, a Dispatchable Asset Related Demand, an External Resource or an External Transaction or, for Capacity Commitment Periods commencing on or after June 1, 2017, a Demand Response Resource.

Restated New England Power Pool Agreement (RNA) is the Second Restated New England Power Pool Agreement, which restated for a second time by an amendment dated as of August 16, 2004 the New England Power Pool Agreement dated September 1, 1971, as the same may be amended and restated from time to time, governing the relationship among the NEPOOL members.

Rest-of-Pool Capacity Zone is a single Capacity Zone made up of the adjacent Load Zones that are neither export-constrained nor import-constrained.

Rest of System is an area established under Section III.2.7(d) of Market Rule 1.

Retail Delivery Point is the point on the transmission or distribution system at which the load of an end-use facility, which is metered and assigned a unique account number by the Host Participant, is measured to determine the amount of energy delivered to the facility from the transmission and distribution system. If an end-use facility is connected to the transmission or

distribution system at more than one location, the Retail Delivery Point shall consist of the metered load at each connection point, summed to measure the net energy delivered to the facility in each interval.

Returning Market Participant is a Market Participant, other than an FTR-Only Customer or a Governance Only Member, whose previous membership as a Market Participant was involuntarily terminated due to a Financial Assurance Default or a payment default and, since returning, has been a Market Participant for less than six consecutive months.

Revenue Requirement is defined in Section IV.A.2.1 of the Tariff.

Reviewable Action is defined in Section III.D.1.1 of Appendix D of Market Rule 1.

Reviewable Determination is defined in Section 12.4(a) of Attachment K to the OATT.

RSP Project List is defined in Section 1 of Attachment K to the OATT.

RTEP02 Upgrade(s) means a Transmission Upgrade that was included in the annual NEPOOL Transmission Plan (also known as the “Regional Transmission Expansion Plan” or “RTEP”) for the year 2002, as approved by ISO New England Inc.’s Board of Directors, or the functional equivalent of such Transmission Upgrade, as determined by ISO New England Inc. The RTEP02 Upgrades are listed in Schedule 12B of the OATT.

RTO is a regional transmission organization or comparable independent transmission organization that complies with Order No. 2000 and the Commission’s corresponding regulation.

Same Reserve Zone Export Transaction is defined in Section III.1.10.7(f)(iii) of Market Rule 1.

Sanctionable Behavior is defined in Section III.B.3 of Appendix B of Market Rule 1.

Schedule, Schedules, Schedule 1, 2, 3, 4 and 5 are references to the individual or collective schedules to Section IV.A. of the Tariff.

Schedule 20A Service Provider (SSP) is defined in Schedule 20A to Section II of this Tariff.

Scheduling Service, for purposes of Section IV.A and Section IV.B of the Tariff, is the service described in Schedule 1 to Section IV.A of the Tariff.

Scheduling, System Control and Dispatch Service, for purposes of Section II of the Tariff, is the form of Ancillary Service described in Schedule 1 of the OATT.

Seasonal Claimed Capability is the summer or winter claimed capability of a generating unit or ISO-approved combination of units, and represent the maximum dependable load carrying ability of such unit or units, excluding capacity required for station use.

Seasonal Claimed Capability Audit is the audit performed pursuant to Section III.1.5.1.3.

Seasonal DR Audit is a seasonal audit of the demand response capability of a Demand Resource initiated pursuant to Section III.13.6.1.5.4.1.

Seasonal Peak Demand Resource is a type of Demand Resource and shall mean installed measures (e.g., products, equipment, systems, services, practices and/or strategies) on end-use customer facilities that reduce the total amount of electrical energy consumed during Demand Resource Seasonal Peak Hours, while delivering a comparable or acceptable level of end-use service. Such measures include Energy Efficiency, Load Management, and Distributed Generation.

Section III.1.4 Transactions are defined in Section III.1.4.2 of Market Rule 1.

Section III.1.4 Conforming Transactions are defined in Section III.1.4.2 of Market Rule 1.

Security Agreement is Attachment 1 to the ISO New England Financial Assurance Policy.

Self-Schedule is the action of a Market Participant in committing and/or scheduling its Resource, in accordance with applicable ISO New England Manuals, to provide service in an hour, whether or not in the absence of that action the Resource would have been scheduled or dispatched by the ISO to provide the service. Demand Response Resources are not permitted to Self-Schedule.

Self-Scheduled MW is an amount, in megawatts, that is Self-Scheduled and is equal to the greater of: (i) the Resource's Economic Minimum Limit; or (ii) the Resource's Minimum Consumption Limit; or (iii) for a generating Resource for which the Regulation Self-Schedule flag is set for the hour and the unit was on Regulation for at least 20 minutes during the applicable hour of the Operating Day, the median value of all Regulation setpoints (Desired Dispatch Point) used by the Resource while regulating.

Self-Supplied FCA Resource is described in Section III.13.1.6 of Market Rule 1.

Senior Officer means an officer of the subject entity with the title of vice president (or similar office) or higher, or another officer designated in writing to the ISO by that office.

Service Agreement is a Transmission Service Agreement or an MPSA.

Service Commencement Date is the date service is to begin pursuant to the terms of an executed Service Agreement, or the date service begins in accordance with the sections of the OATT addressing the filing of unexecuted Service Agreements.

Services means, collectively, the Scheduling Service, EAS and RAS; individually, a Service.

Settlement Financial Assurance is an amount of financial assurance required from a Designated FTR Participant awarded a bid in an FTR Auction. This amount is calculated pursuant to Section VI.D of the ISO New England Financial Assurance Policy.

Settlement Only Resources are generators of less than 5 MW or otherwise eligible for Settlement Only Resource treatment as described in ISO New England Operating Procedure No. 14 and that have elected Settlement Only Resource treatment as described in the ISO New England Manual for Registration and Performance Auditing.

Seven-Day Forecast has the meaning specified in Section III.H.3.3(a).

Shortage Event is defined in Section III.13.7.1.1.1 of Market Rule 1.

Shortage Event Availability Score is the average of the hourly availability scores for each hour or portion of an hour during a Shortage Event, as described in Section III.13.7.1.1.1.A of Market Rule 1.

Shortfall Funding Arrangement, as specified in Section 5.1 of the ISO New England Billing Policy, is a separate financing arrangement that can be used to make up any non-congestion related differences between amounts received on Invoices and amounts due for ISO Charges in any bill issued.

Short-Term is a period of less than one year.

Significantly Reduced Congestion Costs are defined in Section III.G.2.2 of Appendix G to Market Rule 1.

SMD Effective Date is March 1, 2003.

Solutions Study is described in Section 4.2(b) of Attachment K to the OATT.

Special Constraint Resource (SCR) is a Resource that provides Special Constraint Resource Service under Schedule 19 of the OATT.

Special Constraint Resource Service is the form of Ancillary Service described in Schedule 19 of the OATT.

Specified-Term Blackstart Capital Payment is the annual compensation level, as calculated pursuant to Section 5.1 of Schedule 16 of the OATT, for a Designated Blackstart Resource's capital Blackstart Equipment costs associated with the provision of Blackstart Service (except for capital costs associated with adhering to NERC Critical Infrastructure Protection Reliability Standards as part of Blackstart Service).

Standard Blackstart Capital Payment is the annual compensation level, as calculated pursuant to Section 5.1 of Schedule 16 of the OATT, for a Designated Blackstart Resource's capital Blackstart Equipment costs associated with the provision of Blackstart Service (except for capital costs associated with adhering to NERC Critical Infrastructure Protection Reliability Standards as

part of Blackstart Service).

Start-of-Round Price is the highest price associated with a round of a Forward Capacity Auction as described in Section III.13.2.3.1 of Market Rule 1.

Start-Up Fee is the amount, in dollars, that must be paid for a generating unit to Market Participants with an Ownership Share in the unit each time the unit is scheduled in the New England Markets to start-up.

Start-Up Time is the time it takes the Generator Asset, after synchronizing to the system, to reach its Economic Minimum Limit and, for dispatchable Generator Assets, be ready for further dispatch by the ISO.

State Estimator means the computer model of power flows specified in Section III.2.3 of Market Rule 1.

Statements, for the purpose of the ISO New England Billing Policy, refer to both Invoices and Remittance Advices.

Static De-List Bid is a bid that may be submitted by an Existing Generating Capacity Resource, Existing Import Capacity Resource, or Existing Demand Resource in the Forward Capacity Auction to remove itself from the capacity market for a one year period, as described in Section III.13.1.2.3.1.1 of Market Rule 1.

Station is one or more Existing Generating Capacity Resources consisting of one or more assets located within a common property boundary.

Station Going Forward Common Costs are the net risk-adjusted going forward costs associated with a Station that are avoided only by (1) the clearing of the Static De-List Bids or the Permanent De-List Bids of all the Existing Generating Capacity Resources comprising the Station; or (2) the acceptance of a Non-Price Retirement Request of the Station, calculated in the same manner as the net-risk adjusted going forward costs of Existing Generating Capacity Resources as described in Section III.13.1.2.3.2.1.2.

Station-level Blackstart O&M Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Station-level Specified-Term Blackstart Capital Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Station-level Standard Blackstart Capital Payment is defined and calculated as specified in Section 5.1.2 of Schedule 16 to the OATT.

Successful FCA is a Forward Capacity Auction in which a Capacity Zone has neither Inadequate Supply nor Insufficient Competition.

Summer ARA Qualified Capacity is described in Section III.13.4.2.1.2.1.1.1 of Market Rule 1.

Summer Capability Period means one of two time periods defined by the ISO for the purposes of rating and auditing resources. The time period associated with the Summer Capability Period is the period of June 1 through September 30.

Summer Intermittent Reliability Hours are defined in Section III.13.1.2.2.2.1(c) of Market Rule 1.

Supplemental Availability Bilateral is described in Section III.13.5.3.2 of Market Rule 1.

Supplemental Capacity Resources are described in Section III.13.5.3.1 of Market Rule 1.

Supplemented Capacity Resource is described in Section III.13.5.3.2 of Market Rule 1.

Supply Offer is a proposal to furnish energy at a Node or Regulation from a Resource that meets the applicable requirements set forth in the ISO New England Manuals submitted to the ISO by a Market Participant with authority to submit a Supply Offer for the Resource. The Supply Offer will be submitted pursuant to Market Rule 1 and applicable ISO New England Manuals, and include a price and information with respect to the quantity proposed to be furnished, technical parameters for the Resource, timing and other matters. A Supply Offer is a subset of the information required in a Market Participant's Offer Data.

Supply Offer Block-Hours are Block-Hours assigned to the Lead Market Participant for each Supply Offer. The daily bid Blocks in the price-based Real-Time offer/bid will be multiplied by the number of hours in the day to determine the quantity of Supply Offer Block-Hours for a given day. In the case that a Resource has a Real-Time unit status of “unavailable” for the entire day, that day will not contribute to the quantity of Supply Offer Block-Hours. However, if the Resource has at least one hour of the day with a unit status of “available,” the entire day will contribute to the quantity of Supply Offer Block-Hours.

Synchronous Condenser is a generator that is synchronized to the grid but supplying no energy for the purpose of providing Operating Reserve or VAR or voltage support.

System Condition is a specified condition on the New England Transmission System or on a neighboring system, such as a constrained transmission element or flowgate, that may trigger Curtailment of Long-Term Firm MTF or OTF Service on the MTF or the OTF using the curtailment priority pursuant to Section II.44 of the Tariff or Curtailment of Local Long-Term Firm Point-to-Point Transmission Service on the non-PTF using the curtailment priority pursuant to Schedule 21 of the Tariff. Such conditions must be identified in the Transmission Customer’s Service Agreement.

System Impact Study is an assessment pursuant to Part II.B, II.C, II.G, Schedule 21, Schedule 22, or Schedule 23 of the OATT of (i) the adequacy of the PTF or Non-PTF to accommodate a request for the interconnection of a new or materially changed generating unit or a new or materially changed interconnection to another Control Area or new Regional Network Service or new Local Service or an Elective Transmission Upgrade, and (ii) whether any additional costs may be required to be incurred in order to provide the interconnection or transmission service.

System Operator shall mean ISO New England Inc. or a successor organization.

System-Wide Capacity Demand Curve is the demand curve used in the Forward Capacity Market as specified in Section III.13.2.2.

TADO is the total amount due and owing (not including any amounts due under Section 14.1 of the RNA) at such time to the ISO, NEPOOL, the PTOs, the Market Participants and the Non-

Market Participant Transmission Customers, by all PTOs, Market Participants and Non-Market Participant Transmission Customers.

Tangible Net Worth is the value, determined in accordance with international accounting standards or generally accepted accounting principles in the United States, of all of that entity's assets less the following: (i) assets the ISO reasonably believes to be restricted or potentially unavailable to settle a claim in the event of a default (e.g., regulatory assets, restricted assets, and Affiliate assets), net of any matching liabilities, to the extent that the result of that netting is a positive value; (ii) derivative assets, net of any matching liabilities, to the extent that the result of that netting is a positive value; (iii) the amount at which the liabilities of the entity would be shown on a balance sheet in accordance with international accounting standards or generally accepted accounting principles in the United States; (iv) preferred stock; (v) non-controlling interest; and (vi) all of that entity's intangible assets (e.g., patents, trademarks, franchises, intellectual property, goodwill and any other assets not having a physical existence), in each case as shown on the most recent financial statements provided by such entity to the ISO.

Technical Committee is defined in Section 8.2 of the Participants Agreement.

Ten-Minute Non-Spinning Reserve (TMNSR) is the reserve capability of a generating unit that can be converted fully into energy within ten minutes from the request of the ISO, and is provided by generating units that are either electrically synchronized or not electrically synchronized to the New England Transmission System or the reserve capability of a Dispatchable Asset Related Demand that can be fully utilized within ten minutes from the request of the ISO to reduce consumption.

Ten-Minute Non-Spinning Reserve Service is the form of Ancillary Service described in Schedule 6 of the OATT.

Ten-Minute Spinning Reserve (TMSR) is the reserve capability of a generating unit that can be converted fully into energy within ten minutes from the request of the ISO or a Dispatchable Asset Related Demand pump that can reduce energy consumption to provide reserve capability within ten minutes from the request of the ISO, and is provided by generating units and Dispatchable Asset Related Demand pumps electrically synchronized to the New England Transmission System.

Ten-Minute Spinning Reserve Service is the form of Ancillary Service described in Schedule 5 of the OATT.

Third-Party Sale is any sale for resale in interstate commerce to a Power Purchaser that is not designated as part of Regional Network Load or Local Network Load under the Regional Network Service or Local Network Service, as applicable.

Thirty-Minute Operating Reserve (TMOR) means the reserve capability of a generating unit that can be converted fully into energy within thirty minutes from the request of the ISO, and is provided by generating units that are either not electrically synchronized or synchronized to the New England Transmission System or the reserve capability of a Dispatchable Asset Related Demand that can be fully utilized within thirty minutes from the request of the ISO to reduce consumption.

Thirty-Minute Operating Reserve Service is the form of Ancillary Service described in Schedule 7 of the OATT.

Through or Out Rate (TOUT Rate) is the rate per hour for Through or Out Service, as defined in Section II.25.2 of the OATT.

Through or Out Service (TOUT Service) means Point-To-Point Service over the PTF provided by the ISO with respect to a transaction that goes through the New England Control Area, as, for example, a single transaction where energy or capacity is transmitted into the New England Control Area from New Brunswick and subsequently out of the New England Control Area to New York, or a single transaction where energy or capacity is transmitted into the New England Control Area from New York through one point on the PTF and subsequently flows over the PTF prior to passing out of the New England Control Area to New York, or with respect to a transaction which originates at a point on the PTF and flows over the PTF prior to passing out of the New England Control Area, as, for example, from Boston to New York.

Tie-Line Asset is a physical transmission tie-line, or an inter-state or intra-state border arrangement created according to the ISO New England Manuals and registered in accordance with the Asset Registration Process.

Time-on-Regulation Credit is the credit associated with provision of Time-on-Regulation Megawatts and is calculated in accordance with Section III.3.2.2(b) of Market Rule 1.

Time-on-Regulation Megawatts is the amount of Regulation capability provided during one hour calculated in accordance with Section III.3.2.2(g) of Market Rule 1.

Total Available Amount is the sum of the available amount of the Shortfall Funding Arrangement and the balance in the Payment Default Shortfall Fund.

Total Blackstart Capital Payment is the annual compensation calculated under either Section 5.1 or Section 5.2 of Schedule 16 of the OATT, as applicable.

Total Blackstart O&M Payment is the annual compensation calculated under either Section 5.1 or 5.2 of Schedule 16 of the OATT, as applicable.

Total Blackstart Service Payments is monthly compensation to Blackstart Owners or Market Participants, as applicable, and as calculated pursuant to Section 5.6 of Schedule 16 to the OATT.

Total Negative Hourly Demand Response Resource Deviation means the absolute value of the sum of the negative Hourly Real-Time Demand Response Resource Deviations and negative Hourly Real-Time Emergency Generation Deviations from all Real-Time Demand Response Resources and Real-Time Emergency Generation Resources receiving Dispatch Instructions in the same hour in the same Dispatch Zone.

Total Positive Hourly Demand Response Resource Deviation means the sum of the positive Hourly Real-Time Demand Response Resource Deviations and positive Hourly Real-Time Emergency Generation Deviations from all Real-Time Demand Response Resources and Real-Time Emergency Generation Resources receiving Dispatch Instructions in the same hour in the same Dispatch Zone.

Total System Capacity is the aggregate capacity supply curve for the New England Control Area as determined in accordance with Section III.13.2.3.3 of Market Rule 1.

Transaction Unit (TU) is a type of billing determinant under Schedule 2 of Section IV.A of the Tariff used to assess charges to Customers.

Transition Period: The six-year period commencing on March 1, 1997.

Transmission Charges, for the purposes of the ISO New England Financial Assurance Policy and the ISO New England Billing Policy, are all charges and payments under Schedules 1, 8 and 9 of the OATT.

Transmission Congestion Credit means the allocated share of total Transmission Congestion Revenue credited to each holder of Financial Transmission Rights, calculated and allocated as specified in Section III.5.2 of Market Rule 1.

Transmission Congestion Revenue is defined in Section III.5.2.5(a) of Market Rule 1.

Transmission Credit Limit is a credit limit, not to be used to meet FTR Requirements, established for each Market Participant in accordance with Section II.D and each Non-Market Participant Transmission Customer in accordance with Section V.B.2 of the ISO New England Financial Assurance Policy.

Transmission Credit Test Percentage is calculated in accordance with Section III.B.1(c) of the ISO New England Financial Assurance Policy.

Transmission Customer is any Eligible Customer that (i) executes, on its own behalf or through its Designated Agent, an MPSA or TSA, or (ii) requests in writing, on its own behalf or through its Designated Agent, that the ISO, the Transmission Owner, or the Schedule 20A Service Provider, as applicable, file with the Commission, a proposed unexecuted MPSA or TSA containing terms and conditions deemed appropriate by the ISO (in consultation with the applicable PTO, OTO or Schedule 20A Service Provider) in order that the Eligible Customer may receive transmission service under Section II of this Tariff. A Transmission Customer under Section II of this Tariff includes a Market Participant or a Non-Market Participant taking Regional Network Service, Through or Out Service, MTF Service, OTF Service, Ancillary Services, or Local Service.

Transmission Default Amount is all or any part of any amount of Transmission Charges due to be paid by any Covered Entity that the ISO, in its reasonable opinion, believes will not or has not been paid when due.

Transmission Default Period is defined in Section 3.4.f of the ISO New England Billing Policy.

Transmission Late Payment Account is defined in Section 4.2 of the ISO New England Billing Policy.

Transmission Late Payment Account Limit is defined in Section 4.2 of the ISO New England Billing Policy.

Transmission Late Payment Charge is defined in Section 4.1 of the ISO New England Billing Policy.

Transmission, Markets and Services Tariff (Tariff) is the ISO New England Inc. Transmission, Markets and Services Tariff, as amended from time to time.

Transmission Obligations are determined in accordance with Section III.A(vi) of the ISO New England Financial Assurance Policy.

Transmission Operating Agreement (TOA) is the Transmission Operating Agreement between and among the ISO and the PTOs, as amended and restated from time to time.

Transmission Owner means a PTO, MTO or OTO.

Transmission Provider is the ISO for Regional Network Service and Through or Out Service as provided under Section II.B and II.C of the OATT; Cross-Sound Cable, LLC for Merchant Transmission Service as provided under Schedule 18 of the OATT; the Schedule 20A Service Providers for Phase I/II HVDC-TF Service as provided under Schedule 20A of the OATT; and the Participating Transmission Owners for Local Service as provided under Schedule 21 of the OATT.

Transmission Requirements are determined in accordance with Section III.A(iii) of the ISO

New England Financial Assurance Policy.

Transmission Security Analysis Requirement shall be determined pursuant to Section III.12.2.1.2.

Transmission Service Agreement (TSA) is the initial agreement and any amendments or supplements thereto: (A) in the form specified in either Attachment A or B to the OATT, entered into by the Transmission Customer and the ISO for Regional Network Service or Through or Out Service; (B) entered into by the Transmission Customer with the ISO and PTO in the form specified in Attachment A to Schedule 21 of the OATT; (C) entered into by the Transmission Customer with an OTO or Schedule 20A Service Provider in the appropriate form specified under Schedule 20 of the OATT; or (D) entered into by the Transmission Customer with a MTO in the appropriate form specified under Schedule 18 of the OATT. A Transmission Service Agreement shall be required for Local Service, MTF Service and OTF Service, and shall be required for Regional Network Service and Through or Out Service if the Transmission Customer has not executed a MPSA.

Transmission Upgrade(s) means an upgrade, modification or addition to the PTF that becomes subject to the terms and conditions of the OATT governing rates and service on the PTF on or after January 1, 2004. This categorization and cost allocation of Transmission Upgrades shall be as provided for in Schedule 12 of the OATT.

UDS is unit dispatch system software.

Unconstrained Export Transaction is defined in Section III.1.10.7(f)(iv) of Market Rule 1.

Uncovered Default Amount is defined in Section 3.3(i) of the ISO New England Billing Policy.

Uncovered Transmission Default Amounts are defined in Section 3.4.f of the ISO New England Billing Policy.

Unrated means a Market Participant that is not a Rated Market Participant.

Unsecured Covered Entity is, collectively, an Unsecured Municipal Market Participant and an Unsecured Non-Municipal Covered Entity.

Unsecured Municipal Default Amount is defined in Section 3.3(i) of the ISO New England Billing Policy.

Unsecured Municipal Market Participant is defined in Section 3.3(h) of the ISO New England Billing Policy.

Unsecured Municipal Transmission Default Amount is defined in Section 3.4.f of the ISO New England Billing Policy.

Unsecured Non-Municipal Covered Entity is a Covered Entity that is not a Municipal Market Participant or a Non-Market Participant Transmission Customer and has a Market Credit Limit or Transmission Credit Limit of greater than \$0 under the ISO New England Financial Assurance Policy.

Unsecured Non-Municipal Default Amount is defined in Section 3.3(i) of the ISO New England Billing Policy.

Unsecured Non-Municipal Transmission Default Amount is defined in Section 3.3(i) of the ISO New England Billing Policy.

Unsecured Transmission Default Amounts are, collectively, the Unsecured Municipal Transmission Default Amount and the Unsecured Non-Municipal Transmission Default Amount.

Updated Measurement and Verification Plan is an optional Measurement and Verification Plan that may be submitted as part of a subsequent qualification process for a Forward Capacity Auction prior to the beginning of the Capacity Commitment Period of the Demand Resource project. The Updated Measurement and Verification Plan may include updated Demand Resource project specifications, measurement and verification protocols, and performance data as described in Section III.13.1.4.3.1.2 of Market Rule 1 and the ISO New England Manuals.

VAR CC Rate is the CC rate paid to Qualified Reactive Resources for VAR Service capability

under Section IV.A of Schedule 2 of the OATT.

VAR Payment is the payment made to Qualified Reactive Resources for VAR Service capability under Section IV.A of Schedule 2 of the OATT.

VAR Service is the provision of reactive power voltage support to the New England Transmission System by a Qualified Reactive Resource or by other generators that are dispatched by the ISO to provide dynamic reactive power as described in Schedule 2 of the OATT.

Virtual Requirements are determined in accordance with Section III.A(iv) of the ISO New England Financial Assurance Policy.

Volt Ampere Reactive (VAR) is a measurement of reactive power.

Volumetric Measure (VM) is a type of billing determinant under Schedule 2 of Section IV.A of the Tariff used to assess charges to Customers under Section IV.A of the Tariff.

Winter ARA Qualified Capacity is described in Section III.13.4.2.1.2.1.1.2 of Market Rule 1.

Winter Capability Period means one of two time periods defined by the ISO for the purposes of rating and auditing resources. The time period associated with the Winter Capability Period is the period October 1 through May 31.

Winter Intermittent Reliability Hours are defined in Section III.13.1.2.2.2.2(c) of Market Rule 1.

Year means a period of 365 or 366 days, whichever is appropriate, commencing on, or on the anniversary of March 1, 1997. Year One is the Year commencing on March 1, 1997, and Years Two and higher follow it in sequence.

Zonal Price is calculated in accordance with Section III.2.7 of Market Rule 1.

III.12, III.12 Calculation of Capacity Requirements, 10.0.0, A
Record Narrative Name: III.12 - Calculation of Capacity Requirements
Tariff Record ID: 140
Tariff Record Collation Value: 801169810 Tariff Record Parent Identifier: 127
Proposed Date: 2014-09-01
Priority Order: 50
Record Change Type: CHANGE
Record Content Type: 1
Associated Filing Identifier:

III.12 Calculation of Capacity Requirements

III.12.1 Installed Capacity Requirement.

Prior to each Forward Capacity Auction, the ISO shall calculate the Installed Capacity Requirement for the New England Control Area for each upcoming Capacity Commitment Period through the Capacity Commitment Period associated with that Forward Capacity Auction in accordance with this Section III.12.1.

The ISO shall determine the Installed Capacity Requirement such that the probability of disconnecting non-interruptible customers due to resource deficiency, on average, will be no more than once in ten years. Compliance with this resource adequacy planning criterion shall be evaluated probabilistically, such that the Loss of Load Expectation (“LOLE”) of disconnecting non-interruptible customers due to resource deficiencies shall be no more than 0.1 day each year. The forecast Installed Capacity Requirement shall meet this resource adequacy planning criterion for each Capacity Commitment Period. The Installed Capacity Requirement shall be determined assuming all resources pursuant to Sections III.12.7 and III.12.9 will be deliverable to meet the forecasted demand determined pursuant to Section III.12.8.

If the Installed Capacity Requirement shows a consistent bias over time, either high or low, the ISO shall make adjustments to the modeling assumptions and/or methodology through the stakeholder process to eliminate the bias in the Installed Capacity Requirement. The modeling assumptions used in determining the Installed Capacity Requirement are specified in Sections III.12.7, III.12.8 and III.12.9. For the purpose of this Section III.12, a “resource” shall include generating resources, demand resources, and import capacity resources eligible to receive capacity payments in the Forward Capacity Market.

The ISO shall determine, by applying the same modeling assumptions and methodology used in determining the Installed Capacity Requirement, the capacity requirement value for each LOLE probability specified in Section III.13.2.2 for the System-Wide Capacity Demand Curve.

III.12.2 Local Sourcing Requirements and Maximum Capacity Limits.

Prior to each Forward Capacity Auction, the ISO shall calculate the capacity requirements and limitations, accounting for relevant transmission interface limits which shall be determined pursuant to Section III.12.5, for each modeled Capacity Zone (as described in Section III.12.4) for each upcoming Capacity Commitment Period through the Capacity Commitment Period associated with that Forward Capacity Auction. The Local Sourcing Requirement shall represent the minimum amount of capacity that must be procured within an import-constrained Capacity Zone. The Maximum Capacity Limit shall represent the maximum amount of capacity that can be procured in an export-constrained Capacity Zone to meet the Installed Capacity Requirement.

The ISO shall use consistent assumptions and standards to establish a resource's electrical location for purposes of qualifying a resource for the Forward Capacity Market and for purposes of calculating Local Sourcing Requirements and Maximum Capacity Limits. The methodology used in determining the Local Sourcing Requirements and the Maximum Capacity Limits are specified in Sections III.12.2.1 and III.12.2.2, respectively. The modeling assumptions used in determining the Local Sourcing Requirements and the Maximum Capacity Limits are specified in Sections III.12.5, III.12.6, III.12.7, III.12.8 and III.12.9.

III.12.2.1 Calculation of Local Sourcing Requirements for Import-Constrained Capacity Zones.

For each import-constrained Capacity Zone, the Local Sourcing Requirement shall be the amount needed to satisfy the higher of: (i) the Local Resource Adequacy Requirement as determined pursuant to Section III.12.2.1.1; or (ii) the Transmission Security Analysis Requirement as determined pursuant to Section III.12.2.1.2.

III.12.2.1.1 Local Resource Adequacy Requirement.

The Local Resource Adequacy Requirement shall be calculated as follows:

- (a) Two areas shall be modeled: (i) the Capacity Zone under study which includes all load and all resources electrically located within the Capacity Zone, including external Control Area support from tie benefits on the import-constrained side of the interface, if any; and (ii) the rest of the New England Control Area which includes all load and all resources electrically located within the rest of the New England Control Area, including external Control Area support from tie benefits on the unconstrained side of the interface, if any.

(b) The only transmission constraint to be modeled shall be the transmission interface limit between the Capacity Zone under study and the rest of the New England Control Area as identified pursuant to Section III.12.5.

(c) Any proxy units that are required in the New England Control Area pursuant to Section III.12.7.1 shall be modeled as specified in Section III.12.7.1, in order to ensure that the New England Control Area meets the resource adequacy planning criterion specified in Section III.12.1. If the system LOLE is less than 0.1 days/year, firm load is added (or unforced capacity is subtracted) so that the system LOLE equals 0.1 days/year.

(d) The Local Resource Adequacy Requirement for the import-constrained Capacity Zone Z shall be determined in accordance with the following formula:

$$LRA_Z = Resources_Z + Proxy Units_Z - (Proxy Units Adjustment_Z(1-FOR_Z)) - (Firm Load Adjustment_Z(1-FOR_Z))$$

In which:

LRA_Z = MW of Local Resource Adequacy Requirement for Capacity Zone Z;

$Resources_Z$ = MW of resources electrically located within Capacity Zone Z, including import Capacity Resources on the import-constrained side of the interface, if any;

$Proxy Units_Z$ = MW of proxy unit additions in Load Zone Z;

$Firm Load Adjustment_Z$ = MW of firm load added (or subtracted) within Capacity Zone Z to make the LOLE of the New England Control Area equal to 0.105 days per year; and

FOR_Z = Capacity weighted average of the forced outage rate modeled for all

resources within Capacity Zone Z,
including and proxy unit additions to
Capacity Zone Z.

Proxy Units

Adjustment = MW of firm load added to (or unforced
capacity subtracted from) Capacity Zone Z
until the system LOLE equals 0.1
days/year.

To determine the Local Resource Adequacy Requirement, the firm load is adjusted within Capacity Zone Z until the LOLE of the New England Control Area reaches 0.105 days per year. The LOLE of 0.105 days per year includes an allowance for transmission related LOLE of 0.005 days per year associated with each interface. As firm load is added to (or subtracted from) Capacity Zone Z, an equal amount of firm load is removed from (or added to) the rest of New England Control Area.

III.12.2.1.2 Transmission Security Analysis Requirement.

A Transmission Security Analysis shall be used to determine the requirement of the zone being studied, and shall include the following features:

- (a) The ISO shall perform a series of transmission load flow studies and/or a deterministic operable capacity analysis targeted at determining the performance of the system under stressed conditions, and at developing a resource requirement sufficient to allow the system to operate through those stressed conditions.
- (b) The Transmission Security Analysis Requirement shall be set at a level sufficient to cover most reasonably anticipated events, but will not guarantee that every combination of obligated resources within the zone will meet system needs.
- (c) In performing the Transmission Security Analysis, the ISO may establish static transmission interface transfer limits, as identified pursuant to Section III.12.5, as a reasonable representation of the transmission system's capability to serve load with available existing resources.

(d) The Transmission Security Analysis may model the entire New England system and individual zones, for both the first contingency (N-1) and second contingency (N-1-1) conditions. First contingency conditions (N-1) shall include the loss of the most critical generator or most critical transmission element with respect to the zone. Second contingency conditions (N-1-1) shall include both: (i) the loss of the most critical generator with respect to the zone followed by the loss of the most critical transmission element (“Line-Gen”); and (ii) the loss of the most critical transmission element followed by the loss of the next most critical transmission element (“Line-Line”) with respect to the zone.

III.12.2.2 Calculation of Maximum Capacity Limit for Export-Constrained Capacity Zones.

For each export-constrained Capacity Zone, the Maximum Capacity Limit shall be calculated using the following method:

(a) Two areas shall be modeled: (i) the Capacity Zone under study which includes all load and all resources electrically located within the Capacity Zone, including external Control Area support from tie benefits on the export-constrained side of the interface, if any; and (ii) the rest of the New England Control Area, which includes all load and all resources electrically located within the rest of the New England Control Area, including external Control Area support from tie benefits to the rest of the New England Control Area, if any.

(b) The only transmission constraint to be modeled shall be the transmission interface limit between the Capacity Zone under study and the rest of the New England Control Area as identified pursuant to Section III.12.5.

(c) Any proxy units that are required in the New England Control Area pursuant to Section III.12.7.1 shall be modeled as specified in Section III.12.7.1, in order to ensure that the New England Control Area meets the resource adequacy planning criterion specified in Section III.12.1. If the system LOLE is less than 0.1 days/year, firm load is added (or unforced capacity is subtracted) so that the system LOLE equals 0.1 days/year.

(d) The Maximum Capacity Limit for the export-constrained Capacity Zone Y shall be determined in accordance with the following formula:

$$\text{Maximum Capacity Limit}_Y = \text{ICR} - \text{LRA}_{\text{RestofNewEngland}}$$

In which:

Maximum Capacity Limit_Y = Maximum MW amount of resources , including Import Capacity Resources on the export-constrained side of the interface, if any, that can be procured in the export-constrained Capacity Zone Y to meet the Installed Capacity Requirement;

ICR = MW of Installed Capacity Requirement for the New England Control Area, determined in accordance with Section III.12.1; and

LRA_{RestofNewEngland} = MW of Local Sourcing Requirement for the rest of the New England Control Area, which for the purposes of this calculation is treated as an import-constrained region, determined in accordance with Section III.12.2.1.

III.12.3 Consultation and Filing of Capacity Requirements.

At least two months prior to filing the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve for each upcoming Capacity Commitment Period through the relevant Capacity Commitment Period with the Commission, the ISO shall review the modeling assumptions and resulting Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve with the Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies. Following consultation with Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies, the ISO shall file the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve for each upcoming Capacity Commitment Period through the relevant Capacity Commitment Period with the Commission pursuant to Section 205 of the Federal Power Act 90 days prior to the Forward Capacity Auction for the Capacity Commitment Period. The ISO shall file with the Commission pursuant to Section 205 of the Federal Power Act, the proposed identification of a potential new Capacity Zone when the boundary of the potential new Capacity

Zone differs from the boundaries of existing Load Zones or Capacity Zones. In order to be used in a given FCA, any new Capacity Zone must have received approval from the Commission prior to the Existing Capacity Qualification Deadline of the applicable FCA.

III.12.4 Capacity Zones.

For each Forward Capacity Auction, the ISO shall, using the results of the most recent annual assessment of transmission transfer capability conducted pursuant to ISO Tariff Section II, Attachment K, determine the Capacity Zones to model as described below, and will include such designations in its filing with the Commission pursuant to Section III.13.8.1:

(a) The ISO shall model in the Forward Capacity Auction, as separate export-constrained Capacity Zones, those zones identified in the most recent annual assessment of transmission transfer capability pursuant to ISO Tariff Section II, Attachment K, for which the Maximum Capacity Limit is less than the sum of the existing qualified capacity and proposed new capacity that could qualify to be procured in the export constrained Capacity Zone, including existing and proposed new Import Capacity Resources on the export-constrained side of the interface.

(b) The ISO shall model in the Forward Capacity Auction, as separate import-constrained Capacity Zones, those zones identified in the most recent annual assessment of transmission transfer capability pursuant to ISO Tariff Section II, Attachment K, for which the second contingency transmission capability results in a line-line Transmission Security Analysis Requirement, calculated pursuant to Section III.12.2.1.2 and pursuant to ISO New England Planning Procedures, that is greater than the Existing Qualified Capacity in the zone, with the largest generating station in the zone modeled as out-of-service. Each assessment will model out-of-service all Non-Price Retirement Requests (including any received for the current FCA at the time of this calculation) and Permanent De-List Bids as well as rejected for reliability Static De-List Bids from the most recent previous Forward Capacity Auction and rejected for reliability Dynamic De-List Bids from the most recent previous Forward Capacity Auction.

(c) Adjacent Load Zones that are neither export-constrained nor import-constrained shall be modeled together as the Rest of Pool Capacity Zone in the Forward Capacity Auction.

III.12.5 Transmission Interface Limits.

Transmission interface limits, used in the determination of Local Sourcing Requirements, shall be

determined pursuant to ISO Tariff Section II, Attachment K using network models that include all resources, existing transmission lines and proposed transmission lines that the ISO determines, in accordance with Section III.12.6, will be in service no later than the first day of the relevant Capacity Commitment Period. The transmission interface limits shall be established, using deterministic analyses, at levels that provide acceptable thermal, voltage and stability performance of the system both with all lines in service and after any criteria contingency occurs as specified in ISO New England Manuals and ISO New England Administrative Procedures.

III.12.6 Modeling Assumptions for Determining the Network Model.

The ISO shall determine, in accordance with this Section III.12.6, the generating units and transmission infrastructure to include in the network model that: (i) are expected to be in service no later than the first day of the relevant Capacity Commitment Period; and (ii) may have a material impact on the network model, a potential interface constraint, or on one or more Local Sourcing Requirements. The network model shall be used, among other purposes, (i) for the Forward Capacity Market qualification process and (ii) to calculate transmission interface limits in order to forecast the Local Sourcing Requirements. The network model shall include generating units and associated Interconnection Facilities as specified in subsection (a) and Transmission Upgrades as specified in subsection (b).

(a) Generating units and associated Interconnection Facilities that shall be included in the network model for the relevant Capacity Commitment Period shall include:

(i) all existing resources that have not been approved to be retired for the relevant Capacity Commitment Period, as described in Section III.13.2.5.2.5.3;

(ii) all generating units that are resources cleared in previous Forward Capacity Auctions or obligated for the relevant Capacity Commitment Period that have a valid Interconnection Request for which a draft Interconnection System Impact Study report has been submitted to the Interconnection Customer; and

iii. any generating unit that has a valid Interconnection Request for which a draft Interconnection Feasibility Study report has been submitted to the Interconnection Customer and is reasonably expected to declare commercial operation no later than the first day of the relevant Capacity Commitment Period whether or not such unit is

participating in the Forward Capacity Market qualification process.

(b) Prior to each Forward Capacity Auction and each annual reconfiguration auction, the ISO shall determine and publish a list of the transmission projects and elements of transmission projects that will be included in the network model. During the process of making the transmission infrastructure determinations, as described in Section III.12.6.1, the ISO shall consult with the Governance Participants, the Transmission Owners, any transmission project proponents, the state utility regulatory agencies in New England and, as appropriate, other state agencies.

III.12.6.1 Process for Establishing the Network Model

(a) The ISO shall establish an initial network model prior to the Forward Capacity Auction that only includes transmission infrastructure that is already in service at the time that the initial network model is developed.

(b) After establishing the initial network model, the ISO shall compile a preliminary list of the transmission projects or elements of transmission projects in the RSP Project List, individually or in combination with each other, as appropriate, to identify transmission projects that may achieve an in-service date no later than the first day of the relevant Capacity Commitment Period and that will have a material impact on the network model, on a potential interface constraint or one or more Local Sourcing Requirements.

(c) For the transmission projects or elements of transmission projects in the RSP Project List that are included in the preliminary list developed pursuant to subsection (b), the ISO shall determine whether the transmission projects or elements of transmission projects meet all of the initial threshold milestones specified in Section III.12.6.2 and will be considered for further evaluation pursuant to subsection (d).

(d) For those transmission projects or elements of transmission projects that meet the initial threshold milestones in subsection (c), the ISO shall use the evaluation criteria specified in Section III.12.6.3, and any other relevant information, to determine whether to include a transmission project or element of a transmission project in the final network model.

(e) If after completing its evaluation pursuant to Sections III.12.6.1 through III.12.6.3 and

conferring with the transmission project proponents, the Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies, the ISO determines that the transmission project or a portion of the transmission project is reasonably expected to be in service no later than the first day for the relevant Capacity Commitment Period, then such transmission project or portion of transmission project shall be considered in service in the finalized network model to calculate the transmission interface limits pursuant to Section III.12.5.

III.12.6.2 Initial Threshold to be Considered In-Service.

The ISO shall determine whether transmission projects or elements of transmission projects meet all of the following initial threshold milestones:

- (a) A critical path schedule for the transmission project has been furnished to ISO showing that the transmission project or the element of the transmission project will be in-service no later than the first day of the relevant Capacity Commitment Period. The critical path schedule must be sufficiently detailed to allow the ISO to evaluate the feasibility of the schedule.
- (b) At the time of the milestone review, siting and permitting processes, if required, are on schedule as shown on the critical path schedule.
- (c) At the time of the milestone review, engineering is on schedule as shown on the critical path schedule.
- (d) At the time of the milestone review, land acquisition, if required, is on schedule as shown on the critical path schedule.
- (e) Corporate intent to build the transmission project has been furnished to the ISO. An officer of the host Transmission Owner has submitted to the ISO a statement verifying that the officer has reviewed the proposal and critical path schedule submitted to the ISO, and the Transmission Owner concurs that the schedule is achievable, and it is the intent of the Transmission Owner to build the proposed transmission project in accordance with that schedule. The Transmission Owner may develop alternatives or modifications to the transmission project during the course of design of the transmission project that accomplish at least the same transfer capability. Such alternatives or modifications are acceptable, so long as the ISO determines that the alternative or modification is reasonably expected to achieve an in-service date no later than the first day of the relevant Capacity Commitment Period. The provision of an officer's statement

shall be with the understanding that the statement shall not create any liability on the officer and that any liability with respect to the Transmission Owner's obligations shall be as set forth in the Transmission Operating Agreement and shall not be affected by such officer's statement.

III.12.6.3 Evaluation Criteria.

For a transmission project or element of a transmission project that meets the initial threshold milestones specified in Section III.12.6.2, the ISO shall consider the following factors and any other relevant information to determine whether to include the transmission project or element of the transmission project in the network model for the relevant Capacity Commitment Period.

- (a) Sufficient engineering to initiate construction is on schedule as shown on the critical path schedule.
- (b) Approval under Section I.3.9 of the Transmission, Markets and Services Tariff, if required, has been obtained or is on schedule to be obtained as shown on the critical path schedule.
- (c) Significant permits, including local permits, if required to initiate construction have been obtained or are on schedule consistent with the critical path schedule.
- (d) Easements, if required, have been obtained or are on schedule consistent with the critical path schedule. Needed land purchases, if required, have been made or are on schedule consistent with the critical path schedule.
- (e) Any contracts required to procure or construct a transmission project are in place consistent with the critical path schedule. The ISO's analysis may also take into account whether such contracts contain incentive and/or penalty clauses to encourage third parties to advance the delivery of material services to conform with the critical path schedule.
- (f) Physical site work is on schedule consistent with the critical path schedule.
- (g) The transmission project is in a designated National Interest Electric Transmission Corridor in accordance with Section 216 of the Federal Power Act, 16 U.S.C. §§ 824p.

III.12.7 Resource Modeling Assumptions.

III.12.7.1 Proxy Units.

When the available resources are insufficient for the unconstrained New England Control Area to meet the resource adequacy planning criterion specified in Section III.12.1, proxy units shall be used as additional capacity to determine the Installed Capacity Requirement, Local Resource Adequacy Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve. The proxy units shall reflect resource capacity and outage characteristics such that when the proxy units are used in place of all other resources in the New England Control Area, the reliability, or LOLE, of the New England Control Area does not change. The outage characteristics are the summer capacity weighted average availability of the resources in the New England Control Area as determined in accordance with Section III.12.7.3. The capacity of the proxy unit is determined by adjusting the capacity of the proxy unit until the LOLE of the New England Control Area is equal to the LOLE calculated while using the capacity assumptions described in Section III.12.7.2.

When modeling transmission constraints for the determination of Local Resource Adequacy Requirements, the same proxy units may be added to the import-constrained zone or elsewhere in the rest of the New England Control Area depending on where system constraints exist.

III.12.7.2 Capacity.

The resources included in the calculation of the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve shall include:

- (a) all Existing Generating Capacity Resources,
- (b) resources cleared in previous Forward Capacity Auctions or obligated for the relevant Capacity Commitment Period,
- (c) all Existing Import Capacity Resources backed by a multiyear contract to provide capacity in the New England Control Area, where that multiyear contract requires delivery of capacity for the Commitment Period for which the Installed Capacity Requirement is being calculated, and

(d) Existing Demand Resources that are qualified to participate in the Forward Capacity Market and New Demand Resources that have cleared in previous Forward Capacity Auctions and obligated for the relevant Capacity Commitment Period,

but shall exclude:

(e) capacity associated with Export Bids cleared in previous Forward Capacity Auctions and obligated for the relevant Capacity Commitment Period, and

(f) resources for which Permanent De-list Bids cleared in previous Forward Capacity Auctions or for which Non-Price Retirement Requests have been received.

The rating of Existing Generating Capacity Resources and Existing Import Capacity Resources used in the calculation of the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve shall be the summer Qualified Capacity value of such resources for the relevant zone. The rating of Demand Resources shall be the summer Qualified Capacity value reduced by any reserve margin adjustment factor that is otherwise included in the summer Qualified Capacity value. The rating of resources, except for Demand Resources, cleared in previous Forward Capacity Auctions and obligated for the relevant Capacity Commitment Period shall be based on the amount of Qualified Capacity that cleared in previous Forward Capacity Auctions or obligated for the relevant Capacity Commitment Period. Resources are located within the Capacity Zones in which they are electrically connected as determined during the qualification process.

III.12.7.2.1 [Reserved.]

III.12.7.3 Resource Availability.

The Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve shall be calculated taking resource availability into account and shall be determined as follows:

For Existing Generating Capacity Resources:

(a) The most recent five-year moving average of EFORd shall be used as the measure of resource availability used in the calculation of the Installed Capacity Requirement, Local Resource Adequacy Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve. The most recent five-year moving average of EFORd shall be used as the measure of resource availability for non-peaking resources used in the calculation of Transmission Security Analysis Requirements. A deterministic adjustment factor, based on the operational experience of the ISO, shall be used as the measure of resource availability for peaking resources used in the calculation of Transmission Security Analysis Requirements, and will be reviewed periodically.

(b) [Reserved.]

(c) Once sufficient data are collected under the availability incentives in the Forward Capacity Market, a resource availability metric, which reflects resource availability in a manner that is consistent with the availability incentives in the Forward Capacity Market, shall be developed and reviewed with Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies and used in the calculation of the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve.

For resources cleared in previous Forward Capacity Auctions or obligated for the relevant Capacity Commitment Period that do not have sufficient data to calculate an availability metric as defined in subsections (a) or (c) above, class average data for similar resource types shall be used. For Demand Resources, including Real-Time Emergency Generation, historical performance data for those resources will be used to develop an availability metric for use in the calculation of the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve.

III.12.7.4 Load and Capacity Relief.

Load and capacity relief expected from system-wide implementation of the following actions specified in ISO New England Operating Procedure No. 4. Action During a Capacity Deficiency, shall be included in the calculation of the Installed Capacity Requirement, Local Resource Adequacy Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve. :

- (a) **Implement voltage reduction.** The MW value of the load relief shall be equal to the percentage load reduction achieved in the most applicable voltage reduction tests multiplied by the forecasted seasonal peak loads.
- (b) **Arrange for available Emergency energy from Market Participants or neighboring Control Areas.** These actions are included in the calculation through the use of tie benefits to meet system needs. The MW value of tie benefits is calculated in accordance with Section III.12.9.
- (c) **Maintain an adequate amount of ten-minute synchronized reserves.** The amount of system reserves included in the determination of the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve shall be consistent with those needed for reliable system operations during Emergency Conditions. When modeling transmission constraints, the reserve requirement for a zone shall be the zone's pro rata share of the forecasted system peak load multiplied by the system reserves needed for reliable system operations during Emergency Conditions.

III.12.8 Load Modeling Assumptions.

The ISO shall forecast load for the New England Control Area and for each Load Zone within the New England Control Area. The load forecasts shall be based on appropriate models and data inputs. Each year, the load forecasts and underlying methodologies, inputs and assumptions shall be reviewed with Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies. If the load forecast shows a consistent bias over time, either high or low, the ISO shall propose adjustments to the load modeling methodology to the Governance Participants, the state utility regulatory agencies in New England and, as appropriate, other state agencies to eliminate the bias.

Demand Resources shall be reflected in the load forecast as specified below:

- (a) Expected reductions from an installed or forecast Demand Resource not qualifying for or not participating in the Forward Capacity Auction shall be reflected as a reduction in the load forecast that will be used to determine the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide

Capacity Demand Curve for the relevant Capacity Commitment Period. The expected reduction from these resources will be included in the load forecast to the extent that they meet the qualification process rules, including monitoring and verification plan and financial assurance requirements. If no qualification process rules are in place for the expected reductions from these resources, they shall not be included within the load forecast.

(b) Expected reductions from an installed or forecast Demand Resource that qualifies to participate in the Forward Capacity Market, participates but does not clear in the Forward Capacity Auction, or has cleared in a previous Forward Capacity Auction and is expected to continue in the Forward Capacity Market shall not be reflected as a reduction in the load forecast that will be used to determine the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve for the relevant Capacity Commitment Period.

(c) [Reserved.]

(d) Any realized Demand Resource reductions in the historical period that received Forward Capacity Market payments for these reductions, or Demand Resource reductions that are expected to receive Forward Capacity Market payments by participating in the upcoming Forward Capacity Auction or having cleared in a previous Forward Capacity Auction, shall be added back into the appropriate historical loads to ensure that such resources are not reflected as a reduction in the load forecast that will be used to determine the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve for the relevant Capacity Commitment Period.

III.12.9 Tie Benefits.

The Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve shall be calculated assuming appropriate tie benefits, if any, available from interconnections with neighboring Control Areas. Tie benefits shall be calculated only for interconnections with directly interconnected neighboring Control Areas with which the ISO has in effect agreements providing for emergency support to New England, including but not limited to inter-Control Area coordination agreements, emergency aid agreements and the NPCC Regional Reliability Plan.

Tie benefits shall be calculated using a probabilistic multi-area reliability model, by comparing the LOLE for the New England system before and after interconnecting the system to the neighboring Control Areas. To quantify tie benefits, firm capacity equivalents shall be added until the LOLE of the isolated New England Control Area is equal to the LOLE of the interconnected New England Control Area.

III.12.9.1. Overview of Tie Benefits Calculation Procedure.

III.12.9.1.1. Tie Benefits Calculation for the Forward Capacity Auction and Annual Reconfiguration Auctions; Modeling Assumptions and Simulation Program.

For each Capacity Commitment Period, tie benefits shall be calculated for the Forward Capacity Auction and the third annual reconfiguration auction using the calculation methodology in this Section III.12.9. For the first and second annual reconfiguration auctions for a Capacity Commitment Period, the tie benefits calculated for the associated Forward Capacity Auction shall be utilized in determining the Installed Capacity Requirement, Local Sourcing Requirements, Maximum Capacity Limits and capacity requirement values for the System-Wide Capacity Demand Curve as adjusted to account for any changes in import capability of interconnections with neighboring Control Areas and changes in import capacity resources using the methodologies in Section III.12.9.6.

Tie benefits shall be calculated using the modeling assumptions developed in accordance with Section III.12.9.2 and using the General Electric Multi-area Reliability Simulation (MARS) program.

III.12.9.1.2. Tie Benefits Calculation.

The total tie benefits to New England from all directly interconnected neighboring Control Areas are calculated first using the methodology in Section III.12.9.3. Following the calculation of total tie benefits, individual tie benefits from each qualifying neighboring Control Area are calculated using the methodology in Section III.12.9.4.1. If the sum of the tie benefits from each Control Area does not equal the total tie benefits to New England, then each Control Area's tie benefits are adjusted based on the ratio of the individual Control Area tie benefits to the sum of the tie benefits calculated for each Control Area using the methodology in Section III.12.9.4.2.

Following this calculation, tie benefits are calculated for each qualifying individual interconnection or group of interconnections using the methodology in Section III.12.9.5.1. If the sum of the tie benefits from individual interconnections or groups of interconnections does not equal their associated Control Area's tie benefits, then the tie benefits of each individual interconnection or group of interconnections is adjusted based on the ratio of the tie benefits of the individual interconnection or group of interconnections to the sum of the tie benefits within the Control Area using the methodology in Section III.12.9.5.2.

III.12.9.1.3. Adjustments to Account for Transmission Import Capability and Capacity Imports.

Once the initial calculation of tie benefits is performed, the tie benefits for each individual interconnection or group of interconnections is adjusted to account for capacity imports and any changes in the import capability of interconnections with neighboring Control Areas, using the methodologies in Section III.12.9.6. Once the import capability and capacity import adjustments are completed, the sum of the tie benefits of all individual interconnections and groups of interconnections for a Control Area, with the import capability and capacity import adjustments, represents the tie benefits associated with that Control Area, and the sum of the tie benefits from all Control Areas, with the import capability and capacity import adjustments, represents the total tie benefits available to New England.

III.12.9.2. Modeling Assumptions and Procedures for the Tie Benefits Calculation.

III.12.9.2.1. Assumptions Regarding System Conditions.

In calculating tie benefits, "at criterion" system conditions shall be used to model the New England Control Area and all interconnected Control Areas.

III.12.9.2.2. Modeling Internal Transmission Constraints in New England.

In calculating tie benefits, all New England internal transmission constraints that (i) are modeled in the most recent Regional System Plan resource adequacy studies and assessments and (ii) are not addressed by either a Local Sourcing Requirement or a Maximum Capacity Limit calculation shall be modeled, using the procedures in Section III.12.9.2.5.

III.12.9.2.3. Modeling Transmission Constraints in Neighboring Control Areas.

The ISO will review annually NPCC's assumptions regarding transmission constraints in all directly interconnected neighboring Control Areas that are modeled for the tie benefits calculations. In the event that NPCC models a transmission constraint in one of the modeled neighboring Control Areas, the ISO will perform an evaluation to determine which interfaces are most critical to the ability of the neighboring Control Area to reliably provide tie benefits to New England from both operational and planning perspectives, and will model those transmission constraints in the tie benefits calculation, using the procedures in Section III.12.9.2.5.

III.12.9.2.4. Other Modeling Assumptions.

A. External transfer capability determinations. The transfer capability of all external interconnections with New England will be determined using studies that take account of the load, resource and other electrical system conditions that are consistent with those expected during the Capacity Commitment Period for which the calculation is being performed. Transfer capability studies will be performed using simulations that consider the contingencies enumerated in sub-section (iii) below.

(i) The transmission system will be modeled using the following conditions:

1. The forecast 90/10 peak load conditions for the Capacity Commitment Period;
2. Qualified Existing Generating Capacity Resources reflecting their output at their Capacity Network Resource level;
3. Qualified Existing Demand Resources reflecting their Capacity Supply Obligation received in the most recent Forward Capacity Auction;
4. Transfers on the transmission system that impact the transfer capability of the interconnection under study.

(ii) The system will be modeled in a manner that reflects the design of the interconnection. If an interconnection and its supporting system upgrades were

designed to provide incremental capacity into the New England Control Area, simulations will assume imports up to the level that the interconnection was designed to support. If the interconnection was not designed to be so comparably integrated, simulations will determine the amount of power that can be delivered into New England over the interconnection.

(iii) The simulations will take into account contingencies that address a fault on a generator or transmission facility, loss of an element without a fault, and circuit breaker failure following the loss of an element or an association with the operation of a special protection system.

B. In calculating tie benefits, New England capacity exports are removed from the internal capacity resources and are modeled as a resource in the receiving Control Area. The transfer capability of external interconnections is not adjusted to account for capacity exports.

III.12.9.2.5. Procedures for Adding or Removing Capacity from Control Areas to Meet the 0.1 Days Per Year LOLE Standard.

In calculating tie benefits, capacity shall be added or removed from the interconnected system of New England and its neighboring Control Areas, until the LOLE of New England and the LOLE of each Control Area of the interconnected system equals 0.1 days per year simultaneously. The following procedures shall be used to add or remove capacity within New England and the interconnected Control Areas to achieve that goal.

A. Adding Proxy Units within New England when the New England system is short of capacity. In modeling New England as part of the interconnected system, if New England is short of capacity to meet the 0.1 days per year LOLE, proxy units (with the characteristics identified in Section III.12.7.1) will be added to the sub-areas that are created by any modeled internal transmission constraints within New England, beginning with the sub-area with the highest LOLE. If there are no modeled internal transmission constraints in the New England Control Area, then proxy units will be added to the entire Control Area. If, as a result of the addition of one or more proxy units, the system is surplus of capacity, then the methodology in Section III.12.9.2.5(b) will be used to remove the surplus capacity.

- B.** Removing capacity from New England when the New England system is surplus of capacity. In modeling New England as part of the interconnected system, if New England is surplus of capacity to meet the 0.1 days per year LOLE, the surplus capacity will be removed from the sub-areas as follows. Resources will be removed from sub-areas with capacity surplus based on the ratio of capacity surplus in the sub-area to the total capacity surplus in these surplus sub-areas. The amount of capacity surplus for a sub-area is the amount of the Existing Qualified Capacity, and any amount of proxy units added in that sub-area that is above its 50-50 peak load forecast. Notwithstanding the foregoing, if removing resources will exacerbate a binding transmission constraint, then capacity will not be removed from that sub-area and will instead be removed from the remaining sub-areas using the same ratios described above for the removal of capacity surplus. If there are no modeled internal transmission constraints in the New England Control Area, then the surplus capacity shall be removed from the entire Control Area.
- C.** Adding capacity within neighboring Control Areas when the neighboring Control Area is short of capacity. In modeling neighboring Control Areas as part of the interconnected system, if the neighboring Control Area is short of capacity to meet the 0.1 days per year LOLE, additional capacity will be added to the neighboring Control Area's sub-areas that are created by any modeled internal transmissions constraints, beginning with the sub-area with the highest LOLE. If there are no modeled internal transmission constraints in the Control Area, then capacity will be added to the entire Control Area. The process that the neighboring Control Area utilizes in its resource adequacy study to meet its resource adequacy criterion will be utilized to add capacity to that Control Area. In filing the Installed Capacity Requirement values pursuant to Section III.12.3, the ISO will provide citations to any resource adequacy studies relied upon for these purposes. If, as a result of the capacity addition, the system is surplus of capacity, then the methodology in Section III.12.9.2.5(d) shall be used to remove the surplus capacity.
- D.** Removing capacity from neighboring Control Areas when the neighboring Control Area is surplus of capacity. In modeling neighboring Control Areas as part of the interconnected system, if the neighboring Control Area is surplus of capacity to meet the 0.1 days per year LOLE, the surplus capacity will be removed from the

neighboring Control Area's sub-areas as follows. Resources will be removed from sub-areas with capacity surplus based on the ratio of capacity surplus in the sub-area to the total capacity surplus in the surplus sub-areas. The amount of capacity surplus for a sub-area is the amount of the installed capacity in the sub-area above its 50/50 peak load forecast. For a sub-area that has a minimum locational resource requirement above its 50/50 peak load forecast, the amount of capacity surplus is the amount of the installed capacity in the sub-area above its minimum locational resource requirement. Notwithstanding the foregoing, if removing resources from a sub-area will exacerbate a binding transmission constraint, then capacity will not be removed from that sub-area and will instead be removed from the remaining sub-areas using the same ratio of capacity surplus in the sub-area to the total capacity surplus in the those remaining surplus sub-areas. If there are no modeled internal transmission constraints in the neighboring Control Area, then the surplus capacity will be removed from the entire Control Area.

- E.** Maintaining the neighboring Control Area's locational resource requirements. In modeling a neighboring Control Area with internal transmission constraints, all minimum locational resource requirements in the Control Area's sub-areas as established by the neighboring Control Area's installed capacity requirement calculations shall be observed.

III.12.9.3. Calculating Total Tie Benefits.

The total tie benefits with all qualifying directly interconnected neighboring Control Areas shall be calculated by comparing the interconnection state of the New England system with all interconnections to neighboring Control Areas connected with the interconnection state of the New England system with all interconnections with neighboring Control Areas disconnected. To calculate total tie benefits:

- A.** The New England system shall be interconnected with all directly interconnected neighboring Control Areas and the New England Control Area, and each neighboring Control Area shall be brought to 0.1 days per year LOLE simultaneously by adjusting the capacity of each Control Area, utilizing the methods for adding or removing capacity in Section III.12.9.2.5.
- B.** Once the interconnected system is brought to 0.1 days per year LOLE, the LOLE of

the New England Control Area shall be calculated a second time, with the New England system isolated from the rest of the interconnected system that was brought to 0.1 days per year LOLE.

- C. Total tie benefits shall be the sum of the amounts of firm capacity that needs to be added to the isolated New England Control Area at the point at which each interconnection with neighboring Control Areas interconnects in New England to bring the New England LOLE back to 0.1 days per year. This value is subject to adjustment in accordance with Section III.12.9.6.

III.12.9.4. Calculating Each Control Area's Tie Benefits.

III.12.9.4.1. Initial Calculation of a Control Area's Tie Benefits.

Tie benefits from each neighboring Control Area shall be determined by calculating the tie benefits for every possible interconnection state that has an impact on the tie benefit value between the New England system and the target neighboring Control Area. If two or more interconnections between New England and the target neighboring Control Area exist, then all interconnections grouped together will be used to represent the state of interconnection between New England and the target neighboring Control Area. The tie benefits from the target neighboring Control Area shall be equal to the simple average of the tie benefits calculated from all possible interconnection states, subject to adjustment in accordance with Section III.12.9.4.2.

III.12.9.4.2. Pro Ration Based on Total Tie Benefits.

If the sum of the individual Control Area tie benefits calculated in accordance with Section III.12.9.4.1 is different than the total tie benefits from all Control Areas calculated in accordance with Section III.12.9.3, then each Control Area's tie benefits shall be increased or decreased based on the ratio of the individual Control Area tie benefits to the sum of the tie benefits for each individual Control Area, so that the sum of each Control Area's tie benefits, after the pro-rata, is equal to the total tie benefits calculated in accordance with Section III.12.9.3. The pro-rated Control Area tie benefits are subject to further adjustment in accordance with Section III.12.9.6.

III.12.9.5. Calculating Tie Benefits for Individual Ties.

Tie benefits shall be calculated for an individual interconnection or group of interconnections to the extent that a discrete and material transfer capability can be identified for the interconnection or group of interconnections. All interconnections or groups of interconnections shall have equal rights in calculating individual tie benefits, with no grandfathering or incremental tie capability treatment.

For purposes of calculating tie benefits, a group of interconnections refers to two or more AC lines that operate in parallel to form a transmission interface in which there are significant overlapping contributions of each line toward establishing the transfer limit, such that the individual lines in a group of interconnections cannot be assigned individual contributions.

III.12.9.5.1. Initial Calculation of Tie Benefits for an Individual Interconnection or Group of Interconnections.

Tie benefits for an individual interconnection or group of interconnections shall be calculated by calculating tie benefits for each possible interconnection state between the New England system and the individual interconnection or group of interconnections. The tie benefits from that interconnection or group of interconnections shall be equal to the simple average of the tie benefits calculated from all possible interconnection states, subject to adjustment in accordance with Section III.12.9.5.2.

III.12.9.5.2. Pro Ration Based on Total Tie Benefits.

If the sum of the individual interconnection's or group of interconnection's tie benefits calculated in accordance with Section III.12.9.5.1 is different than the associated Control Area's tie benefits calculated in accordance with Section III.12.9.4, then the tie benefits of the individual interconnection or group of interconnections shall be adjusted based on the ratio of the tie benefits of the individual interconnection or group of interconnections to the sum of the tie benefits for each interconnection or group of interconnections in that Control Area, so that the sum of the tie benefits for each interconnection or group of interconnections in the Control Area, after the pro-ration, is equal to the total tie benefits for the Control Area calculated in accordance with Section III.12.9.4. The pro-rated tie benefits for each interconnection or group of interconnections is subject to further adjustment in accordance with Section III.12.9.6.

III.12.9.6. Accounting for Capacity Imports and Changes in External Transmission Facility Import Capability.

III.12.9.6.1. Accounting for Capacity Imports.

In the initial tie benefits calculations, capacity imports are modeled as internal resources in New England, and the import capability of the interconnections with neighboring Control Areas is not reduced to reflect the impact of capacity imports. After the initial tie benefits calculations, total tie benefits, tie benefits for each Control Area, and tie benefits from each individual interconnection or group of interconnections shall be adjusted to account for capacity imports using the methodology contained in this Section III.12.9.6.1. For the Forward Capacity Auction and third annual reconfiguration auction, this adjustment shall be applied to the tie benefit values calculated in accordance with Sections III.12.9.3, III.12.9.4 and III.12.9.5 respectively. For the first and second annual reconfiguration auctions, this adjustment shall be applied to the tie benefits values calculated for the Forward Capacity Auction.

- A.** Capacity imports shall be deducted from the import capability of each individual interconnection or group of interconnections to determine the available import capability of the interconnection or group of interconnections prior to accounting for tie benefits from those interconnections. The transfer capability of an interconnection or group of interconnections shall be determined using the procedures in Section III.12.9.2.4.A.
- B.** If the tie benefits value of an individual interconnection or group of interconnections, as determined in accordance with Section III.12.9.5, is greater than the remaining transmission import capability of the interconnection or group of interconnections after accounting for capacity imports, the tie benefit value of the individual interconnection or group of interconnections shall be equal to the remaining transmission import capability (taking into account any further adjustments to transmission import capability in accordance with Section III.12.9.6.2). If the tie benefits value of an individual interconnection or group of interconnections is not greater than the remaining transmission import capability after accounting for capacity imports, then the tie benefit value of the individual interconnection or group of interconnections shall be equal to the value determined in accordance with Section III.12.9.5 (taking into account any further adjustments to

transmission import capability in accordance with Section III.12.9.6.2).

- C. The tie benefits for each Control Area shall be the sum of the tie benefits from the individual interconnections or groups of interconnections with that Control Area, after accounting for any adjustment for capacity imports and any further adjustments to transmission import capability in accordance with Section III.12.9.6.2.
- D. The total tie benefits from all qualifying neighboring Control Areas shall be the sum of the Control Area tie benefits, after accounting for any adjustment for capacity imports and any further adjustments to transmission import capability in accordance with Section III.12.9.6.2.
- E. For purposes of determining the adjustment to tie benefits to account for capacity imports under this Section III.12.9.6.1, the capacity imports applicable for determining tie benefits for the Forward Capacity Auction shall be the Qualified Existing Import Capacity Resources for the relevant Capacity Commitment Period, and the capacity imports applicable for determining tie benefits for the annual reconfiguration auctions are those Import Capacity Resources that hold Capacity Supply Obligations for the relevant Capacity Commitment Period as of the time the tie benefits calculation is being performed for the annual reconfiguration auction.

III.12.9.6.2. Changes in the Import Capability of Interconnections with Neighboring Control Areas.

For purposes of calculating tie benefits for the Forward Capacity Auction and third annual reconfiguration auction, the most recent import capability values for an interconnection or group of interconnections with a neighboring Control Area shall be reflected in the modeling of system conditions for the tie benefits calculation. In addition, for the first and second annual reconfiguration auctions, any changes to the import capability of an interconnection or group of interconnections with a neighboring Control Area shall be reflected in the adjustment to tie benefits to account for capacity imports under Section III.12.9.6.1.

III.12.9.7 Tie Benefits Over the HQ Phase I/II HVDC-TF.

The tie benefits from the Quebec Control Area over the HQ Phase I/II HVDC-TF calculated in accordance with Section III.12.9.1 shall be allocated to the Interconnection Rights Holders or

their designees in proportion to their respective percentage shares of the HQ Phase I and the HQ Phase II facilities, in accordance with Section I of the Transmission, Markets and Services Tariff.

III.12.10 Calculating the Maximum Amount of Import Capacity Resources that May be Cleared Over External Interfaces in the Forward Capacity Auction and Reconfiguration Auctions.

For external interfaces, Import Capacity Resources shall be allowed in the Forward Capacity Auction and reconfiguration auctions up to the interface limit minus the tie benefits, calculated pursuant to Section III.12.9.1 or 12.9.2 over the applicable interface.

Document Content(s)

383-d854272c-e64f-41c5-9178-28c8c128ff7d.PDF.....1-7

383-7dd85100-65dc-4e61-b29f-d3cde47c8492.PDF.....8-128

383-c9fb90cf-9322-4f08-8b4d-30926e9ecla8.PDF.....129-249

383-86bb3cf3-13a1-4c22-8aa0-4d661b4167ad.PDF.....250-254

383-972c50b8-a747-4167-babd-2224780eff33.PDF.....255-256

FERC GENERATED TARIFF FILING.RTF.....257-382